

# East Placer

## Storm Water Quality Design Manual



May 2017

Revised May 2018

## Disclaimer

---

Although every reasonable effort has been made to ensure the integrity of the document, Placer County does not make any warranty or representation, expressed or implied, with respect to the accuracy or completeness of the information contained herein.

The storm water controls described herein are intended to meet the minimum standard of “reducing the discharge of pollutants from their MS4s to waters of the U.S. to the maximum extent practicable” as required the State Water Resources Control Board Water Quality Order No. 2013-001-DWQ National Pollutant Discharge Elimination System (NPDES) General Permit No. CAS000004 Waste Discharge Requirements for Storm Water Discharges from Small MS4s. Other permit requirements may apply and it is the responsibility of the project owner to ensure compliance with all applicable regulations.

Mention of trade names or commercial products does not constitute endorsement or recommendation of those products.

Questions or comments about the Manual should be directed to Placer County Storm Water Program staff.

Web Site (download Manual here):

<http://www.placer.ca.gov/lowimpactdevelopment>

# Table of Contents

---

<b>Chapter 1 Introduction.....</b>	<b>1-1</b>
1.1 Regulatory Background.....	1-3
1.2 Purpose of this Manual .....	1-3
1.3 Use of Outside References.....	1-4
1.4 How This Manual Relates to Other Requirements.....	1-5
1.5 Manual Revision Process .....	1-5
<b>Chapter 2 Projects Subject to Requirements.....</b>	<b>2-1</b>
2.1 Project Location .....	2-1
2.2 Project Categorization.....	2-3
2.3 Exclusions.....	2-6
2.4 Project Submittal and Approval Process.....	2-7
<b>Chapter 3 Pre-Project Site Assessment .....</b>	<b>3-1</b>
3.1 Site Assessment.....	3-1
3.1.1 Soil, Geologic, and Groundwater Characteristics .....	3-2
3.1.2 Topography, Hydrology, Snow Storage, and Drainage Characteristics.....	3-5
3.1.3 Existing Vegetation and Natural Areas.....	3-6
3.1.4 Contaminated Soil or Groundwater .....	3-7
3.1.5 Existing Improvements and Easements.....	3-7
<b>Chapter 4 Site Planning and BMP Selection .....</b>	<b>4-1</b>
4.1 Small Projects.....	4-1
4.2 Regulated Projects .....	4-2
4.2.1 Site Plan Layout .....	4-4
4.2.2 Source Control Measures.....	4-6
4.2.3 Site Design Measures (LID BMP Selection) .....	4-8
4.2.4 Storm Water Treatment and Baseline Hydromodification Management .....	4-10
4.3 Hydromodification Management Projects .....	4-12
4.4 In Lieu Program .....	4-13
<b>Chapter 5 BMP Inspection, Operation and Maintenance .....</b>	<b>5-1</b>
5.1 Operation and Maintenance Submittal Requirements at the Permitting Stage ....	5-1
5.2 Annual Self-Certification Reports.....	5-1
<b>Chapter 6 Developing a Post-Construction Storm Water Quality Plan (SWQP).....</b>	<b>6-1</b>
Using the SWQP Template (Appendix A).....	6-2
Title Page .....	6-2
Section 1 General Project Information .....	6-2
Section 2 Requirements for Small Projects.....	6-3
Section 3 Requirements for Regulated Projects.....	6-6
Section 4 Requirements for Hydromodification Management Projects .....	6-17
Section 5 Inspection and Maintenance of Post-Construction BMPs .....	6-21
Section 6 Compliance Checklist .....	6-21

## Glossary

## List of Figures

Figure 2-1 Phase II MS4 Permit Regulatory Boundaries.....	2-2
Figure 2-2 Project Category Decision Tree.....	2-3
Figure 2-3 SWQP Development and Submittal Process.....	2-7
Figure 3-1 NRCS Hydrologic Soil Groups .....	3-4
Figure 4-1 Site Plan Example.....	4-5
Figure 4-2 Selection of Storm Water Treatment/Baseline Hydromodification Controls	4-11

## List of Tables

Table 2-1 Project Categories.....	2-4
Table 2-2 Special Case Regulated Projects .....	2-5
Table 4-1 Selection of Site Design Measures for Small Projects.....	4-2
Table 4-2 Selection of Site Design Measures for Regulated Projects.....	4-9
Table 6-1 Required SWQP Sections by Project Category .....	6-1

## Appendices

Appendix A .....	Automated Template for Post-Construction Storm Water Quality Plan
Appendix B .....	Site Design Measures Fact Sheets
Appendix C.....	Source Control Measures Selection Table
Appendix D .....	SWQP Examples

# Chapter 1

## Introduction

This Storm Water Quality Design Manual (Manual) has been developed by Placer County to provide a consistent approach to storm water management within the East Placer region. For the purposes of this Manual, the East Placer region refers to the areas of Placer County subject to the requirements of the State Water Resources Control Board Water Quality Order No. 2013-001-DWQ, NPDES General Permit No. CAS000004, Waste Discharge Requirements for Storm Water Discharges from Small MS4s (Phase II MS4 Permit) as described in Chapter 2.

As development transforms undeveloped lands with impervious surfaces such as pavement, concrete, buildings, or even compacted soils, the natural infiltration of rainfall into the soil and absorption of rainfall by vegetation is inhibited. This reduction of natural retention of rainfall increases the frequency and intensity of surface runoff which can mobilize and transport sediment and pollutants into our lakes, streams and wetlands. The resulting changes in runoff patterns can also disrupt natural streams through a process known as hydromodification, causing impacts such as increased channel erosion, flooding, loss of habitat, and damage to aquatic ecosystems.



**Hydrologic changes caused by development can damage our natural waterways.**

**Photo Credit – CDM Smith**

The State of California, together with local municipalities, have developed storm water management strategies to address the adverse effects of development by implementing regulations and storm water management programs to preserve our waterways and natural hydrologic processes. Storm water permits across the country now include requirements for Low Impact Development (LID) strategies that focus on preserving key elements of a project site's pre-development hydrologic function.

LID is a design strategy where storm water runoff is treated as a valuable resource that can recharge groundwater supplies, protect and enhance natural habitat and biodiversity,

and add value to new development or redevelopment projects. Rather than discharging storm water runoff as a waste product, projects are designed to include a diverse set of post-construction storm water controls, or Best Management Practices (BMPs) that infiltrate, evapotranspire, or biotreat storm water runoff. By retaining storm water runoff on-site, downstream receiving waters are provided with protection from increased pollutant loads and alterations of hydrologic functions by increased impervious surfaces and human activities. By protecting receiving waters, LID strategies help maintain the beneficial uses of these resources including potable water sources, recreational uses and fisheries. LID can also add value to new development and redevelopment by integrating storm water management features with landscaping and other improvements rather than the more traditional approach of constructing drainage impact mitigation measures (e.g., detention basins) as disconnected, often fenced off, features.

The intent of this Manual is to promote the following LID goals:

- Minimize adverse impacts of storm water runoff on water quality, biological integrity of receiving waters, and beneficial uses of water bodies.
- Minimize the percentage of impervious surfaces on land development projects and implement mitigation measures to approximately preserve the overall pre-development water balance through infiltration, evapotranspiration, and capture and use of storm water.
- Minimize pollutant loadings from impervious surfaces such as roof tops, parking lots, and roadways through the use of properly designed, technically appropriate storm water controls, including source control measures or good housekeeping practices, LID planning and design strategies, and treatment control BMPs.
- Guide proper selection, design and maintenance of storm water BMPs to address pollutants generated by land development, minimize post-development surface flows and velocities, assure long-term functionality of BMPs, and avoid vector breeding.



**By directing storm water to natural or landscaped areas, rather than efficiently conveying it to the nearest water body, we protect our natural water resources.**

**Photo Credit – CDM Smith**

## 1.1 Regulatory Background

Local storm water regulations originate from federal regulations that began in 1987 when the Clean Water Act (CWA) was amended by the Water Quality Act to formally include storm water runoff. Congress subsequently authorized the U.S. Environmental Protection Agency (EPA) to administer the National Pollutant Discharge Elimination System (NPDES) program and issue storm water permits to municipalities regulating storm water discharges. In California, this authority was delegated from EPA to the California State Water Resources Control Board (SWRCB) and associated Regional Water Quality Control Boards (RWQCBs).

In addition to storm water regulations, RWQCBs certify that permits under Section 404 of the CWA issued by the U.S. Army Corps of Engineers (Corps) meet state water quality requirements pursuant to Section 401 of the CWA. The 401 certification program provides for protection of the physical, chemical, and biological integrity of waters. Also, pursuant to the Porter-Cologne Water Quality Act, adopted by the state, RWQCBs also regulate activities that impact “Waters of the State,” which include certain wetlands and waters not regulated by the Corps.

The Lahontan RWQCB (LRWQCB) is responsible for issuing NPDES permits and 401 certifications in the East Placer region. NPDES Municipal Separate Storm Sewer System (MS4) Permits require municipalities to implement a variety of programs to prevent pollution, improve and protect storm water quality, reduce storm water runoff, and enhance the ecologic vitality of local creeks and waterways. MS4 Permits also require that municipalities regulate new development and redevelopment projects within their jurisdiction.

## 1.2 Purpose of this Manual

This Manual provides guidance for projects that are required to comply with CWA regulations and presents LID design standards to reduce runoff, treat storm water, and provide baseline hydromodification management. This Manual is a regulatory compliance tool that addresses the requirements of the SWRCB Water Quality Order No. 2013-001-DWQ, NPDES General Permit No. CAS000004, Waste Discharge Requirements for Storm Water Discharges from Small MS4s (Phase II MS4 Permit).

Consistent with the CWA and the Phase II MS4 Permit, this Manual requires storm water controls to reduce pollutants to the maximum extent practicable (MEP). The MEP standard is an ever-evolving, flexible, and advancing concept, which considers technical and economic feasibility. Interpretation of the MEP standard will be by the jurisdictional agency that has discretion over the project.

The process of developing a Storm Water Quality Plan (SWQP) for new and redevelopment projects is outlined in this Manual and a SWQP Template is provided in Appendix A. The SWQP documents a project’s compliance with the Phase II MS4 Permit

and provides a standardized format for complete and accurate analyses which will result in more efficient design, review, and project approval.

The following website is available to view additional information regarding Placer County's storm water program activities:

[www.placer.ca.gov/stormwater](http://www.placer.ca.gov/stormwater)

The reader is encouraged to review Section E.12 - Post Construction Storm Water Management Program of the Phase II MS4 Permit which can be found at the following website:

[http://www.waterboards.ca.gov/water\\_issues/programs/stormwater/phase\\_ii\\_municipal.shtml](http://www.waterboards.ca.gov/water_issues/programs/stormwater/phase_ii_municipal.shtml)

### 1.3 Use of Outside References.

Throughout this Manual, several website references are made to assist the designer with the SWQP development. The following websites provide certain baseline information that is applicable to the understanding and development of the plan:

- Placer County Stormwater Management Manual (SWMM)  
<https://www.placer.ca.gov/departments/floodcontrol>
- Placer County Planning Division  
<http://www.placer.ca.gov/Departments/CommunityDevelopment/Planning.aspx>
- Natural Resources Conservation Service Web Soil Survey  
<http://websoilsurvey.nrcs.usda.gov/app/HomePage.htm>
- Natural Resources Conservation Service TR-55 Manual  
<http://www.hydrocad.net/pdf/TR-55%20Manual.pdf>
- California State Water Resources Control Board Database of Registered Contaminated Sites  
SWRCB: <http://geotracker.waterboards.ca.gov/>
- U.S. EPA Brownfields Information  
EPA Brownfield: <http://www.epa.gov/brownfields>

- CA Department of Toxic Substances Control Former Brownfields and Agricultural Sites  
<http://www.dtsc.ca.gov/SiteCleanup/Brownfields/>  
[http://www.dtsc.ca.gov/SiteCleanup/Cortese\\_List.cfm](http://www.dtsc.ca.gov/SiteCleanup/Cortese_List.cfm)
- California Stormwater Quality Association  
[www.casqa.org/resources/bmp-handbooks/](http://www.casqa.org/resources/bmp-handbooks/)
- California State Water Resources Control Board Impaired Water Bodies Information  
[http://www.waterboards.ca.gov/water\\_issues/programs/water\\_quality\\_assessment/](http://www.waterboards.ca.gov/water_issues/programs/water_quality_assessment/)

## 1.4 How This Manual Relates to Other Requirements

This Manual is intended to satisfy the specific requirements of the Phase II MS4 Permit as discussed above. Additional design requirements imposed by other regulations and permits, such as construction and industrial permits, local grading ordinances, CAL Green, California Environmental Quality Act (CEQA), and hydraulic design for flood control, still apply as appropriate. The governing agencies overseeing these regulations may, at their discretion, determine that designs in accordance with this Manual satisfy other requirements. Additionally, coverage under another regulation may trigger the requirement to design in accordance with this Manual. It is the project owner's responsibility to determine which regulations and permits are applicable to their project.

## 1.5 Manual Revision Process

It is recognized that LID is an emerging field, and that while every effort has been made to ensure that this Manual is complete and accurate, revisions and/or amendments may be necessary. In addition, the Phase II MS4 Permit is on a 5-year reissuance cycle, which may trigger required updates to this Manual. It is anticipated that Manual revisions will generally coincide with Phase II MS4 Permit revisions following the 5-year revision schedule. The current Phase II MS4 Permit expires in June 2018.

Administrative revisions to improve permit processing and correct problems outside of the next scheduled Phase II MS4 Permit revision shall be authorized cooperatively by the Placer County Board of Directors (or their designee responsible for storm water compliance).

This page intentionally left blank.


## Chapter 2

# Projects Subject to Requirements

The post-construction storm water control requirements described herein apply to new development and redevelopment projects approved after July 1, 2015. These requirements vary depending on the project's location and the amount of impervious surface that is being created. This chapter introduces a categorization process to define the project type and then determine the corresponding storm water requirements.

### 2.1 Project Location


The Phase II MS4 Permit compliance boundary defines the areas that are subject to the requirements of this Manual. The boundary encompasses the high elevation areas within Placer County that are located east of the Sierra Crest. The areas of Placer County that lie within the Lake Tahoe Basin are not included in this boundary because they are subject to a separate Tahoe specific MS4 permit. Projects located outside of the Phase II MS4 Permit are not subject to the requirements of this Manual, but may be subject to other post-construction storm water requirements (e.g., Construction General Permit, Industrial General Permit). The Phase II MS4 Permit area is presented in Figure 2-1 below and defines the East Placer region for the purposes of this Manual.

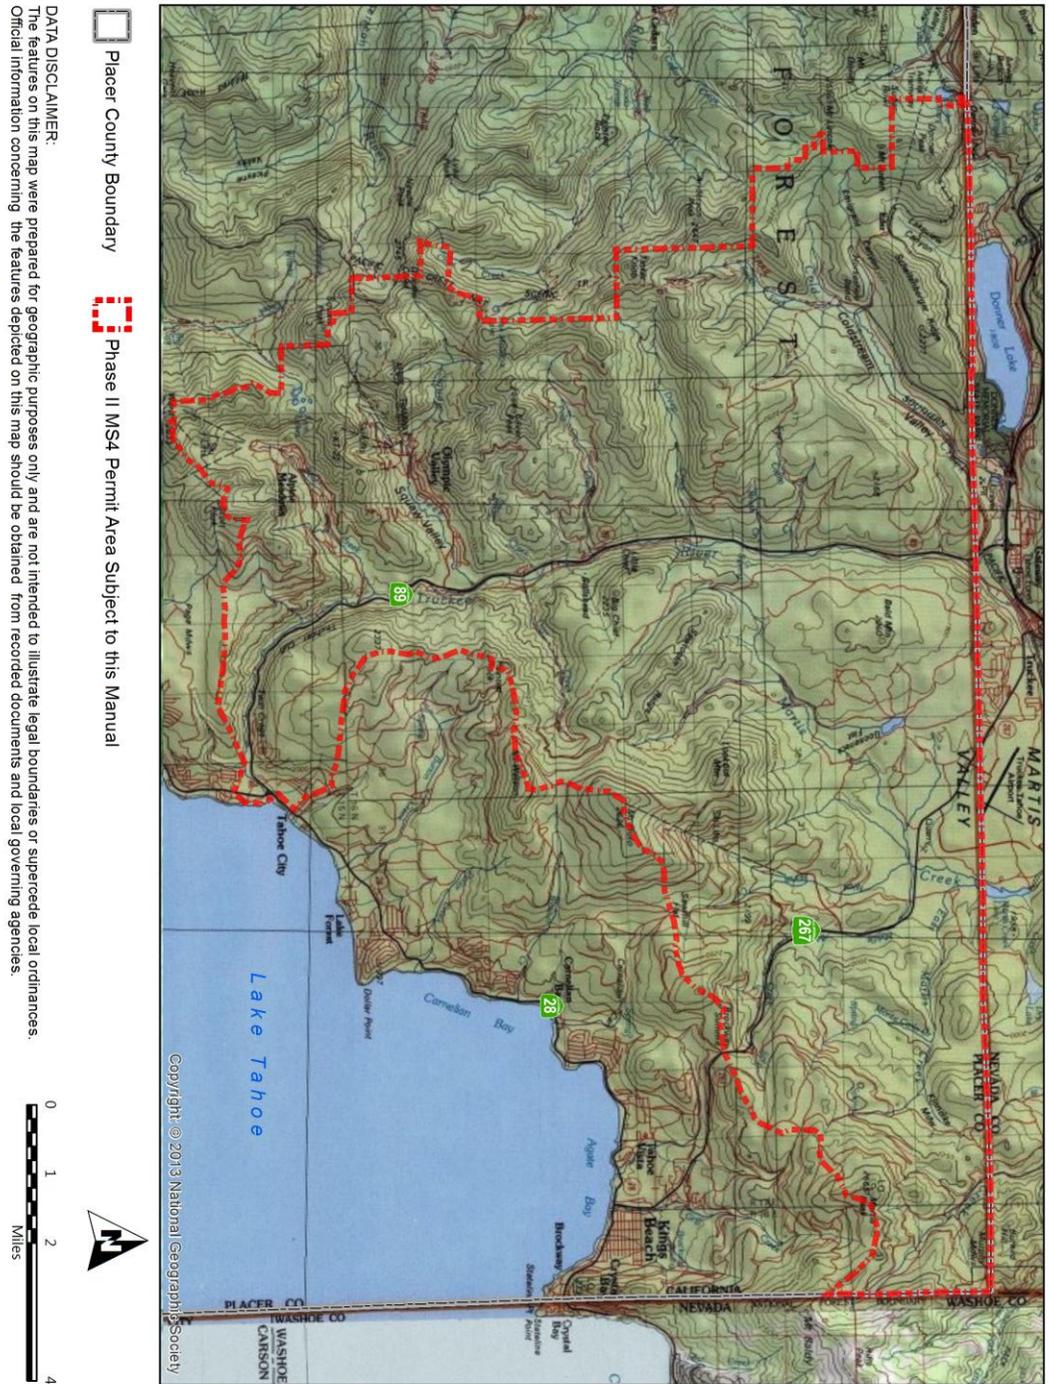

**Figure 2-1**  
**Phase II MS4 Permit Regulatory Boundaries**

## 2.2 Project Categorization

The distinction between Small Projects and Regulated Projects is based on the amount of impervious surface that is created or replaced. The decision tree, below, may be used to assist in determining the project category.

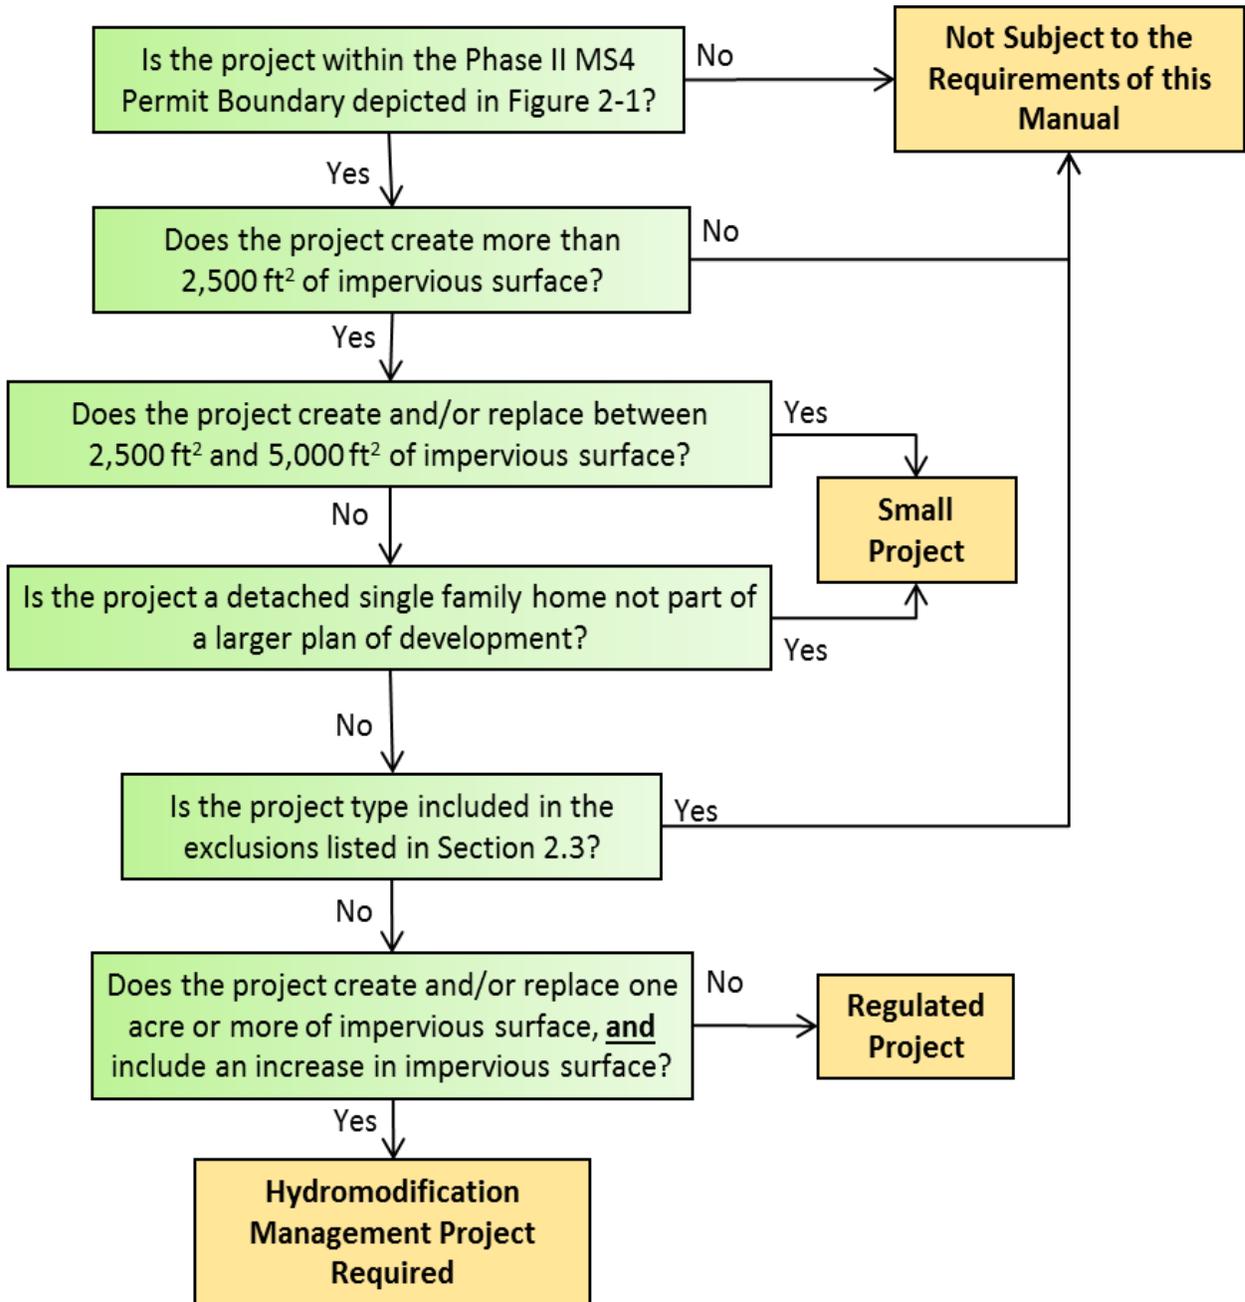

**Figure 2-2**  
Project Category Decision Tree

The definitions of the project categories and a summary of the associated storm water requirements are presented in Table 2-1. Supplemental information for Special Case Regulated Projects is presented in Table 2-2.

**Table 2-1 Project Categories**

Project Category	Definition	Post-Construction Requirements	Reference for Additional Information
Small Projects	All projects that create and/or replace (including projects with no net increase in impervious footprint) more than 2,500 and up to 5,000 square feet of impervious surface, including detached single family homes that create and/or replace 2,500 square feet or more of impervious surface and are not part of a larger plan of development.	Minimum of one Site Design Measure	Section 4.1
Regulated Projects	All projects that create and/or replace 5,000 square feet or more of impervious surface.  Includes new development and redevelopment projects on public or private land that fall under the planning and permitting authority of Placer County.	Site Assessment and Layout to optimize for capture and treatment of storm water	Chapter 3
		Source Control Measures	Section 4.2.2
		Site Design Measures to the extent technically feasible	Section 4.2.3
		Storm Water Treatment and Baseline Hydromodification Measures	Section 4.2.4
		Operations and Maintenance Plan	Section 5.1

**Table 2-2 Special Case Regulated Projects**

Project Category	Definition	Post-Construction Requirements
Regulated Redevelopment Projects	Any land-disturbing activity that results in the creation, addition, or replacement of 5,000 square feet or more exterior impervious surface area on a site on which some past development has occurred.	Where a redevelopment project results in an increase equal to or greater than 50 percent of the impervious surface of a previously existing development, runoff from the entire project, consisting of all existing, new, and/or replaced impervious surfaces must be treated per the requirements for Regulated Projects to the extent feasible.
		Where a redevelopment project results in an increase of less than 50 percent of the impervious surface of a previously existing development, only runoff from the new and/or replaced impervious surface must be treated per the requirements for Regulated Projects.
Regulated Road Projects and Regulated Linear Underground/Overhead Projects (LUPs)	<p>Any of the following types of projects that create 5,000 square feet or more of newly constructed contiguous impervious surface and that are public road projects and/or fall under the building and planning authority of Placer County:</p> <ol style="list-style-type: none"> <li>1. New streets or roads, including sidewalks and bicycle lanes built as part of the new streets or roads.</li> <li>2. Widening of existing streets or roads with additional traffic lanes.</li> <li>3. LUPs</li> </ol>	<ul style="list-style-type: none"> <li>▪ Infiltrate impervious surface runoff onsite from the post-construction 85<sup>th</sup> percentile 24-hour storm event.</li> <li>▪ Treatment of runoff that cannot be infiltrated onsite shall follow U.S. EPA guidance regarding green infrastructure to the extent feasible (EPA, 2008).</li> <li>▪ Where the addition of traffic lanes results in an alteration of equal to or greater than 50 percent of the impervious surface of an existing street or road, runoff from the entire project, consisting of all existing, new, and/or replaced impervious surfaces must be included in the treatment system design.</li> <li>▪ Where the addition of traffic lanes results in an alteration of less than 50 percent of the impervious surface of an existing street or road, only runoff from the new, and/or replaced impervious surface must be included in the treatment system design.</li> </ul>

**Table 2-2 Special Case Regulated Projects**

Project Category	Definition	Post-Construction Requirements
Hydromodification Management Projects	Regulated Projects that create and/or replace one acre or more of impervious surface. Projects that do not increase impervious surface area over the pre-project condition are not Hydromodification Management Projects.	Same as for Regulated Projects plus:  ▪ Post project runoff shall not exceed estimated pre-project flow rate for the 2-year, 24-hour storm.

## 2.3 Exclusions

Projects located outside of the East Placer Region (Figure 2-1) and projects that create and/or replace less than 2,500 square feet of impervious surface are excluded from the requirements of this Manual. The following additional specific project cases are also excluded:


- Interior remodels;
- Routine maintenance and repair activities that are conducted to maintain original line and grade, hydraulic capacity, and original purpose of facility such as: exterior wall surface replacement, reroofing, and pavement resurfacing within the existing footprint;
- Sidewalks and bicycle lanes built as part of new streets or roads and built to direct storm water runoff to adjacent vegetated areas;
- Impervious trails built to direct storm water runoff to adjacent vegetated areas, or other non-erodible permeable areas, preferably away from creeks or towards the outboard side of levees;
- Sidewalks, bicycle lanes, or trails constructed with permeable surfaces;
- Trenching, excavation and resurfacing associated with LUPs, unless the LUP has a discrete location that has 5,000 square feet of more of newly constructed contiguous impervious surface;
- Pavement grinding, surface treatments, and repaving and/or resurfacing of existing roadways and parking lots;
- Construction of new sidewalks, pedestrian ramps, or bike lanes on existing roadways;

- Emergency redevelopment activities required to protect public health and safety; and,
- Routine replacement of damaged pavement such as pothole repair or replacement of short, non-contiguous sections of roadway.

## 2.4 Project Submittal and Approval Process

Once it is determined that a project is required to incorporate post-construction storm water controls in accordance with this Manual, a Preliminary SWQP is required to be developed and submitted as part of the project entitlement application package and entitlement approval process, followed by a Final SWQP prior to the approval of construction plans/improvement plans or the issuance of a building permit.

The flowchart in Figure 2-3 provides an overview of the SWQP Development and Submittal Process. Each step is summarized below and then described in further detail in the applicable chapters that follow. This process is similar for Small and Regulated Projects; although the SWQP submittal for Small Projects is simpler.

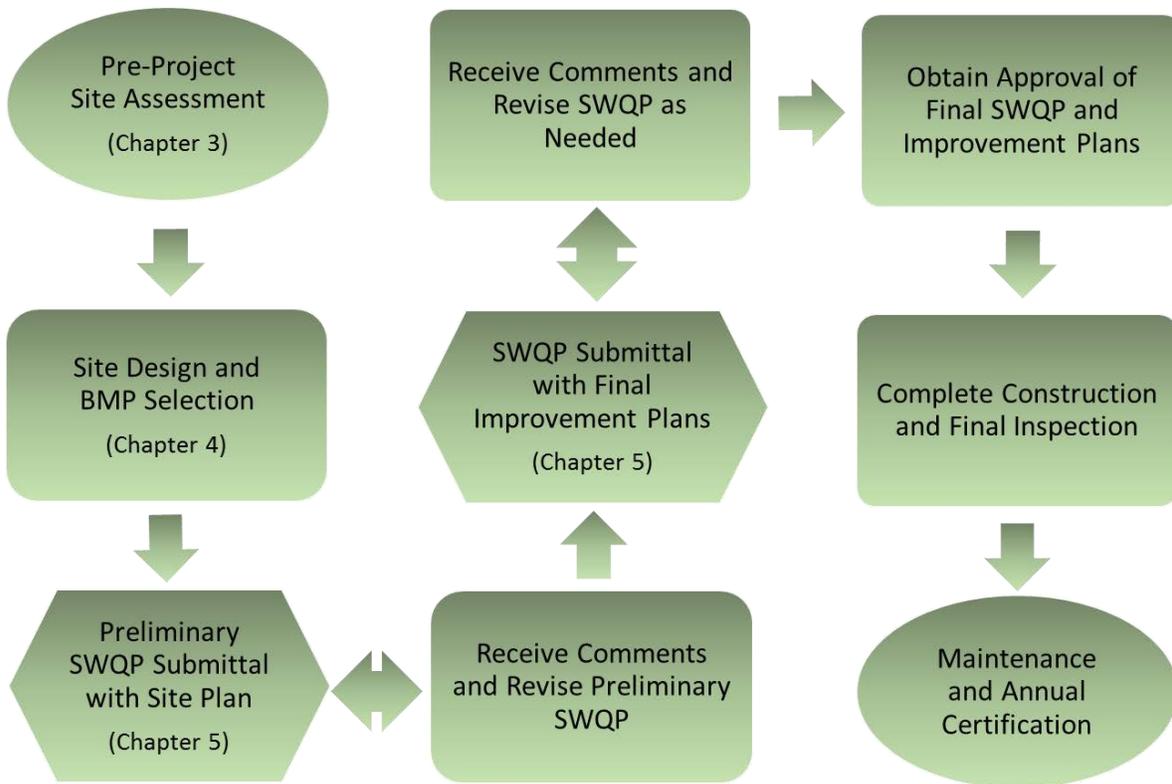

**Figure 2-3**  
**SWQP Development and Submittal Process**

Detailed guidance for developing a SWQP is provided in the following sections and by using the electronic SWQP Template provided in Appendix A. The SWQP must be

submitted as a Preliminary and Final document. The Preliminary SWQP is submitted with the Entitlement Application Package for Tentative Map (or equivalent) while the Final SWQP is submitted with the Final Improvement Plans and Building Permit Application Package (or equivalent). Both the Preliminary and Final SWQP submittals must include all the forms in the template as required for the determined project category.

The Preliminary SWQP contains a site plan identifying selected BMPs, their locations, tributary drainage areas, preliminary sizing calculations, and preliminary inspection and maintenance documentation.

The Final SWQP includes the Final Improvement Plans showing all BMPs and necessary design details on the appropriate sheets. The BMP Checklist from the SWQP Template must be included on the cover sheet of the Final Improvement Plans. The Final SWQP also includes final sizing calculations, inspection and maintenance schedules and procedures, identification of responsible parties, and all required signatures. The Final SWQP serves as the Project Maintenance Agreement between the owner and the permitting jurisdictional agency and provides permission to access for jurisdictional agency staff to conduct BMP inspections.

SWQP preparation consists of systematically collecting and documenting project specific information that includes the following key components.

- **General Project Information** – Documentation of permitting jurisdictional agency, project name and other identifying information.
- **Responsible Parties** – Project owner and engineer certifications of responsibility and Permission to Access.
- **Site Assessment** – Documentation of existing site conditions and storm water quality management opportunities and constraints. Detailed information on conducting an LID-based site assessment and developing a site layout that supports the retention of storm water runoff on-site is provided in Section 3.
- **Design Documentation** – Project plans showing the location and size of storm water management measures and sizing calculations. Detailed information on the selection of source control measures, site design measures, and storm water treatment and baseline hydromodification measures is provided in Section 4. Design guidance is provided in the SWQP Template (Appendix A) and the BMP Fact Sheets (Appendix B).
- **Operations and Maintenance (O&M) Documentation** – O&M Plan listing BMP-specific inspection and O&M requirements. See the BMP Fact Sheets in Appendix B for guidance on O&M requirements.

## Chapter 3

# Pre-Project Site Assessment

During the early planning stages of any project, a thorough site assessment can provide valuable information for planning the layout of site improvements. Developing a site layout with consideration of storm water management can provide substantial reductions in cost and improve the effectiveness of the project's storm water control measures. Consideration of terrain, required buffer areas, and other natural features can lead to efficient location of BMPs. Additionally, a site layout that keeps clean flows separated from contaminated flows can reduce the need for, and size of, downstream treatment controls. Project sites, or portions thereof, can typically be configured to direct storm water runoff from impervious surfaces to landscaped or natural areas, rather than to convey it directly to a discharge location, which may require a structural BMP.

### 3.1 Site Assessment

A site assessment must be completed for all Regulated Projects and considered for Small Projects during the earliest stages of project planning to appropriately plan the site layout for the capture and treatment of storm water runoff. The incorporation of storm water features is more effective, and often less costly, when site conditions such as soils, vegetation, and drainage characteristics are considered when determining the placement of buildings, paved areas, drainage facilities and other improvements. Site assessments consist of collecting and evaluating data from a variety of sources including, but not limited to, surveys, topographic maps, geotechnical investigations, groundwater records, and site-specific measurements and field observations. The site assessment should evaluate the following key site characteristics:

- Soil, Geologic, and Groundwater Characteristics;
- Topography, Hydrology, Snow Storage, and Drainage Characteristics;
- Existing Vegetation and Natural Areas;
- Contaminated Soil or Groundwater;



**A careful evaluation of a site's pre-developed condition is key to minimizing the impacts of development.**

**Photo Credit – CDM Smith**

- Existing Improvements and Easements; and,
- Opportunities and constraints for preserving or enhancing existing natural resources.

The subsections below provide reference information and guidance for evaluating each key site characteristics and incorporating the results into the layout of improvements and the development of a site plan.

### 3.1.1 Soil, Geologic, and Groundwater Characteristics

Soil and geologic characteristics and information are necessary for determining the feasibility of infiltrating storm water runoff on a site and will assist in identifying appropriate locations for proposed improvements and the required storm water management measures. Where feasible, buildings, pavement, and other impervious surfaces should be located in areas where soils have lower infiltration rates while infiltration facilities should be installed in more permeable soil areas where there is an average separation of 10 feet between the bottom elevation of the infiltrating BMP and the groundwater surface elevation. At no time shall the separation between the bottom elevation of the infiltrating BMP and the seasonal high groundwater surface elevation be less than 5 feet.

Some information regarding soil types and their potential suitability for infiltrating storm water can be obtained from the United States Department of Agriculture (USDA) Natural Resources Conservation Service (NRCS) Web Soil Survey (WSS) at the following website:

<http://websoilsurvey.nrcs.usda.gov/app/HomePage.htm>

Soils are categorized into one of four Hydrologic Soil Groups (HSGs) A, B, C or D based on their capacity to percolate water. Type A soils are well drained and highly permeable, while Type D soils consist of low permeability materials such as clays that infiltrate water very slowly.

A soils map illustrating the HSGs and their general locations in East Placer Region is provided in Figure 3-1. As shown, much of the region's soils are classified as Type B, indicating moderately fine to coarse texture with moderate permeability. Type B soils are fairly well suited for infiltration as long as site specific conditions are considered during the design process. Ideally, site designs allow infiltration to occur at the maximum rate the native soil will accept and allow for the safe bypass of overflows. In some cases, native soils can be amended to increase their storage and infiltration capacity by mixing organic mulches and/or sandy materials with the less permeable native soils. Additional information on the use of soil amendments is provided in the Fact Sheet SDM-2 in Appendix B.

The WSS provides planning level information such as soil type, HSG, typical infiltration rates, saturated hydraulic conductivity, typical depth to restrictive layers or bedrock, and

typical depth to groundwater. The Placer County Stormwater Management Manual<sup>1</sup> (SWMM) (Placer County, 1994) provides additional guidance in determining soil infiltration rates based on the HSG and the type and condition of ground cover. This information may be used for pre-project runoff calculations, but a site-specific geotechnical evaluation is recommended to obtain more accurate soil characteristics and infiltration rates for the design of infiltration facilities. It should be noted that saturated hydraulic conductivity can be used for designing infiltration facilities, but a site-specific infiltration rate measurement for the soils underlying the infiltration facilities is strongly recommended for final design and optimized sizing.


A site-specific geotechnical investigation should be conducted under the guidance of a licensed geotechnical, soils, or civil engineer and include digging test pits and conducting infiltration rate measurements in locations where infiltration-based BMPs may be located. Test pits will help confirm the types of soils present onsite, identify soil layers or bedrock that may impede infiltration, and locate the depth to seasonally high groundwater. Testing should be performed at the soil surface as well as the approximate bottom depth of the infiltration BMP to determine appropriate infiltration rates for design. The infiltration measurement methodology must be selected by an appropriately licensed professional and applied in a manner that adjusts for the relative influence of sidewall flow in the test configuration to the effectiveness of the sidewall flow in the proposed BMP configuration. The potential for long-term degradation of the infiltration rate and the ability to monitor performance and rehabilitate facilities must also be considered. In many cases, the design rate will be no more than one-half of the adjusted measured rate.

The geological assessment must also evaluate a site's susceptibility to landslides. Landslides occur when the stability of a slope changes from a stable to an unstable condition due to natural and/or anthropogenic causes. Soil saturation is a primary cause of landslides, and infiltration should be limited in areas of high landslide risk, especially when downhill structures, roads, and infrastructure are at risk of being damaged. LID design in areas prone to landslides, especially those that utilize infiltration, should be carefully considered and must be prepared by a licensed civil or geotechnical engineer.

---

<sup>1</sup> The Placer County Stormwater Management Manual is available for download at:

<https://www.placer.ca.gov/departments/floodcontrol>

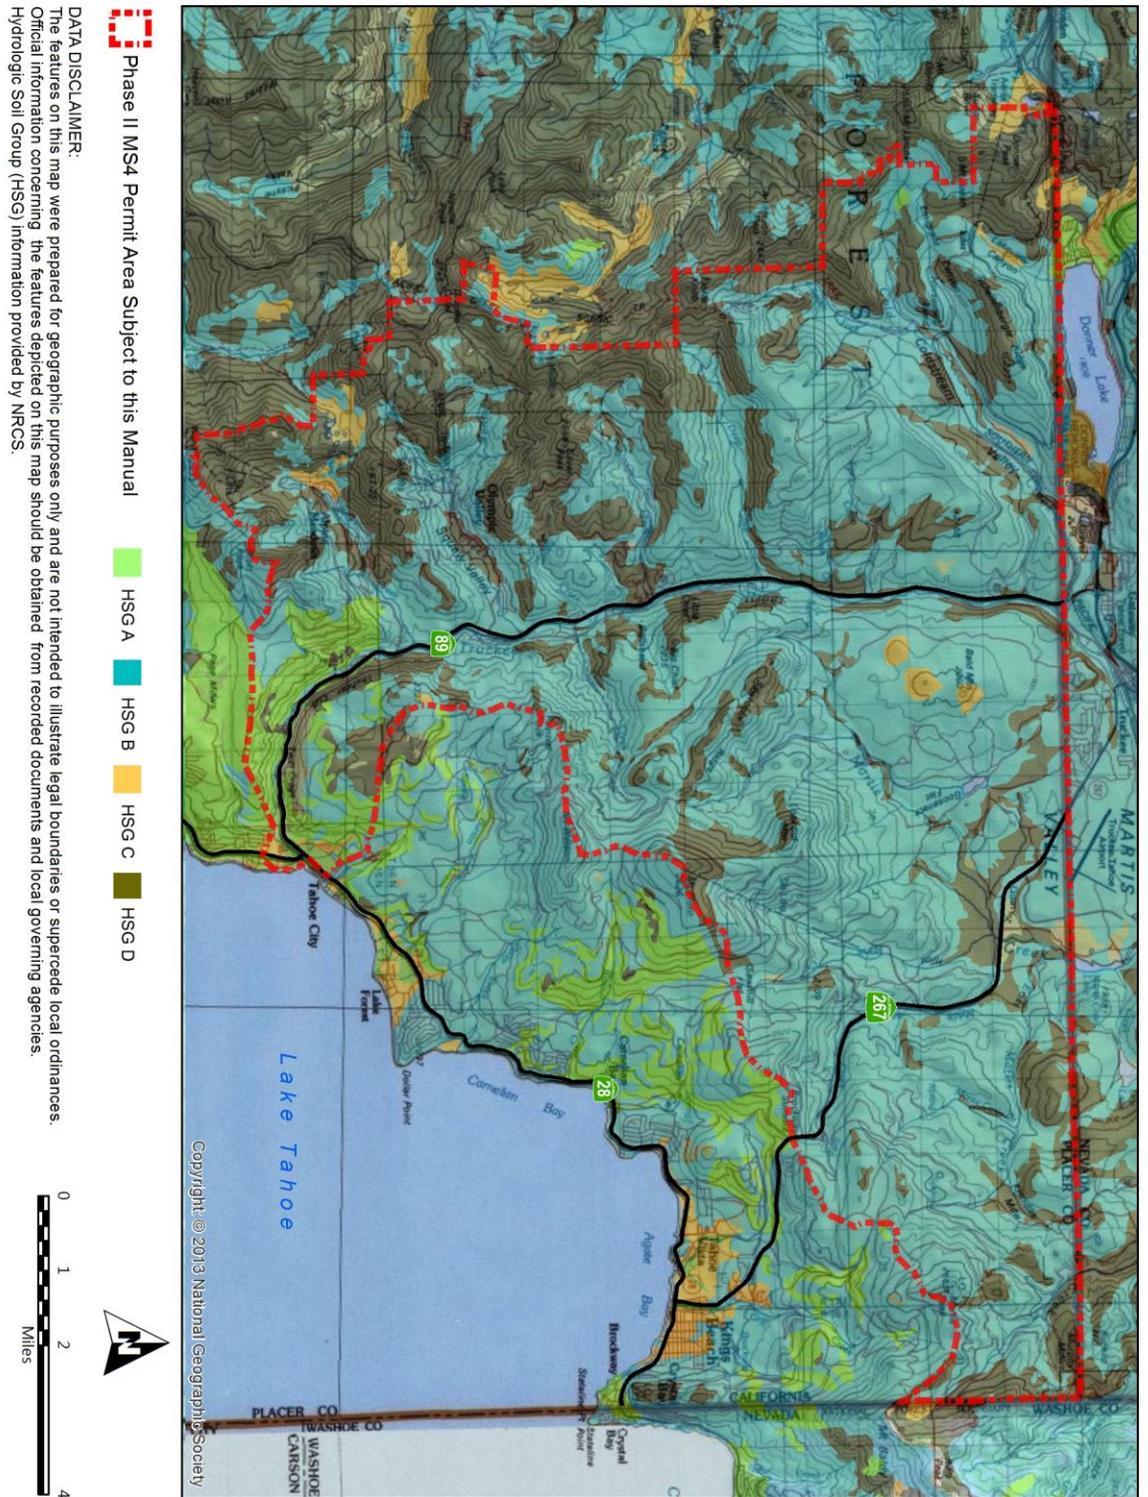

**Figure 3-1**  
**NRCS Hydrologic Soil Groups**

### 3.1.2 Topography, Hydrology, Snow Storage and Drainage Characteristics

Site topography, hydrology, and drainage characteristics are also critical factors in developing an appropriate site layout for LID implementation. Clearing, grading, and building should be avoided on slopes greater than 25 percent, and, as discussed above, steep slopes and landslide-prone areas are not recommended for infiltration facilities. The design of storm water conveyance and treatment measures relies on existing, or constructed, grades to direct runoff to the desired locations and provide adequate hydraulic head (pressure) to drive flows through treatment measures.

The topography of upstream and downstream sites should be considered for any potential contribution to the total runoff generated during a storm event. Designing effective LID into new or existing sites requires a careful analysis of the topography and how and where storm water runoff will concentrate and flow. Site assessment of the pre-developed site during a storm event is highly recommended to observe and map areas of natural infiltration, concentration, flow, and offsite discharge points.

Snow accumulation and storage is a key water quality consideration in East Placer County. Seasonal winter snowfall amounts vary widely and planning for large snow storms and seasonal snow packs will provide significant water quality benefits. These considerations will also help protect property from water damage and/or structural damage. Snow removal from driveways, walkways, decks, patios, etc. requires adequate space for storage of the removed snow. When snow is stored in upgradient, or impervious areas, it can drain back towards the structure during the melting process, causing nuisance ponding, ice formation, and other damage. Efforts should be made to provide snow storage areas over well-drained soils that are located adjacent to, and downgradient, of the areas to be kept clear. Avoid storing snow on paved surfaces and in areas that drain into a storm drainage system or into a natural surface water body.

Planning for snow shedding from roofs is also of critical importance, especially with steep or metal roofs. The resulting accumulations can be very large and the melting snow can drain into crawl spaces or basements if adequate drainage is not provided. Provide for infiltration by shedding the snow to well-drained soil areas and grade the surface to slope away from the structure.

For previously developed sites, record, or as-built, drawings should be reviewed if available. In the event that topographic data does not already exist for the site or the accuracy of available data is inadequate, a professional topographic survey should be performed prior to proceeding with project design. The survey should produce a detailed topographic base map of the site with contour lines for each foot of elevation change. The survey should also identify the location and elevation of any existing improvements, utilities, and storm water structures (e.g. curb and gutter, swales, catch basins, storm drain pipe inverts, outfalls). This provides the starting point for the development of the site plan.

Hydrologic and drainage characteristics of the site should be identified and assessed including:

- **Onsite streams and water bodies:** Streams and water bodies should be delineated for the project site to locate setbacks and buffer zones. The presence and extent of receiving waters, wetlands, Environmentally Sensitive Areas (ESAs), and impaired water bodies on the 303(d) list or with established Total Maximum Daily Loads (TMDLs) should be clearly defined (see the SWRCB website below for identification of pertinent water bodies).

[http://www.waterboards.ca.gov/water\\_issues/programs/water\\_quality\\_assessment/](http://www.waterboards.ca.gov/water_issues/programs/water_quality_assessment/)

- **Floodplains and drainage hazards:** Floodplains on the site should be delineated to identify areas where significant flooding may occur. LID principles may be effectively implemented in floodplains, where allowed by the jurisdictional agency, but the impacts of potential flooding on proposed LID improvements should be assessed. Development within the floodplain should be avoided to the extent practicable. Areas of the site with other potential drainage hazards such as erosion and landslides should also be identified.
- **Drainage areas, flow paths, and run-on/runoff locations:** For the pre-project condition, define the area(s) within the site that drain to common discharge location(s). For undeveloped sites, these areas are defined by the natural topography of the site. For previously developed sites, any existing drainage improvements must be considered since they can alter the locations of drainage area boundaries.

The key characteristics of existing flow paths include locations, direction of flow, and capacity. It is also critical to identify all locations where storm water might enter a site (run-on) and where it discharges from a site.

### 3.1.3 Existing Vegetation and Natural Areas

LID design strategies include preserving or enhancing the quality of existing native, and other high quality vegetation to the maximum extent practicable. The designer should identify existing natural and ESAs on the site and consider how these areas can be preserved and integrated into the site design. Avoiding sensitive areas and preserving natural open space may reduce the need for other permits and provides opportunities for reducing the amount of storm water runoff that needs to be treated. Storm water runoff can sometimes be directed to these areas for infiltration and irrigation. Preservation of existing trees and other vegetation that help intercept rainfall and reduces runoff. Where wetlands and sensitive areas are present, it may be necessary to maintain natural runoff quantities.

### 3.1.4 Contaminated Soil or Groundwater

If a site is influenced by contaminated soils and/or groundwater, special consideration of LID design needs to be made. Infiltration of storm water runoff in areas with contaminated soils and/or groundwater should be avoided to prevent mobilization and dispersion of the pollutants. Sites must be reviewed to ascertain if there is a potential that contamination is present. Redevelopment sites must be investigated for underground storage tanks and other potential sources of contamination. If soil and/or groundwater contamination is suspected, LID implementation must avoid further infiltration of storm water runoff and focus on flow-through type treatment devices.

As part of the Preliminary SWQP, the site must be evaluated for the presence of contamination. The SWRCB maintains a database of registered contaminated sites through their Geotracker® Program. Sites with soil contamination (brownfields) and former agriculture sites are managed by EPA and the California Department of Toxic Substances Control. For preliminary investigation of site contamination, the websites for these agencies can be accessed as follows:

- SWRCB: <http://geotracker.waterboards.ca.gov/>
- EPA Brownfield: <http://www.epa.gov/brownfields>
- California Department of Toxic Substances Control:  
<http://www.dtsc.ca.gov/SiteCleanup/Brownfields/>  
[http://www.dtsc.ca.gov/SiteCleanup/Cortese\\_List.cfm](http://www.dtsc.ca.gov/SiteCleanup/Cortese_List.cfm)

### 3.1.5 Existing Improvements and Easements

Existing improvements from previous on-site development, adjacent properties, public infrastructure, and underground or overhead utilities must be identified and evaluated when planning the site layout. If available, as-built or record drawings should be reviewed and compared to actual site conditions to verify site features such as buildings and structures, parking lots, roads, drainage systems, landscaped areas.

Previously developed sites may have existing underground utilities,



**Existing improvements and easements can constrain storm water management alternatives.**  
Photo Credit – Placer County

including storm water conveyance/detention, sanitary sewers, and/or gas lines, as well as underground or overhead electrical and/or communications lines. Locations of utilities, whether below ground or overhead, must be noted on the site plan so that any conflicts with storm water, or other improvements may be readily identified.

All easement encumbrances for existing or proposed utilities should also be identified and shown on the site plan as they may indicate a future utility, road, or other structure that may conflict with LID features.

## Chapter 4

# Site Planning and BMP Selection

Selection of an effective set of integrated storm water control measures, or BMPs, can be challenging. Each site is unique, and the application of BMPs will vary depending on site characteristics and proposed use of the site. The storm water management requirements vary depending on the different project categories (i.e., Small, Regulated, Hydromodification Management Projects). This chapter provides a step-wise process for selecting complementary BMPs to complete an effective and integrated design.

This chapter is organized by project categories as described in Chapter 2. Information in the corresponding subsection(s) below provides guidance for selection of BMPs that are appropriate for the site and project type.

### 4.1 Small Projects

For Small Projects, a site plan showing the layout of improvements and storm water control measures is required to demonstrate consideration of the following:

- Define the development envelope and protected areas, identifying areas that are most suitable for development and areas to be landscaped, or left undisturbed, and used for infiltration. (Sections 3.1.1 through 3.1.4).
- Provide adequate snow storage over pervious soil areas that are suitable for infiltration. (Section 3.1.2).
- Minimize overall impervious coverage (paving and roofs) of the site.
- Set back development from creeks, wetlands, and riparian habitats in accordance with local ordinances. (Sections 3.1.2 and 3.1.3).
- Preserve significant trees and native vegetation. (Section 3.1.3).
- Conform the site layout along natural landforms. (Section 3.1.2).
- Avoid excessive grading and disturbance of vegetation and soils and stabilize disturbed areas.
- Replicate the site's natural drainage patterns. (Section 3.1.2).

Implementation of one or more Site Design Measure, listed in Table 4-1, is required to reduce project site runoff. The Site Design Measure(s) must be included on the site plan and final improvement plans that are submitted with the building permit application.

Note that some of the Site Design Measures for Small Projects are required to be designed by an appropriately qualified professional engineer licensed in the State of California. Fact Sheets in Appendix B provide detailed descriptions and design requirements for each Site Design Measure listed.

Additional guidance for incorporating the required storm water measures into Small Projects is provided in Chapter 6 and the SWQP Template in Appendix A.

**Table 4-1 Selection of Site Design Measures for Small Projects<sup>1</sup>**

Small Projects must incorporate at least one Site Design Measure	Fact Sheet (Appendix B)	Selection Considerations
Adjacent/On-Site Stream Setbacks and Buffers	SDM-1	Applicable for sites with streams on, or directly adjacent to the property.
Soil Quality Improvement and Maintenance	SDM-2	Consult a qualified professional before using in areas of high groundwater, soil or groundwater contamination, or slopes greater than 10 percent.
Tree Planting and Preservation	SDM-3	Irrigation requirements Defensible space for wildfire
Rooftop and Impervious Area Disconnection	SDM-4	Roof drain discharge must be at least six (6) feet from a basement and at least two (2) feet from a crawl space or structural foundation.
Porous Pavement	SDM-5	Consult a professional engineer before using in areas of high groundwater, soil or groundwater contamination, or slopes greater than 10 percent.
Vegetated Swales	SDM-6	Consult a professional engineer before using in areas of high groundwater, soil or groundwater contamination, or slopes greater than 10 percent.
Rain Barrels and Cisterns	SDM-7	Operation and Maintenance requirements

1. The Phase II MS4 Permit also allows the use of green roofs. This Site Design Measure has been omitted from this Manual as a practice that may not be suitable due to the climate of the region and water conservation requirements. However, project applicants may propose green roofs as a Site Design Measure for consideration on a case-by-case basis.

## 4.2 Regulated Projects

This section provides guidance for site design considerations and selection and layout of storm water control measures for Regulated Projects. The approach consists of applying

information from the site assessment to lay out improvements and BMPs to reduce storm water runoff volumes and pollutant concentrations. This information is intended as a reference source for the development of SWQPs for Regulated Projects which are required to be completed by an appropriately qualified professional engineer licensed in the State of California.

Requirements for Regulated Projects include the following:

- Completing a site assessment to evaluate local conditions and identify LID opportunities and constraints,
- Developing a site layout that incorporates LID storm water management strategies,
- Implementing Site Design Measures to reduce surface runoff by infiltration, evapotranspiration, and/or harvesting and use as close to its source as possible,
- Implementing Storm Water Treatment and Baseline Hydromodification Measures using bioretention-based facilities or facilities of demonstrated equivalent effectiveness,
- Implementing biotreatment/media filters for special case exceptions to bioretention or facility of demonstrated equivalent effectiveness,
- Implementing hydromodification management measures to control post-project runoff rates (required for projects that create or replace more than one (1) acre of impervious surface and result in a net increase in impervious area), and
- Maintaining and implementing an O&M Plan.

For maximum effectiveness, the BMPs listed above should be designed to work together in an integrated system. BMPs can be designed in series to provide multiple treatment steps for pollutant removal and volume reduction. Pretreatment, which refers to design features that provide settling of large particles before storm water enters a storm water infiltration or treatment facility, is important to ensure proper operation of the facility and reduce the long-term maintenance burden. Perhaps the most common example is a sediment trap placed upstream of another BMP to remove bulk coarse solids in a location that is easily accessed for maintenance upstream from a facility that provides further treatment and runoff reduction. By reducing sediment loads entering a bioretention facility or other infiltration-based facility, pretreatment protects the engineered planting media and/or underlying soil from being occluded prematurely and maintains the infiltration rate of the facility. Another example is installing an oil/water separator upstream of another BMP to remove potential hazardous materials prior to infiltrating runoff. The Phase II MS4 Permit requires that additional treatment steps be considered in high-risk areas such as fueling stations, truck stops, auto repairs, and heavy industrial sites to protect groundwater quality.

The completed SWQP for Regulated Projects provides a multi-layered approach to protect water quality and downstream water bodies. The following sections describe the site planning and BMP selection processes that must be used to develop an effective, integrated SWQP.

### **4.2.1 Site Plan Layout**

The results of the site assessment are used to develop the layout of improvements and site plan, which is submitted with the Preliminary SWQP (see Figure 4-1 for an example). A list with the information required to be included on the site plan is provided in Chapter 6 under the Form 3-4 guidance. The site plan, together with the SWQP, documents consideration of the following items:

- Define the development envelope and protected areas, identifying areas that are most suitable for development and areas to be left undisturbed. (Sections 3.1.2 through 3.1.4).
- Concentrate development on portions of the site with less permeable soils and preserve areas that can promote infiltration. (Section 3.1.1).
- Provide adequate snow storage over pervious soil areas that are suitable for infiltration. (Section 3.12).
- Minimize overall impervious coverage (paving and roofs) of the site.
- Set back development from creeks, wetlands, and riparian habitats in accordance with local ordinances. (Sections 3.1.2 and 3.1.3).
- Preserve significant trees. (Section 3.1.3).
- Conform the site layout along natural landforms. (Section 3.1.2).
- Avoid excessive grading and disturbance of vegetation and soils. (Sections 3.1.2 and 3.1.3)
- Replicate the site's natural drainage patterns. (Section 3.1.2).
- Detain and retain runoff throughout the site. (Sections 3.1.2)


#### **4.2.1.1 Drainage Management Areas**

As the proposed new or replaced impervious surfaces are laid out, the associated Drainage Management Areas (DMAs) are defined and identified on the site plan. DMAs are the tributary areas within the project site that drain to a common location where BMPs can be implemented to reduce and treat storm water runoff. DMAs must be carefully defined for each BMP that receives storm water runoff (from both pervious and impervious surfaces) so that they may be appropriately designed. Ideally, DMAs are

defined by separating areas that drain pervious and impervious surfaces; however, depending on the project site grading and physical characteristics, this may not always be possible. If multiple types of surfaces are present in a DMA, an appropriate composite storm water runoff coefficient must be used to calculate runoff flows and volumes. The placement of BMPs and identification of DMAs is typically an iterative process as alternative layouts and storm water management strategies are developed.

As described previously, LID storm water management strategy can involve implementation of various BMP combinations in series. Generally, upstream BMPs, or Site Design Measures, are smaller, distributed measures that function to slow and reduce runoff. Downstream BMPs, or Storm Water Treatment and Baseline Hydromodification Measures, function to remove pollutants from the remaining runoff and provide additional runoff flow and volume control. In some cases, DMAs that discharge to separate upstream BMPs must be combined for the design of BMPs located further downstream in the site’s drainage system.

The site plan provided in Figure 4-1 presents an example of a new development project consisting of an office building, driveway, and parking lot. The site was separated into four discrete DMAs. DMA 1 consists of the western portion of the office building roof, DMA 2 consists of the eastern portion of the office building roof, DMA 3 consists of a paved driveway, and DMA 4 consists of a paved parking lot.

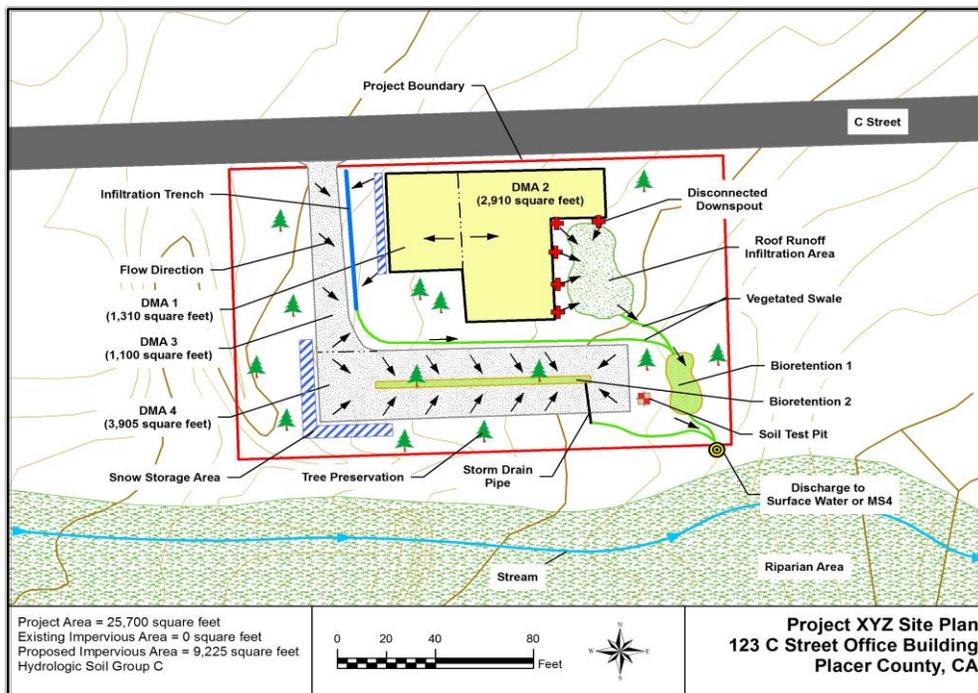

**Figure 4-1**  
**Site Plan Example**

Site Design Measures and storm water treatment/baseline hydromodification BMPs (bioretention) to manage runoff from each DMA are also included in Figure 4-1. Roof runoff from DMA 1 discharges to a snow storage area which drains to an infiltration trench that overflows into a bioretention BMP during larger storm events. Roof downspouts from DMA 2 discharge away from the building to a natural depression where infiltration occurs. The natural depression area overflows into a vegetated swale which conveys runoff to a bioretention BMP. Driveway runoff from DMA 3 slopes towards the infiltration trench and then a vegetated swale which also conveys runoff to a bioretention BMP during larger storm events. Snow storage is provided over pervious soils adjacent to the paved parking lot and in areas where shedding snow from the roof will accumulate.

In this example, DMAs 1, 2, and 3 all discharge to the same bioretention BMP which would need to be designed to treat flows from all three DMAs. Parking lot runoff from DMA 4 flows to a separate bioretention BMP (parking lot landscaped area) which contains two existing trees to be preserved. Treated storm water and overflow from both bioretention BMPs is combined at a single discharge point and released offsite into the municipal storm drain system or natural drainage way.

#### **4.2.2 Source Control Measures**

After properly assessing a site and refining the layout, source control measures are implemented to reduce the potential for storm water runoff and pollutants from coming into contact with one another. The goal of source control measures is to KEEP CLEAN WATER CLEAN.

Source control measures can include both structural and operational measures. Structural source control measures include a physical or structural component for controlling the pollutant source such as installing an efficient irrigation system to prevent overspray and off-site runoff or covering trash enclosures or fuel dispensing operations. Operational source control measures involve practices such as storm water management training, trash management and litter control practices, and general good housekeeping practices. When properly implemented, source control measures are effective in preventing pollutants from entering storm water runoff and are typically less expensive than other types of storm water BMPs.

Regulated Projects with potential pollutant-generating activities and sources are required to implement applicable structural and/or operational source control measures. Selection of source control measures must be based on an assessment of potential pollutant generating activities or sources that are anticipated to occur at the site. Depending on the site operations and activities, typical pollutants of concern that can be mobilized and transported by storm water runoff may include, but are not limited to, microbial pathogens (bacteria and viruses), metals, nutrients, toxic organic compounds, suspended solids/sediment, trash and debris, and oil and grease. Some examples of

source control measures include trash enclosures, street or parking lot sweeping, and proper materials storage practices.

In some areas, downstream water bodies may be impaired, or subject to TMDL requirements (Chapter 3). In these situations, the pollutant(s) of concern must be identified along with any additional actions that may be required to control potential releases of the pollutant(s).

The Source Control Measures Selection Table (Appendix C) shall be used as a guideline to identify and select source control measures for inclusion in the SWQP. In some cases, multiple source control measures will be used in combination. The table does not include all possible pollutant generating project characteristics/activities that may warrant the consideration of source control measures and additional operational or structural source control measures may be required.

The California Stormwater Quality Association (CASQA) Storm Water BMP Handbooks, or an accepted equivalent reference document, provide recommended guidance for design of source control measures. CASQA has published several storm water BMP handbooks for various project applications and settings, and the source control measures identified in Appendix C reference fact sheets in one or more of these handbooks. The identification codes in the table correspond to the CASQA fact sheets which can be referenced for more information on each source control measure. The CASQA Storm Water BMP Handbooks are available for purchase at:


<https://www.casqa.org/resources/bmp-handbooks>

### 4.2.3 Site Design Measures (LID BMP Selection)

Site Design Measures are generally small-scale, distributed BMPs that are intended to reduce and treat surface runoff volumes as close to its source as possible. Site Design Measures often incorporate vegetation which can further reduce runoff through evapotranspiration. These storm water controls are critical for minimizing the hydrologic impacts of site development, a primary goal of LID.

Regulated Projects are required to incorporate the Site Design Measures listed in Table 4-3 to the extent technically feasible with the objective of retaining the impervious runoff volume generated by the post-construction 85<sup>th</sup> percentile, 24-hour storm event by means of infiltration, evapotranspiration, and/or harvesting and use. Typical feasibility considerations are included in the table, but technical feasibility can vary based on a wide variety of site specific conditions that must be evaluated and determined by a professional engineer. Technical feasibility also requires approval by the jurisdictional agency.

If Site Design Measures applied are demonstrated to completely treat and retain the impervious runoff from the post-construction 85<sup>th</sup> percentile, 24-hour storm event, then no additional downstream BMPs are required. This determination is made during the development of the SWQP (Appendix A). The Site Design Measure Fact Sheets (Appendix B) provide detailed descriptions and design requirements for each measure listed in Table 4-2.

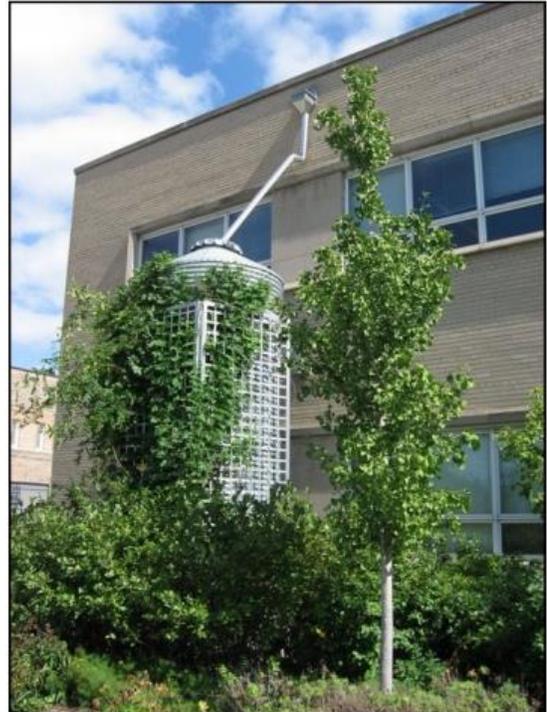

**Distributed Site Design Measures, such as this cistern, can provide significant reductions in site runoff.**

**Photo Credit – U.S. EPA**

**Table 4-2 Selection of Site Design Measures for Regulated Projects<sup>1</sup>**

Regulated Projects must incorporate Site Design Measures to the Extent Technically Feasible	Fact Sheet (Appendix B)	Feasibility Considerations
Stream Setbacks and Buffers	SDM-1	<ul style="list-style-type: none"> <li>▪ Applicable for sites with streams on or directly adjacent to the property.</li> </ul>
Soil Quality Improvement and Maintenance	SDM-2	<ul style="list-style-type: none"> <li>▪ Not suitable in areas of high groundwater, soil or groundwater contamination, or slopes greater than 10 percent.</li> </ul>
Tree Planting and Preservation	SDM-3	<ul style="list-style-type: none"> <li>▪ Irrigation requirements</li> <li>▪ Defensible space for wildfire</li> </ul>
Rooftop and Impervious Area Disconnection	SDM-4	<ul style="list-style-type: none"> <li>▪ Roof drain discharge must be at least six (6) feet from a basement and at least two (2) feet from a crawl space or structural foundation.</li> </ul>
Porous Pavement	SDM-5	<ul style="list-style-type: none"> <li>▪ Not suitable in areas of high groundwater, soil or groundwater contamination, or slopes greater than 10 percent.</li> <li>▪ Not ideal for sites with infiltration rates less than 0.5 in/hr.</li> <li>▪ Not suitable in areas with heavy equipment or traffic loads.</li> <li>▪ Sediment deposition will cause clogging.</li> <li>▪ Not suitable in areas where traction sand is applied</li> </ul>
Vegetated Swales	SDM-6	<ul style="list-style-type: none"> <li>▪ Not suitable in areas of high groundwater, soil or groundwater contamination, or slopes greater than 10 percent.</li> </ul>
Infiltration Trenches	SDM-7	<ul style="list-style-type: none"> <li>▪ Not suitable in areas of high groundwater, soil or groundwater contamination, or slopes greater than 10 percent.</li> </ul>
Dry Wells and Underground Infiltration Facilities	SDM-8	<ul style="list-style-type: none"> <li>▪ Not suitable in areas of high groundwater, soil or groundwater contamination.</li> <li>▪ Installations on slopes require geotechnical evaluation.</li> </ul>
Rain Barrels and Cisterns	SDM-9	<ul style="list-style-type: none"> <li>▪ Must be emptied to re-establish storage volume between storm events.</li> <li>▪ Underground facilities can provide protection from freezing.</li> </ul>

1. The Phase II MS4 Permit also allows the use of green roofs and rain barrels and cisterns. These Site Design Measure have been omitted from this Manual as practices that may not be suitable due to the climate of the region and water conservation requirements. However, project applicants may propose green roofs or rain barrels and cisterns as Site Design Measures for evaluation by Placer County on a case-by-case basis.

#### 4.2.4 Storm Water Treatment and Baseline Hydromodification Management

After implementation of Site Design Measures, remaining runoff that is not retained by the Site Design Measures must be directed to storm water treatment/baseline hydromodification facilities sized to manage the remaining portion of the post-construction 85<sup>th</sup> percentile, 24-hour storm event runoff. These treatment facilities, also known as bioretention facilities, are designed to infiltrate, evapotranspire, and/or bioretain




**Bioretention can be integrated into a site's landscaping to provide water quality and aesthetic benefits while also reducing project costs.**

**Photo Credit – CDM Smith**

the remaining storm water similar to the LID principles of the Site Design Measures. Depending on site characteristics, infiltrating or non-infiltrating flow-through bioretention facilities are typically used to meet this requirement. Infiltrating systems are preferred, and the use of flow-through systems with impervious liners to prevent infiltration is only permitted in several specific cases. These specific circumstances include shallow groundwater conditions, the existence of underlying groundwater or soil contamination, when infiltration creates the potential for geotechnical hazards, or when the facility is located on an elevated plaza or other structure. Bioretention facilities provide pollutant removal through several mechanisms including sedimentation, filtration, and biological processes. Additionally, they reduce runoff volumes and peak flow rates to mitigate the potential hydromodification effects of development.

The determination of which type of storm water treatment/baseline hydromodification control measure(s) to implement can be made using the following flow chart in Figure 4-2. As shown, infiltrating bioretention BMPs are required in the majority of cases. Once the appropriate storm water treatment BMP(s) is (are) selected, refer to the corresponding Fact Sheet (Appendix B) for further design considerations and allowable variations.

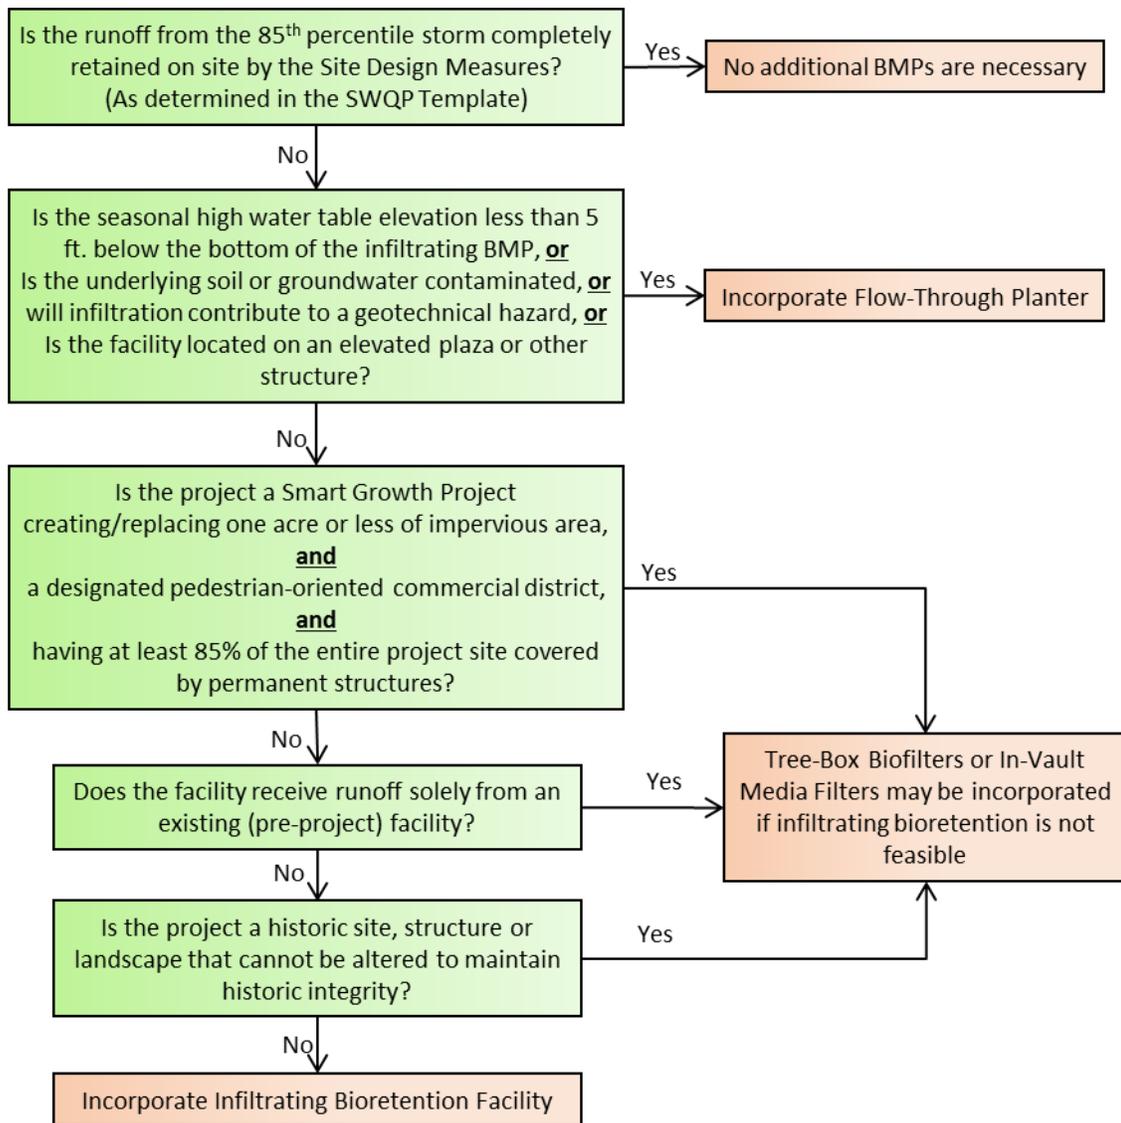

**Figure 4-2**  
**Selection of Storm Water Treatment/Baseline Hydromodification Controls**

Alternative storm water treatment and baseline hydromodification facilities may be proposed by the designer if the designer can demonstrate that the proposed facility meets all the following measures of equivalent effectiveness criteria when compared to bioretention facilities:

- Equal or greater amount of storm water runoff infiltrated or evapotranspired for alternatives to infiltrating bioretention facilities
- Equal or greater rate of storm water treatment for flow-through facilities

- Equal or lower pollutant concentrations in storm water runoff that is discharged after biotreatment
- Equal or greater protection against shock loadings and spills
- Equal or greater accessibility and ease of inspection and maintenance

Proposed alternative storm water treatment and baseline hydromodification facilities will be reviewed on a case-by-case basis by the jurisdictional agency.

### 4.3 Hydromodification Management Projects

The term “hydromodification” is used to define the changes that occur to the natural hydrologic systems of streams and watersheds and how they have the potential to disrupt the natural balances within the watershed. Hydromodification resulting from land development has the potential to create impacts such as excessive erosion, sediment transport and deposition, stream bed instability, loss of habitat, pollutant loading, and damage to the overall ecosystem in downstream reaches of watershed systems. The dynamics of development projects have historically decreased groundwater recharge, increased runoff volume and peak flow frequencies, and altered the natural hydraulic loading of the receiving water (creek system) hydrology. Most LID principles incorporated into this Manual begin to address and minimize these impacts. In the event that storm water runoff reductions do not meet post-construction condition requirements, as demonstrated with the runoff reduction calculator (made part of the Storm Water Template – Appendix A), additional hydromodification treatment measures are required for Regulated Projects creating and/or replacing one acre or more of impervious surface that create a net increase in impervious surface.

The required performance standard for hydromodification control consists of maintaining post-project runoff at or below pre-project flow rates for the 2-year, 24-hour storm event. If this standard can be achieved through the implementation of Site Design Measures and storm water treatment/baseline hydromodification controls (as referenced in Section 4.2 above), then no further storm water controls are required. If post-construction peak flows do not meet this standard, then additional storage capacity with flow control at the discharge point must be incorporated into the design. If additional detention capacity is added using a facility that is separate from the Site Design Measures and storm water treatment/baseline hydromodification BMPs, flow control at the discharge must be incorporated so the total discharge rate from all BMPs is lower than the pre-project peak runoff rate.

For hydromodification management projects in sensitive environmental locations, and/or larger sized projects with complex hydrologic characteristics, the jurisdictional agency may require an alternative approach to using the template forms. In these cases,

additional hydrologic modeling analyses, such as a HEC-1 or HEC-HMS discrete storm analysis, may be required to compare pre- and post-project discharge rates for compliance. In these cases, the Section 4 form should be replaced with model results documentation showing that post-construction runoff is less than or equal to the pre-construction runoff rate for a 2-year, 24-hour storm event.

BMP selection for hydromodification controls should be based on the amount of additional storage needed. Additional storage capacity for hydromodification management can be provided by either increasing the size of the control measures (e.g., Site Design Measures or storm water treatment and baseline hydromodification facilities) that are already incorporated in the design or by adding separate structures such as detention basins or vaults.

Follow the procedures outlined in Chapter 6 and the SWQP Template to determine the additional storage volume needs to select the preferred alternative. If relatively little additional storage is needed, then increasing the capacity of the Site Design and/or storm water treatment measures is likely to be the preferred alternative. For larger additional storage requirements, separate detention facilities are recommended.

## 4.4 In-Lieu Program

Storm water management requirements must meet the MEP standard as specified in this Manual and within and on the project site. If the storm water management goals specified in this Manual cannot be fully met on the project site due to feasibility constraints, then an In-Lieu Project may be identified to satisfy the remaining requirements. All projects that utilize the In-Lieu Program require review and approval by the LRWQCB in addition to the jurisdictional agency.

The In-Lieu Program provides two options:

### **Option 1- In Lieu Projects**

A separate LID, or other environmental protection/enhancement, project may be selected from the list of pre-approved projects developed by the jurisdictional agency, and approved by the LRWQCB. If an In-Lieu Project option is chosen, the jurisdictional agency will identify the In-Lieu Project in the Conditions of Approvals to ensure that the requirement is documented in case the property and/or project is sold. The pre-approved list of In-Lieu Projects may be amended periodically on a case-by-case basis with approval from both the LRWQCB and jurisdictional agency.

In-Lieu Projects should treat the same type of pollutants that are generated by the untreated portion of the new development or redevelopment project. For example; if the untreated portion of the new development or redevelopment site is roadway, then the In-Lieu Project selected should treat runoff from a roadway.

In Lieu Projects should be located within the same jurisdiction or unincorporated area in which the new development or redevelopment project causing the impact is located. Projects located in other areas may be approved on a case-by-case basis. Projects that have the potential to cause a significant impact to a particular water body, as determined by the jurisdictional agency, either because of the size of the project or the sensitivity of the water body, will need to choose an In-Lieu Project in the same watershed, if feasible.

In Lieu Projects must be completed within two years of the completion of the qualifying new development or redevelopment project. If additional time is needed to complete the In-Lieu Project, an extension may be requested and approved on a case-by-case basis. To compensate for long-term water quality and hydromodification impacts downstream of the project, penalties, in the form of additional fees or additional treatment areas, may be imposed on projects requiring time extensions by the jurisdictional agency.

### **Option 2 - In Lieu Fee**

An In-Lieu Fee may be paid toward the completion of a larger project from the pre-approved list. The amount of the In-Lieu Fee will be calculated based on the treatment and/or volume capture not achieved on the project site, including maintenance costs, times a multiplier.

## Chapter 5

# BMP Inspection, Operation and Maintenance

Structural BMPs required for Regulated Projects must *meet manufacturers' or designer's recommendation for operation and maintenance* to ensure that the facilities are functioning as designed and do not create health and safety hazards.

To support these requirements, owners of Regulated Projects must provide specific operations and maintenance (O&M) related information with the SWQP during the project permitting process and submit annual self-certification reports documenting that the O&M activities are performed and BMPs are functioning properly.

## 5.1 Operation and Maintenance Submittal Requirements at the Permitting Stage

The following items are required to be included in the SWQP for all Regulated Projects:

- A signed statement from the project owner accepting responsibility for inspection and O&M activities for all structural BMPs at the project site until such responsibility is legally transferred to another entity.
- A signed statement from the project owner granting access to all representatives of the jurisdictional agency for the sole purpose of performing O&M inspections of the installed treatment systems(s), and hydromodification control(s) if any. Alternatively, this requirement is considered satisfied if an easement dedication or irrevocable offer of dedication is made to the jurisdictional agency providing equivalent access.
- A list of all structural BMPs on the project site and their specific inspection and O&M requirements. BMP-specific inspection and O&M requirements are included on the respective Fact Sheets (Appendix B). It is the responsibility of the project owner to review these requirements and develop a detailed site-specific O&M Plan to document these requirements and include it with the SWQP.
- A copy of any maintenance agreements that modify the BMP O&M responsibilities for the project.

## 5.2 Annual Self-Certification Reports

In addition to the above items, which are required at the permitting phase, Annual Self-Certification Reports must be submitted by the responsible party for the life of the project. In accordance with the Phase II MS4 Permit, the Annual Self-Certification Reports must include, at a minimum, the following information:

- Dates and findings of field observations to determine the effectiveness of the structural BMPs in removing pollutants of concern from storm water runoff and/or reducing hydromodification impacts as designed.
- Long-term plan for conducting regular maintenance of BMPs including the frequency of such maintenance.

## Chapter 6

# Developing a Post-Construction Storm Water Quality Plan (SWQP)

This chapter, in conjunction with the SWQP Template in Appendix A, provides project applicants, project owners, and design professionals with supplemental guidance for developing a SWQP for the various project categories defined herein.

The SWQP Template also provides planning and design review staff with a standardized submittal format to streamline the project review and approval process. In some cases, if the applicant wishes to propose alternative storm water control measures, supplemental documentation is required to be submitted to demonstrate equivalent performance per the listed criteria.

The SWQP for Regulated Projects must outline project compliance with the requirements of this Manual. It must be sealed by a registered professional engineer and include a signed certification statement by the project owner accepting responsibility for its development and implementation. SWQPs for Small Projects do not require a professional engineer's certification, however; some storm water control measures may require engineered designs. A copy of the Final SWQP shall be available at the project site for the duration of construction and then stored with the project approval documentation and improvement plans in perpetuity.

The SWQP development process begins with identifying the Project Category (see Chapter 2) and completing the corresponding sections in the SWQP template. Table 6-1 below lists the sections in the SWQP that must be completed for each Project Category.

<b>Project Category</b>	<b>Required SWQP Sections</b>
Small Projects	Sections 1 and 2
Regulated Projects, Regulated Redevelopment Projects, Regulated Road Projects, and Regulated LUPs	Sections 1, 3, 5 and 6
Regulated Hydromodification Management Projects	Sections 1, 3 through 6

For Small Projects, the project owner may prepare the SWQP. If the SWQP is prepared by the project owner, then the project owner takes the responsibility for ensuring the proper design of any storm water control measures that are included in the project. For Regulated Projects, a California licensed professional engineer is required to prepare, sign, and stamp the SWQP. Storm water control measures described in this Manual must be designed by, or under the supervision of, a qualified California licensed Professional Engineer with other specialists as may be needed.

### **Using the SWQP Template (Appendix A)**

The SWQP Template is an automated Microsoft Excel-based tool that is provided in electronic format. The user proceeds through a series of pages by opening the workbook tabs which are labeled to indicate which form they contain. To complete the form, required information is entered in the shaded gray cells, while other cells will self-populate. Each section below provides supporting information and guidance on completing the associated forms in the SWQP Template. Other more detailed reference information is provided in the preceding Chapters of this manual and in the BMP fact sheets in Appendix B.

### **Title Page**

The title page identifies the project, project owner, and individual or consulting firm responsible for the preparation of the SWQP.

Project identification information such as Building or Grading Permit Numbers may vary among the jurisdictional agencies and should be included as appropriate for the specific project.

The SWQP preparation date is added by the preparer and the approval date is added by the approving jurisdictional agency to the cover as they become available.

### **Section 1 General Project Information**

Section 1 documents basic information pertaining to the project and identifies the individual(s) responsible for the development and implementation of the SWQP. The Project Category is identified here.

There are two forms to be completed in Section 1 as follows:

#### **Form 1-1 Project Identification and Owner's Certification**

Form 1-1 supplements information provided on the title page with additional detail including the project address and a brief description of the project. For larger or more complex projects, sheets may be added to describe the project.

The project owner's signature is required to certify responsibility for proper implementation of the SWQP. For Regulated Projects, the project owner signature also

provides permission to access to all representatives of the jurisdictional agency for the sole purpose of performing O&M inspections of the installed treatment system(s) and hydromodification control(s), if any.

For Regulated Projects, a California licensed professional civil engineer is required to sign and stamp the SWQP. The professional engineer is responsible for designing all of the storm water control measures for the project site and developing the SWQP per the requirements set forth in the Phase II MS4 Permit and this Manual.

### **Form 1-2 Project Category**

Form 1-2 identifies the project category. Determine the appropriate category by quantifying the size of the newly created and/or replaced impervious surface and then using the decision tree in Figure 2-3. Once the project category is determined, check the appropriate box on the form.

For redevelopment projects, determine the percent increase of impervious surface and check the appropriate box. The percent increase calculation must include both newly created and replaced surfaces as appropriate.

Use the form to indicate if the project is a road or linear underground/overhead project (LUP) that creates 5,000 ft<sup>2</sup> or more of newly constructed contiguous impervious surface or is a public road project and/or falls under the building and planning authority of a jurisdictional agency.

After determining and checking the appropriate project category, enter the total new and/or replaced impervious surface area for the project.

## **Section 2 Requirements for Small Projects**

Owners of Small Projects are required to complete the forms in Section 1 and 2 of the SWQP Template. The forms in Section 2 guide the development of the project layout, as discussed in Chapter 4, and incorporate one or more of the Site Design Measures listed in Table 4-1. Section 2 includes two forms to address these requirements.

### **Form 2-1 LID Site Assessment and Layout Documentation**

The goal of the site assessment is to develop the site in a way that minimizes impacts to the site hydrology and other environmental functions and processes. The form lists a series of considerations that should be made when developing the layout. For each item, check the appropriate box to indicate that it has been considered and appropriately incorporated or that it is not applicable (N/A) and provide a brief explanation (use a separate sheet if necessary). To complete this form, develop and attach the site plan that illustrates the proposed site layout. The site plan may consist of a preliminary, or conceptual level design drawing, and it is a key requirement of the Preliminary SWQP described in Section 2.

Ensure that the following items, at a minimum, are included in the site plan:

- Site boundary
- Topographic data with one-foot contours (five-foot contour intervals may be used for steeper sites)
- Existing natural hydrologic features (e.g., depressions, watercourses, wetlands, riparian corridors)
- Environmentally-sensitive areas and areas to be preserved
- Proposed locations and footprints of improvements creating new or replaced impervious surfaces
- Proposed snow storage areas
- Proposed site drainage with flow directions and site run-on and discharge locations
- Proposed Site Design Measures to reduce runoff

### **Form 2-2 Runoff Reduction Calculator Site Design Measures on Small Projects**

This form is used to identify one or more Site Design Measures to implement on Small Projects and calculate the associated storm water runoff reduction. After identifying the Site Design Measure(s), enter the associated dimensions and quantity information into the form to calculate the storm water runoff reduction and effective treated impervious area. There is no minimum runoff reduction required for Small Projects. Design guidance for Site Design Measures is provided in the Fact Sheets in Appendix B. The equations, variables and units that are used to calculate the Site Design Measure volume reductions ( $V_r$ ) are presented below for reference.

*Adjacent/On-Site Stream Setbacks and Buffers*

$$V_r = \left( \frac{1 \text{ ft}}{12 \text{ in}} \right) \times A_{imp} \times V_{85}$$

$A_{imp}$  (ft<sup>2</sup>) - Impervious drainage area discharging to the buffer

$V_{85}$  (in) – Runoff volume from the 85<sup>th</sup> percentile, 24-hour design storm

*Soil Quality Improvement and Maintenance*

$$V_r = (A_{pond} \times D_{pond}) + (A_{sa} \times D_{sa} \times \eta)$$

$A_{pond}$  (ft<sup>2</sup>) – Ponding area over soil improvement area

$D_{pond}$  (ft) – Ponding depth over soil improvement area

$A_{sa}$  (ft<sup>2</sup>) – Surface area of improved soils

$D_{sa}$  (ft) – Depth, or thickness, of improved soil layer

$\eta$  - Porosity of amended soil

*Tree Planting and Preservation*

$$V_r = [(218 \times n_e) + (109 \times n_d) + A_{tc}] * V_{85} * \left( \frac{1 \text{ ft}}{12 \text{ in}} \right)$$

$n_e$  – Number of new evergreen trees

$n_d$  – Number of new deciduous trees

$A_{tc}$  (ft<sup>2</sup>) –  $A_{tc}$  (ft<sup>2</sup>) – Canopy area of existing trees to remain on the property

$V_{85}$  (in) – Runoff volume from the 85<sup>th</sup> percentile, 24-hour design storm

*Rooftop and Impervious Area Disconnection*

$$V_r = \left( \frac{1 \text{ ft}}{12 \text{ in}} \right) \times A_{imp} \times V_{85}$$

$A_{imp}$  (ft<sup>2</sup>) - Impervious rooftop or other area draining to pervious infiltration area

$V_{85}$  (in) – Runoff volume from the 85<sup>th</sup> percentile, 24-hour design storm

*Porous Pavement*

$$V_r = A_{res} \times D_{res} \times \eta_{agg} \times C$$

$A_{res}$  (ft<sup>2</sup>) – Area of underlying gravel storage layer

$D_{res}$  (ft) – Depth of underlying gravel storage layer

$\eta_{agg}$  – Porosity of aggregate

$C$  – Efficiency factor (See table in Fact Sheet SDM-5)

*Vegetated Swales*

$$V_r = \left( \frac{1 \text{ ft}}{12 \text{ in}} \right) \times A_{imp} \times V_{85}$$

$A_{imp}$  (ft<sup>2</sup>) - Impervious rooftop or other area draining to swale

$V_{85}$  (in) – Runoff volume from the 85<sup>th</sup> percentile, 24-hour design storm

*Infiltration Trenches*

$$V_r = 0.5 \times L \times W \times D$$

L (ft) – Trench length

W (ft) – Trench width

D (ft) – Trench depth

*Dry Wells and Underground Infiltration Facilities*

$$V_r = 0.5 \times V_a$$

$V_a$  (ft<sup>3</sup>) - Combined volume of all dry wells and underground infiltration facilities

*Rain Barrels and Cisterns*

$$V_r = 0.5 \times N \times V_a$$

N - Number of rain barrels and/or cisterns

 $V_a$  (ft<sup>3</sup>) - Volume of each rain barrel and/or cistern

Form 2-2 includes storm water runoff reduction calculations that are equivalent to those in the SWRCB's SMARTS Runoff Reduction Calculator. The volume reductions calculated by these methods are dependent on the Site Design Measure(s) being designed per the requirements in the respective Fact Sheets in Appendix B.

In order to calculate runoff reductions, Form 2-2 requires the project elevation, which is inserted at the top of the form. The form then calculates the impervious runoff volume generated by the design storm. A table is included as a footnote to the form showing the design storm depths that correspond to the elevation of the project. Corresponding runoff volumes are calculated using a runoff coefficient of 0.9 for impervious surfaces.

**Section 3 Requirements for Regulated Projects**

This section addresses the requirements for Regulated Projects. The forms in this section are used to document project characteristics and to facilitate the selection and design of storm water control measures. Projects in this category are required to implement the following storm water control measures to the maximum extent practicable:

- LID site assessment to appropriately plan the layout of improvements for capturing and retaining storm water runoff;
- Source control measures to mitigate potential pollutant generating activities and sources that are anticipated at the site;

- Site Design Measures to infiltrate, evapotranspire, and/or harvest and use the impervious runoff from the post-construction 85<sup>th</sup> percentile, 24-hour storm runoff event; and,
- Storm Water Treatment and Baseline Hydromodification Measures to infiltrate, evapotranspire, and/or bioretain remaining runoff from impervious surfaces, if necessary, after implementation of Site Design Measures.

Section 3 contains seven forms to address each of the above requirements.

**Form 3-1 Site Location and Hydrologic Features**

Enter the project specific information to document the site location and elevation to calculate the 85<sup>th</sup> percentile, 24-hour design storm depth. For reference, the table below provides the 85<sup>th</sup> percentile, 24-hour design storm depths for three elevation increments within the East Placer Region.

<b>85<sup>th</sup> Percentile, 24-Hour Design Storm Depth</b>
Elevation < 6,000 feet = 1.1 inch
Elevation 6,000 - 6,500 feet = 1.2 inch
Elevation 6,500 - 7,000 feet = 1.3 inch
Elevation > 7,000 feet = 1.4 inch

Identify the ultimate receiving waters and provide a general description of their location and distance in relation to the project site.

If the receiving waters are listed as impaired on the state 303(d) list, identify the pollutant(s) of concern. Refer to SWRCB website for the most current information:

[http://www.waterboards.ca.gov/water\\_issues/programs/water\\_quality\\_assessment/](http://www.waterboards.ca.gov/water_issues/programs/water_quality_assessment/)

For phased projects, the form clarifies requirements for defining DMAs and incorporating storm water control measures as each phase is developed.

This form is also used to define the project’s DMAs, as described in Chapter 4. For projects with more than one DMA, a conceptual level schematic should be developed showing the DMAs that have been defined for the project and their hydrologic connections to the site discharge location(s). The conceptual DMA diagram in this form should be referenced when laying out DMAs and conveyances in the project’s site plan as required in Form 3-2.

**Form 3-2 LID Site Assessment and Layout Documentation**

A site assessment must be conducted as early as possible in the project planning process to appropriately plan the site layout for the capture and treatment of storm water runoff.

The goal is to develop a site layout that minimizes impacts to site hydrology and other environmental systems, functions, and processes.

The form lists a series of considerations that should be evaluated when developing the site layout. For each item, check the appropriate box to indicate that it has been considered and appropriately incorporated, or that it is not applicable (N/A) and provide a brief explanation (use a separate sheet if necessary). To complete this form, develop and attach a site plan that illustrates the proposed site layout. The site plan may consist of a preliminary or conceptual level design drawing, but it is a key requirement of the Preliminary SWQP described in Section 2.

Ensure that the following items are included in the site plan:

- Site boundary
- Soil types and locations, test pit and infiltration test locations
- Topographic data with 1-foot contours (5-foot contour intervals may be used for steeper sites)
- Existing natural hydrologic features (e.g., depressions, watercourses, wetlands, riparian corridors)
- Environmentally-sensitive areas and areas to be preserved
- Proposed locations and footprints of improvements creating new, or replaced, impervious surfaces
- Potential pollutant sources areas
- DMAs for the proposed BMPs that will receive storm water runoff
- Existing and proposed site drainage network with flow directions and site run-on and discharge locations
- Proposed design features and surface treatments used to minimize imperviousness and reduce runoff including snow storage areas
- Proposed locations and footprints of treatment and hydromodification management facilities
- Design features for managing authorized non-storm water discharges
- Areas of soil and/or groundwater contamination
- Existing utilities and easements
- Maintenance areas

### Form 3-3 Source Control Measures

Source control measures are required on all Regulated Projects to prevent onsite pollutants from being mobilized and transported by storm water runoff. The goal of source control is to keep clean water clean. For each item listed in the form, check the box for activities and sources that may occur on the project and use the Source Control Measures Selection Table (Appendix C) to identify permanent structural, and/or operational source control measures. Add project specific descriptions of how each measure will be implemented on the project and attach additional pages if necessary. Be sure to describe any special features, materials, or methods of construction that will be used to implement the source control measures. The identification codes in the table correspond to the CASQA fact sheets which can be referenced for more information on each source control measure. The CASQA Storm Water BMP Handbooks are available for purchase at:

[www.casqa.org/resources/bmp-handbooks/](http://www.casqa.org/resources/bmp-handbooks/)

### Form 3-4 Runoff Reduction Calculator for Site Design Measures on Regulated Projects

On Regulated Projects, Site Design Measures must be implemented, to the extent technically feasible, to infiltrate, evapotranspire, and/or harvest and use the impervious surface runoff from the post-construction 85th percentile, 24-hour storm event.

For each DMA, identify the Site Design Measure(s) for implementation and enter the associated dimensions and quantity information into the form to calculate the resulting runoff reduction and the effective treated impervious area. Design guidance for Site Design Measures is provided in the Fact Sheets in Appendix B. The equations, variables and units that are used to calculate the Site Design Measure volume reductions ( $V_r$ ) are presented below for reference.

#### *Adjacent/On-Site Stream Setbacks and Buffers*

$$V_r = \left( \frac{1 \text{ ft}}{12 \text{ in}} \right) \times A_{imp} \times V_{85}$$

$A_{imp}$  (ft<sup>2</sup>) – Impervious drainage area discharging to the buffer

$V_{85}$  (in) – Runoff volume from the 85<sup>th</sup> percentile, 24-hour design storm

#### *Soil Quality Improvement and Maintenance*

$$V_r = (A_{pond} \times D_{pond}) + (A_{sa} \times D_{sa} \times \eta)$$

$A_{pond}$  (ft<sup>2</sup>) – Ponding area over soil improvement area

$D_{pond}$  (ft) – Ponding depth over soil improvement area

$A_{sa}$  (ft<sup>2</sup>) – Surface area of improved soils

$D_{sa}$  (ft) – Depth, or thickness, of improved soil layer  
 $\eta$  – Porosity of amended soil

*Tree Planting and Preservation*

$$V_r = [(218 \times n_e) + (109 \times n_d) + A_{tc}] * V_{85} * \left(\frac{1 \text{ ft}}{12 \text{ in}}\right)$$

$n_e$  – Number of new evergreen trees  
 $n_d$  – Number of new deciduous trees  
 $A_{tc}$  (ft<sup>2</sup>) – Canopy area of existing trees to remain on the property  
 $V_{85}$  (in) – Runoff volume from the 85<sup>th</sup> percentile, 24-hour design storm

*Rooftop and Impervious Area Disconnection*

$$V_r = \left(\frac{1 \text{ ft}}{12 \text{ in}}\right) \times A_{imp} \times V_{85}$$

$A_{imp}$  (ft<sup>2</sup>) – Impervious rooftop or other area draining to pervious infiltration area  
 $V_{85}$  (in) – Runoff volume from the 85<sup>th</sup> percentile, 24-hour design storm

*Porous Pavement*

$$V_r = A_{res} \times D_{res} \times \eta_{agg} \times C$$

$A_{res}$  (ft<sup>2</sup>) – Area of underlying gravel storage layer  
 $D_{res}$  (ft) – Depth of underlying gravel storage layer  
 $\eta_{agg}$  – Porosity of aggregate  
 $C$  – Efficiency factor (0.5 recommended)

*Vegetated Swales*

$$V_r = \left(\frac{1 \text{ ft}}{12 \text{ in}}\right) \times A_{imp} \times V_{85}$$

$A_{imp}$  (ft<sup>2</sup>) – Impervious rooftop or other area draining to swale  
 $V_{85}$  (in) – Runoff volume from the 85<sup>th</sup> percentile, 24-hour design storm

*Infiltration Trenches*

$$V_r = 0.5 \times L \times W \times D$$

$L$  (ft) – Trench length  
 $W$  (ft) – Trench width  
 $D$  (ft) – Trench depth

*Dry Wells and Underground Infiltration Facilities*

$$V_r = 0.5 \times V_a$$

$V_a$  (ft<sup>3</sup>) – Combined volume of all dry wells and underground infiltration facilities

*Rain Barrels and Cisterns*

$$V_r = 0.5 \times N \times V_a$$

N – Number of rain barrels and/or cisterns

$V_a$  (ft<sup>3</sup>) – Volume of each rain barrel and/or cistern

Form 3-4 includes runoff reduction calculations that are equivalent to those in the SWRCB's SMARTS Runoff Reduction Calculator. The volume reductions calculated by these methods are dependent on the Site Design Measure(s) being designed per the requirements in the respective Fact Sheets in Appendix B.

Form 3-4 calculates the impervious runoff volume generated by the design storm using a runoff coefficient of 0.9 for impervious surfaces.

The form calculates the effective treated impervious area by dividing the runoff reduction volume by the depth of runoff produced by the 85<sup>th</sup> percentile, 24-hour design storm depth.

If the post-construction 85<sup>th</sup> percentile, 24-hour storm event runoff from all impervious surfaces in a DMA is treated, no additional storm water control measures are required for that DMA. If there is untreated impervious area remaining, then Storm Water Treatment and Baseline Hydromodification Measures are required.

### Form 3-5 Computation of Water Quality Design Criteria for Storm Water Treatment and Baseline Hydromodification Measures

After implementation of Site Design Measures, any remaining storm water runoff for each DMA must be directed to one or more facilities designed to infiltrate, evapotranspire, and/or bioretain these remaining storm water flows. This form calculates the target Water Quality Volumes and Flows (WQV and WQF, respectively) using the tributary drainage area sizes and characteristics and local rainfall statistics. If all impervious area requiring treatment is treated by Site Design Measures, this form will return a zero value for WQV and WQF as no additional downstream BMPs are required. The Unit WQV referenced in the form is based on the site elevation and a 48-hr. drawdown time as follows:

Elevation (ft above sea level)	Unit WQV (in)
< 6,000	0.75
6,000 – 6,500	0.9
6,501 – 7,000	1.0
> 7,000	1.1

Storm water runoff entering a site from adjacent properties (run-on) becomes the responsibility of the owner. When entering the DMA sizes in this form, all offsite areas that may contribute run-on flows to the treatment facility must be included.

For DMAs containing multiple types of land cover, the form requires the user to enter a composite, area-weighted, runoff coefficient representing the DMA. The composite runoff coefficient can be calculated as:

$$C_w = \frac{\sum_{j=1}^n C_j A_j}{\sum_{j=1}^n A_j}$$

- $C_w$  = weighted runoff coefficient
- $C_j$  = runoff coefficient for area j
- $A_j$  (ft<sup>2</sup>) = area for land cover j
- $n$  = number of distinct land covers

The equations, variables, and units that are used to calculate the WQV and WQF are presented below for reference.

#### *Water Quality Volume (WQV)*

$$WQV (ft^3) = \left( \frac{1 ft}{12 in} \right) \times A \times R_c \times WQV_u$$

A (ft<sup>2</sup>) – Tributary Area to BMP

R<sub>c</sub> – Runoff coefficient

WQV<sub>u</sub> (in) – Unit Water Quality Volume

#### *Water Quality Flow (WQF)*

$$WQF (ft^3/s) = \left( \frac{1 ft}{12 in} \right) \times \left( \frac{1 hr}{3600 s} \right) \times A \times i_u \times R_c$$

$$WQF (ft^3/s) = A_{untreated} * I_u * (1ft/12in) * (1hr/3600s)$$

A (ft<sup>2</sup>) – Tributary Area to BMP

i<sub>u</sub> (in/hr) – Uniform Rainfall Intensity = 0.2 in/hr

R<sub>c</sub> – Runoff coefficient

### **Form 3-6 Infiltrating Bioretention Measures**

Form 3-6 is a sizing tool for volume-based, infiltrating bioretention facilities. Enter the dimensions and other required design parameters for each bioretention facility to calculate volume reductions and determine if the required performance criteria have been achieved. The form is intended to be used in conjunction with the bioretention BMP Fact Sheet(s) in Appendix B which provide additional design guidance.

The following inputs must be determined by the designer and entered into the appropriate cells:

- DMA ID No. – Previously defined DMAs for the Site Design Measures should be combined if they are draining to a single bioretention measure. Enter a unique identifier for the combined DMAs.
- Water Quality Volume (WQV) – If multiple DMAs are combined, as described above, the WQVs for each DMA must be summed.
- Surface Loading Rate (R<sub>surf</sub>)(in/hr)
- BMP Surface Area (top of BMP)(SA<sub>top</sub>) (ft<sup>2</sup>)
- Infiltration rate of soils underlying the BMP (use field measurement at the level where infiltration will occur)(in/hr).

- Maximum ponding depth ( $d_{max}$ ) (ft)
- Infiltrating surface area (bottom of BMP) ( $SA_{bottom}$ ) ( $ft^2$ )
- Planting media depth ( $d_{media}$ ) (ft)
- Planting media porosity ( $n_{media}$ )
- Gravel depth ( $d_{gravel}$ ) (ft)
- Gravel porosity ( $\eta_{gravel}$ )
- Total Treated Flow Rate for Project ( $Q_{total}$ )( $ft^3/s$ ) – Enter the total sum of all treated flows from all DMAs

Calculated values in Form 3-6 include the following:

*Ponding depth ( $d_{pond}$ ) (ft)* – This is determined by comparing the depth of water infiltrated within the drawdown time and the maximum ponding depth. The lesser value is taken as the ponding depth.

*Retention Volume ( $V_d$ ) ( $ft^3$ )* – This is the total runoff volume reduction achieved by the bioretention measure. Retention volume is calculated as follows:

$$V_r = SA_{bottom} \times \left[ d_{pond} + d_{media} \times \eta_{media} + d_{gravel} \times \eta_{gravel} + \left( \frac{1 \text{ ft}}{12 \text{ in}} \right) \times T_f \times I \times 0.5 \right]$$

The time of filling ( $T_f$ ) represents the amount of time typically required for the bioretention measure to fill after the initial onset of rain. A value of 3 hours is assumed and is incorporated into the calculation.

A safety factor of 0.5 is applied to the field measured infiltration rate ( $I$ ) to account for the degradation of this rate as the facility ages.

*Untreated Volume ( $V_{untreated}$ ) ( $ft^3$ )* – This is the difference between the WQV and retention volume. The retention volume must be greater than or equal to the WQV for each DMA so that “Yes” can be checked as the final item to complete the form.

*Treated Flow Rate ( $Q_{treated}$ ) ( $ft^3/s$ )* – This is the volumetric treatment rate achieved by the bioretention facility. The treated flow rate is calculated as follows:

$$Q_{treated} = \left( \frac{1 \text{ ft}}{12 \text{ in}} \right) \times \left( \frac{1 \text{ hr}}{3600 \text{ s}} \right) \times R_{surf} \times SA$$

If an alternative to bioretention is proposed, the designer must submit separate documentation to demonstrate that the proposed facility meets all of the following measures of equivalent effectiveness criteria when compared to bioretention facilities:

- Equal or greater amount of storm water runoff infiltrated or evapotranspired
- Equal or lower pollutant concentrations in storm water runoff that is discharged after biotreatment
- Equal or greater protection against shock loadings and spills
- Equal or greater accessibility and ease of inspection and maintenance

### **Form 3-7 Flow-Through Planters, Tree Box and Media Filters**

This form provides a tool for flow-based sizing of biotreatment and filtration facilities. Enter the dimensions and other required design parameters for each biotreatment facility to calculate volume reductions and determine if the required performance criteria have been achieved. The form is intended to be used in conjunction with the Fact Sheets found in Appendix B for flow-through facilities to help determine the required dimensions of the structure.

The following inputs must be determined by the designer and entered into the appropriate cells:

- DMA ID No. – Previously defined DMAs for the Site Design Measures should be combined if they are draining to a single treatment measure. Enter a unique identifier for the combined DMAs.
- Water Quality Flow (WQF) – If multiple DMAs are combined, as described above, the WQFs for each DMA must be summed.
- Surface loading rate ( $R_{surf}$ ) (in/hr) – A maximum of 5 in/hr is allowed.
- Maximum ponding depth ( $d_{max}$ ) (ft)
- Soil/media surface area (SA) ( $ft^2$ )
- Soil/media depth ( $d_{media}$ ) (ft)
- Soil/media porosity ( $\eta_{media}$ )
- Gravel depth ( $d_{gravel}$ ) (ft)
- Gravel porosity ( $\eta_{gravel}$ )

- Total Treated Flow Rate for Project ( $Q_{total}$ )( $ft^3/s$ ) – Enter the total sum of all treated flows from all DMAs

Calculated values in Form 3-7 include the following:

*Detention Volume ( $V_d$ )* – This is the volume of storm water runoff detained by the flow-through facility for filtration and discharge. Detention volume is calculated as follows:

$$V_d = SA \times \left[ d_{pond} + d_{media} \times \eta_{media} + d_{gravel} \times \eta_{gravel} + \left( \frac{1 \text{ ft}}{12 \text{ in}} \right) \times R_{surf} \times T_f \right]$$

The time of filling ( $T_f$ ) represents the amount of time typically required for the bioretention measure to fill after the initial onset of rain. A value of 3 hours is assumed and is incorporated into the calculation.

*Treated Flow Rate ( $Q_{treated}$ ) ( $ft^3/s$ )* – This is the volumetric treatment rate achieved by the flow-through planter or filter. The treated flow rate is calculated as follows:

$$Q_{treated} = \left( \frac{1 \text{ ft}}{12 \text{ in}} \right) \times \left( \frac{1 \text{ hr}}{3600 \text{ s}} \right) \times R_{surf} \times SA$$

*Untreated Flow Rate ( $Q_{untreated}$ ) ( $ft^3/s$ )* – This is the difference between the WQF and the treated flow rate. The treated flow rate must be greater than or equal to the WQF for each DMA so that “Yes” can be checked as the final item to complete the form.

Form 3-7 also provides a line item for entering the treated flow rate for proprietary devices that do not follow the design approach specified in this form. For proprietary devices, the treated flow rate is entered and the product specifications and design documentation must be included in the SWQP to justify and document the flow rates used.

If an alternative to flow-through planters or tree box or media filters is proposed, the designer must demonstrate that the proposed facility meets all of the following measures of equivalent effectiveness criteria when compared to flow-through planters or tree box or media filters:

- Equal or greater rate of storm water treatment
- Equal or lower pollutant concentrations in storm water runoff that is discharged after biotreatment
- Equal or greater protection against shock loadings and spills
- Equal or greater accessibility and ease of inspection and maintenance

## Section 4 Requirements for Hydromodification Management Projects

This section covers the additional requirements for Hydromodification Management Projects. Projects in this category must meet the same requirements as other Regulated Projects and confirm that post-construction peak runoff rates are less than or equal to the pre-construction peak runoff rate for a 2-yr, 24-hr storm event.

This section incorporates the hydrology methods in Section V of the Placer County SWMM. There are three forms in this section which are used to determine the pre-project peak flows and demonstrate compliance.

For projects in sensitive environmental locations, such as those discharging to impaired waters or wetlands, and/or larger sized projects (>200 acres) with ponding, where flow routing through sub-basins is required, or other projects with complex hydrologic characteristics, the jurisdictional agency may require an alternative approach to using the template forms. In these cases, additional hydrologic modeling analyses, such as a HEC-1 or HEC-HMS discrete storm analysis may be required to compare pre- and post-project discharge rates for compliance. In these cases, the Section 4 forms should be replaced with model results documentation showing that post-construction runoff is less than or equal to the pre-construction runoff rate for a 2-yr, 24-hr storm event.

### Hydromodification DMAs

The hydromodification analysis is performed at the project outlet points and requires that outlet level DMAs be defined for the project outlet points. These outlet level DMAs may be different than the previously defined DMAs used for BMP design, and will typically consist of combinations of these previously defined DMAs.

### Form 4-1 Peak Runoff Response Time

Complete the form utilizing the reference information in the Placer County SWMM to calculate peak runoff response time for each outlet level DMA. The following inputs must be determined by the designer and entered into the appropriate cells:

- Length of longest overland flow path ( $L_o$ ) (ft) – A maximum value of 100 feet is recommended since storm water runoff will typically concentrate and form rivulets or small gullies within this distance rather than staying in a sheet flow type regime.
- Slope of overland flow path ( $S_o$ ) (ft/ft)
- Manning's roughness coefficient for the overland flow surface ( $n_o$ )
- Hydrologic soil group (HSG)
- Current Land Cover Type(s)

- Pervious Area Condition
- Infiltration Rate (I)(in/hr) – The rates for the newly define outlet level DMA are required to be entered. These may vary from the infiltration rates for the previously developed DMAs used for BMP design.
- Length of collector flow path ( $L_c$ )(ft)
- Cross-sectional area of collector flow facility ( $ft^2$ )(A)
- Wetted perimeter of collector flow facility (ft) (P)
- Manning’s roughness coefficient for collector flow facility ( $n_c$ )
- Slope of collector flow facility ( $S_c$ )(ft/ft)

Calculated values in Form 4-1 include the following:

*Overland flow response time ( $T_o$ )(min)* – This is the response time of the overland flow areas for each DMA.

$$T_o = \left( \frac{0.355(nL)^{0.6}}{S_o^{0.3}} \right)$$

*Channel flow velocity ( $V$ ) (ft/s)* – This is used to calculate the response time of the flow conveyances for each DMA and is calculated using Manning’s equation as follows:

$$V = \frac{1.49}{n_c} \times \left( \frac{A}{P} \right)^{2/3} \times S^{0.5}$$

*Collector flow facility response time ( $T_c$ ) (min)* – This is the response time of the flow conveyances for each DMA.

$$T_c = \left( \frac{1 \text{ min}}{60 \text{ s}} \right) \times \frac{L_c}{V}$$

*Total response time ( $T_t$ ) (min)* – This is combined overland and collector flow response time.

$$T_t = T_c + T_o$$

### **Form 4-2 Hydromodification Target for Peak Runoff**

Form 4-2 computes the peak pre- and post-construction storm water runoff rates for each outlet level DMA. This form also provides a comparison of the pre-project peak flows to the combined treated flow rates for all BMPs and requires flow control at the

BMP discharges to be modified, if necessary, to meet the hydromodification management performance criteria.

The following inputs must be determined by the designer and entered into the appropriate cells:

- Drainage Area (A) (ft<sup>2</sup>) – This is the total area of each outlet level DMA including pervious and impervious surfaces.
- Impervious Area (A<sub>i</sub>) (ft<sup>2</sup>) – This is the total impervious area of each outlet level DMA.
- Rainfall depth (P<sub>r</sub>) (in) – This is the depth of the 2-yr, 24-hour storm event with a duration equal to the total response time calculated in Form 4-1.
- Total Pre-Project Peak Runoff (ft<sup>3</sup>/s) – This is the combined total of the pre-project peak runoff rates for each DMA.

Calculated values in Form 4-2 include the following:

*Unit peak runoff (q) (ft<sup>3</sup>/s/acre)*

$$q = 60 \times P_2 \times \frac{1}{T_t}$$

*Infiltration factor (F<sub>i</sub>) (ft<sup>3</sup>/s/acre)*

$$F_i = \text{Infiltration Rate (I)} * \left( 1 + \frac{1}{1.3 \times 0.0005 \times \text{Site Elevation}} \right)$$

*Peak Runoff (Q<sub>p</sub>) (ft<sup>3</sup>/s)*

$$Q_p = A \times q - F_i \times (A - A_i)$$

### **Form 4-3 Detention Volumes for Hydromodification Management**

Form 4-3 is used to demonstrate whether the combined detention capacity of the project's Site Design Measures and Storm Water Treatment and Baseline Hydromodification Measures is sufficient to meet the hydromodification requirements. The NRCS TR-55 Manual is utilized and referenced for information to complete this form and is available at the following website:

<http://www.hydrocad.net/pdf/TR-55%20Manual.pdf>

The following inputs must be determined by the designer and entered into the appropriate cells:

- Land cover and hydrologic condition
- Curve number (CN)

- Precipitation depth ( $P_2$ ) (in) – This is the depth of the 2-yr, 24-hr storm event.
- Equalization factor ( $V_s/V_r$ ) – The ratio of storage capacity to runoff volume. This is determined by using the attenuation factor and the nomograph in Figure 6-1 of the NRCS TR-55 Manual for Type 1A rainfall distribution.
- Site Design Measure volume ( $\text{ft}^3$ ) – This is the combined volume of all Site Design Measures within each of the outlet level DMA.
- Bioretention volume ( $\text{ft}^3$ ) – This is the combined volume of all bioretention facilities within each of the outlet level DMA.
- Flow-Through Detention Volume ( $\text{ft}^3$ ) – This is the combined volume of all flow-through treatment facilities within each of the outlet level DMA.
- Supplemental volume ( $\text{ft}^3$ ) – This is the volume of any additional detention facilities that have been incorporated into the outlet level DMA to meet the hydromodification management performance criteria.

Calculated values in Form 4-3 include the following:

*Post-development soil storage capacity (S) (in)*

$$S = \frac{1000}{CN} - 10$$

*Post-development runoff volume ( $V_{runoff}$ ) ( $\text{ft}^3$ )*

$$V_{runoff} = \left( \frac{1 \text{ ft}}{12 \text{ in}} \right) \times A \times \frac{(P_2 - 0.2 \times S)^2}{P_2 + 0.8 \times S}$$

*Attenuation factor ( $q_{out/in}$ )* – The ratio of the target outflow rate (pre-development peak discharge) to the peak inflow rate (post-development peak discharge).

$$q_{out/in} = \frac{\text{Pre - development } Q_p}{\text{Post - development } Q_p}$$

*Runoff detention capacity required to achieve hydromodification management performance criteria ( $D_{hydromod}$ ) ( $\text{ft}^3$ )*

$$D_{hydromod} = \frac{V_s}{V_r} \times V_{runoff}$$

*Combined Detention Volume ( $\text{ft}^3$ )* – This is the combined volume of all Site Design Measures, bioretention facilities, and any supplemental volume in each outlet level DMA.

The combined detention volume must be greater than or equal to the required runoff detention capacity to achieve hydromodification management performance criteria so that “Yes” can be checked as the final item to complete the form. If additional detention capacity is added using a facility that is separate from the Site Design Measures and storm water treatment/baseline hydromodification BMPs, flow control at the discharge must be incorporated so the total discharge rate from all BMPs is lower than the pre-project peak runoff rate.

### **Section 5 Inspection and Maintenance of Post-Construction BMPs**

An O&M Verification Program will be implemented for all structural storm water control measures. Project owners must provide a signed statement, prior to Improvement Plan or Grading Permit approval, accepting responsibility for O&M requirements until the responsibility is legally transferred to another entity. A signed statement must also be provided that grants access to all representatives of the jurisdictional agency for the sole purpose of performing O&M inspections of the installed treatment systems(s) and hydromodification control(s) if any.

#### **Form 5-1 BMP Inspection and Maintenance**

For Regulated Projects, the Final SWQP serves as a Maintenance Agreement and Permission to Access Agreement unless the jurisdictional agency has a separate mechanism in place such as the City of Roseville. The City of Roseville requires a separate agreement according to its ordinance. The Final SWQP is recorded with the property ownership documentation to ensure that the maintenance responsibilities and access agreement are transferred to the subsequent owner(s) upon sale of the property.

For all BMPs included in the SWQP, assess the site-specific conditions and reference the Fact Sheets in Appendix B to develop BMP inspection and maintenance requirements and complete Form 5-1. For proprietary BMPs, reference the standard inspection and maintenance documents for the product. SWQPs are required to include a detailed O&M Plan for all BMPs (attach O&M Plan) and a signed certification statement accepting responsibility for its implementation.

### **Section 6 Compliance Checklist**

The purpose of this section is to provide a mechanism for ensuring that all of the storm water control measures identified in the SWQP are also included on the approved Improvement Plans and will be constructed with the project.

#### **Form 6-1 Post-Construction Storm Water BMPs**

List each BMP included in the SWQP and the corresponding plan sheet number on the Improvement Plans. Create a copy of Form 6-1 and include it on the cover of the Improvement Plans.

**This page intentionally left blank.**

# Glossary

---

**Baseline Hydromodification Management Measures** – Storm water control measures designed to mitigate hydromodification on Regulated Projects that are not Hydromodification Management Projects.

**Best Management Practices (BMPs)** – Methods, measures, or practices designed and selected to reduce or eliminate the discharge of pollutants to surface waters from point and non-point source discharges including storm water. BMPs include structural, which are permanent, and non-structural controls and operation and maintenance procedures, which when implemented prevents, controls, removes, or reduces pollution from entering surface waters.

**Bioretention** – Post-construction storm water treatment BMP that treats storm water runoff vertically through an engineered soil filter media and vegetation and retains storm water runoff on-site through infiltration or evapotranspiration.

**Bioswale** – Shallow channels lined with grass and used to convey and store runoff.

**Brownfields** - Sites with soil contamination.

**Buffer** – A forested or otherwise vegetated area located between water bodies such as streams, wetlands, and lakes that provides a permanent barrier against runoff from development, agriculture, construction, and other land uses. Buffers are designed to filter pollutants in storm water runoff before the pollutants reach surface waters.

**California Environmental Quality Act (CEQA) Approval** – Formal approval of a proposed project under CEQA (California environmental legislation that establishes procedures for conducting an environmental analysis for all projects in California [California Public Resources Code, Section 21000, et. seq.]).

**California State Water Resources Control Board (SWRCB)** - The state-level entity that regulates storm water runoff and treatment in California.

**California Stormwater Quality Association (CASQA)** – Statewide association of municipalities, storm water quality managers, and other interested parties. Publisher of the California Stormwater Best Management Practices Handbooks, available at [www.cabmphandbooks.com](http://www.cabmphandbooks.com). Successor to the Storm Water Quality Task Force (SWQTF).

**Check Dam** – Structures constructed of a non-erosive material, such as suitably sized aggregate, wood, gabions, riprap, or concrete, used to slow water to allow sedimentation, filtration, evapotranspiration, and infiltration into the underlying native soil. Check dams can be employed in practices such as dry and enhanced grass swales.

**Clean Water Act (CWA)** – (33 U.S.C. 1251 et seq.) The Federal Water Pollution Control Act.

**Common/Larger Plan of Development or Sale** – A contiguous area, plan area, specific plan, subdivision or any other project site that has evaluated storm water management and may be phased in the future or where multiple, distinct construction activities may be taking place at different times under one plan.

**Conveyance System** – Any channel, swale, gutter, or pipe for collecting and directing storm water.

**Curb Cuts** – Curb openings that allow storm water runoff to enter landscaped areas, vegetated swales, planters, rain gardens, and other BMP features.

**Design Engineer** – Engineer responsible for preparing the SWQP for Regulated Projects, site design, and site plan.

**Design Storm** – A synthetic rainstorm based on historic rainfall data. For purposes of this Manual, the design storm is defined as the volume of runoff produced from the 85<sup>th</sup> percentile, 24-hour storm event. In the East Placer County Phase II MS4 Permit area, the 85<sup>th</sup> percentile, 24-hour storm event varies with elevation as follows:

Elevation (ft. above sea level)	85 <sup>th</sup> Percentile 24-Hour Storm Depth (Inches)
< 6,000	1.1
6,000 – 6,500	1.2
6,501 – 7,000	1.3
> 7,000	1.4

**Detached Single-family Home Project** – The building of one single new house or the addition and/or replacement of impervious surface associated with one single existing house, which is not part of a larger plan of development.

**Storm Water Detention** – The practice of temporarily storing peak storm water flows in basins, ponds, vaults, within berms, or in depressed areas and controlling the discharge rates into the storm drain system or receiving water. The detention process allows sediment and associated pollutants to settle out of the runoff.

**Development** – Any construction, rehabilitation, redevelopment, or reconstruction of any public or private residential project (whether single-family, multi-unit or planned unit development); industrial, commercial, retail and other non-residential projects, including public agency projects; or mass grading for future construction. It does not

include routine maintenance to maintain original line and grade, hydraulic capacity, or original purpose of facility, nor does it include emergency construction activities required to immediately protect public health and safety.

**Direct Discharge** – A discharge that is routed directly to waters of the United States by means of a pipe, channel, or ditch (including a municipal separate storm sewer system), or through surface runoff.

**Directly Connected Impervious Area (DCIA) or Surface** – Any impervious surface which drains directly into the storm drain system without first allowing flow through a pervious area (e.g., lawn).

**Discharger** – Any responsible party or site owner or operator within the Permittees' jurisdiction whose site discharges storm water or non-storm water runoff.

**Disconnected Pavement** – An impervious area that drains through a pervious area prior to discharge to the storm drain system.

**Drainage Management Area (DMA)** – A discrete area within a project site that contributes all precipitation falling within its boundaries to a single common outflow point, and is defined for the purpose of siting and designing storm water control measures in accordance with the Phase II MS4 Permit.

**Drawdown Time** – The time required for a storm water detention or infiltration BMP to drain and return to the dry-weather condition. For detention BMPs, drawdown time is a function of basin volume and outlet orifice size. For infiltration BMPs, drawdown time is a function of basin volume and infiltration rate.

**Environmentally Sensitive Area (ESA)** – A designated area that requires special protection because of its landscape, wildlife, and/or historical value.

**Erosion** – The physical detachment of soil due to wind or water. Often the detached fine soil fraction becomes a pollutant transported storm water runoff. Erosion occurs naturally, but can be accelerated by land disturbance and grading activities such as farming, development, road building, and timber harvesting.

**Evapotranspiration (ET)** – The general uptake and release of water by vegetation to the atmosphere.

**Existing Road Project** – Proposed redevelopment street/road project that will modify or redevelop an existing transportation surface in a manner that increases the surface footprint or impervious area of the roadway.

**Filter Strip** – Bands of closely-growing vegetation, usually grass, planted between pollution sources and downstream receiving water bodies.

**Filtration Rate** – The rate at which fluid passes through a porous medium (or media).

**Flow-Based Treatment Control Measures** – Storm water quality treatment measures that rely on flow capacity to treat storm water. These measures remove pollutants from a moving stream of water through filtration, infiltration, adsorption, and/or biological processes (e.g., vegetated swales and filter strips).

**Flow-Through Planters** – Structural landscaped reservoirs placed on impervious surfaces used to collect, filter, and temporarily store storm water runoff, allowing pollutants to settle and filter out as the water percolates through the planter soil until flowing through to an approved conveyance.

**Green Roof** – Conventional rooftops that include a thin covering of vegetation allowing the roof to function more like a vegetated surface. The layer thickness varies between 2-6 inches and consists of vegetation, waterproofing, insulation, fabrics, growth media, and other synthetic components.

**Green Street** – A Green Street uses a natural systems approach to reduce storm water flow, improve water quality, reduce urban heating, enhance pedestrian safety, reduce carbon footprints, and beautify neighborhoods. Green Street features include vegetated curb extensions, sidewalk planters, landscaped medians, vegetated swales, permeable paving, and street trees. (EPA, 2009)

**Groundwater** – Water that is underground in cracks and spaces in soil, sand, and rocks. The layers of soil, sand, and rocks are also known as aquifers.

**Groundwater Recharge** – The replenishment of existing natural water bearing subsurface layers of porous stone, sand, gravel, silt or clay via infiltration.

**Hydrograph** – Runoff flow rate plotted as a function of time.

**Hydrologic Cycle** – The movement of rainfall from the atmosphere to the land surface, to receiving waters and then back to the atmosphere through evaporation.

**Hydrologic Soil Group** – A soil classification system created by the National Resource Conservation Service (formerly Soil Conservation Service) based on the ability to convey and store water; divided into four groups:

- A – well drained sands and gravel, high infiltration capacity, high leaching potential and low runoff potential;
- B – Moderately drained fine to coarse grained soils, moderate infiltration capacity, moderate leaching potential and moderate runoff potential;
- C – Fine grained, low infiltration capacity, low leaching potential and high runoff potential;

- D – Clay soils, very low infiltration capacity, very low leaching potential and very high runoff potential.

### Typical Infiltration Rates

Soil Type (Hydrologic Soul Group)	Infiltration Rate (in/hr.)
A	1.00 – 8.3
B	0.5 – 1.00
C	0.17 – 0.27
D	0.02 – 0.10
Infiltration rates shown represent the range covered by multiple sources, e.g., ASCE, BASMAA, etc.	

**Hydrology** – The science dealing with the waters of the earth, their distribution on the surface and underground, and the cycle involving evaporation, precipitation, and flow to the seas.

**Hydromodification** – Modification of hydrologic pathways (precipitation, surface runoff, infiltration, groundwater flow, return flow, surface-water storage, groundwater storage, evaporation and transpiration) that results in negative impacts to watershed health and functions. Hydromodification results in an artificially altered rate of natural channel erosion and sedimentation processes.

**Impaired Water Body** – A waterbody (i.e., stream reaches, lakes, waterbody segments) with chronic or recurring monitored violations of the applicable numeric and/or narrative water quality criteria. An impaired water is a water that has been listed on the California 303(d) list or has not yet been listed but otherwise meets the criteria for listing. A water is a portion of a surface water of the state, including ocean, estuary, lake, river, creek, or wetland. The water currently may not be meeting state water quality standards or may be determined to be threatened and have the potential to not meet standards in the future. The State of California’s 303(d) list can be found at [http://www.waterboards.ca.gov/water\\_issues/programs/water\\_quality\\_assessment/](http://www.waterboards.ca.gov/water_issues/programs/water_quality_assessment/)

**Impervious Surface** – A surface covering or pavement of a developed parcel of land that prevents the land's natural ability to absorb and infiltrate rainfall/storm water.

**Infiltration** – The entry of water into the soil. Infiltration rate (or infiltration capacity) is the maximum rate at which a soil in a given condition will absorb water.

**Jurisdictional Agency** – The municipal agency/agencies with approval authority for private and public projects that fall under the requirements of the Phase II MS4 Permit.

**Linear Underground/Overhead Projects (LUPs)** – Include, but are not limited to, any conveyance, pipe, or pipeline for the transportation of any gaseous, liquid (including water and wastewater for domestic municipal services), liquescent, or slurry substance; any cable line or wire for the transmission of electrical energy; any cable line or wire for communications (e.g., telephone, telegraph, radio, or television messages); and associated ancillary facilities. Construction activities associated with LUPs include, but are not limited to, (a) those activities necessary for the installation of underground and overhead linear facilities (e.g., conduits, substructures, pipelines, towers, poles, cables, wires, connectors, switching, regulating and transforming equipment, and associated ancillary facilities); and include, but are not limited to, (b) underground utility mark-out, potholing, concrete and asphalt cutting and removal, trenching, excavation, boring and drilling, access road and pole/tower pad and cable/wire pull station, substation construction, substructure installation, construction of tower footings and/or foundations, pole and tower installations, pipeline installations, welding, concrete and/or pavement repair or replacement, and stockpile/borrow locations.

**Low Impact Development (LID)** – A sustainable practice that benefits water supply and contributes to water quality protection. Unlike traditional storm water management, which collects and conveys storm water runoff through storm drains, pipes, or other conveyances to a centralized storm water facility, LID takes a different approach by using site design and storm water management to maintain the site's pre-development runoff rates and volumes. The goal of LID is to approximate a site's pre-development hydrology by using design techniques that infiltrate, filter, store, evaporate, and detain storm water runoff close to the source of rainfall.

**Maximum Extent Practicable (MEP)** – The minimum required performance standard for implementation of municipal storm water management programs to reduce pollutants in storm water. Clean Water Act § 402(p)(3)(B)(iii) requires that municipal permits "shall require controls to reduce the discharge of pollutants to the maximum extent practicable, including management practices, control techniques and system, design and engineering methods, and such other provisions as the Administrator or the State determines appropriate for the control of such pollutants." MEP is the cumulative effect of implementing, evaluating, and making corresponding changes to a variety of technically appropriate and economically feasible BMPs, ensuring that the most appropriate controls are implemented in the most effective manner. This process of implementing, evaluating, revising, or adding new BMPs is commonly referred to as the iterative process.

**Municipal Separate Storm Sewer System (MS4)** – The regulatory definition of an MS4 (40 CFR 122.26(b)(8)) is "a conveyance or system of conveyances (including roads with drainage systems, municipal streets, catch basins, curbs, gutters, ditches, man-made channels, or storm drains): (i) Owned or operated by a state, city, town, borough, county, parish, district, association, or other public body (created to or pursuant to state law)

including special districts under state law such as a sewer district, flood control district or drainage district, or similar entity, or an Indian tribe or an authorized Indian tribal organization, or a designated and approved management agency under section 208 of the Clean Water Act that discharges into waters of the United States; (ii) Designed or used for collecting or conveying storm water; (iii) Which is not a combined sewer; and (iv) Which is not part of a Publicly Owned Treatment Works (POTW) as defined at 40 CFR 122.2."

In practical terms, operators of MS4s can include municipalities and local sewer districts, state and federal departments of transportation, public universities, public hospitals, military bases, and correctional facilities. The Storm Water Phase II Rule added federal systems, such as military bases and correctional facilities by including them in the definition of small MS4s.

**National Pollutant Discharge Elimination System (NPDES)** – A national program for issuing, modifying, revoking and reissuing, terminating, monitoring and enforcing permits, and imposing and enforcing pretreatment requirements, under Sections 307, 402, 318, and 405 of the Clean Water Act.

**Natural Resources Conservation Service (NRCS)** – NRCS provides technical expertise and conservation planning for farmers, ranchers and forest landowners wanting to make conservation improvements to their land.

**Non-Storm Water Discharge** – Any discharge to a storm drain that is not composed entirely of storm water. Certain non-storm water discharges are authorized per the NPDES Municipal Stormwater Permits.

**Open Space** – Pervious area within the project that is subtracted from the total project area to reduce the area used in sizing treatment and LID BMPs. For LID implementation, open space includes, but is not limited to, natural storage reservoirs, drainage corridors, buffer zones for natural water bodies, and flood control detention basins.

**Operations and Maintenance (O&M)** – Continuing activities required to keep storm water management facilities and their components functioning in accordance with design objectives.

**Outfall** – A point source, as defined by 40 CFR 122.2, at the point where an MS4 discharges to waters of the United States and does not include open conveyances connecting two MS4s, or pipes, tunnels or other conveyances which connect segments of the same stream or other waters of the United States and are used to convey waters of the United States.

**Peak Discharge Rate** – The maximum instantaneous rate of flow (volume of water passing a given point over a specific duration, such as cubic feet per second) during a storm, usually in reference to a specific design storm event.

**Permeable** – Soil or other material that allows the infiltration or passage of water or other liquids.

**Permeable or Pervious Pavement** – Asphalt or concrete rendered porous by the aggregate structure surfaces that allow water to pass through voids in the paving material and/or between paving units while providing a stable, load-bearing surface. An important component to permeable pavement is the reservoir base course, which provides stability for load-bearing surfaces and underground storage for runoff.

**Permittee/Permittees** – Municipal agency/agencies and non-traditional small MS4s that are named in and subject to the requirements of the Phase II MS4 Permit.

**Phase II MS4 Permit** - SWRCB Water Quality Order No. 2013-001-DWQ, NPDES General Permit No. CAS000004, Waste Discharge Requirements for Storm Water Discharges from small MS4s.

**Placer County Aquatic Resources Program (CARP)** – A multidisciplinary approach for identifying, classifying, ranking, and protecting the aquatic resources of western Placer County. Broadly defined, aquatic resources are those now regulated by the U.S. Army Corps of Engineers, LRWQCB, the California Department of Fish and Game, and the City of Lincoln and Placer County General Plans.

**Placer County Conservation Plan (PCCP)** – A Placer County-proposed solution to coordinate and streamline the permitting process by allowing local entities to issue state and federal permits. The proposed PCCP is a Habitat Conservation Plan (HCP) under the Federal Endangered Species Act and a Natural Community Conservation Plan (NCCP) under the California Natural Community Conservation Planning Act.

**Placer County Stormwater Management Manual (SWMM)** – A guidance manual produced by the Placer County Flood Control District and Water Conservation District to provide consistent, specific guidance and requirements for storm water management, including regulation of the development process, to achieve storm water management objectives.

**Pollutant** – Those substances defined in CWA §502(6) (33.U.S.C. §1362(6)) and incorporated by reference into California Water Code §13373.

**Porosity** – Ratio of pore volume to total solids volume.

**Project Owner** – Owner of a parcel proposed for development or redevelopment.

**Rain Event or Storm Event** – Any rain event greater than 0.1 inch in 24 hours except where specifically stated otherwise.

**Rain Garden** – A lot-level bioretention cell designed to receive and detain, infiltrate, and filter storm water runoff, typically used for discharge from roof leaders.

**Rainwater Harvesting** – The practice of intercepting, conveying, and storing rainwater for future use. Captured rainwater is typically used for outdoor non-potable water uses such as irrigation and pressure washing, or in the building to flush toilets or urinals or other uses that do not require potable water.

**Receiving Water** – Surface water that receives regulated and unregulated discharges from activities on land.

**Recharge** – The infiltration and movement of surface water into the soil, past the vegetation root zone, to the zone of saturation or water table.

**Reconstruction** – The removal and replacement of paving material down to subgrade.

**Redevelopment** – Land-disturbing activity that results in the creation, addition, or replacement of exterior impervious surface area on a site on which some past development has occurred. Redevelopment does not include trenching, excavation and resurfacing associated with LUPs; pavement grinding and resurfacing of existing roadways; construction of new sidewalks, pedestrian ramps, or bike lanes on existing roadways; or routine replacement of damaged pavement such as pothole repair or replacement of short, non-contiguous sections of roadway.

**Regional Water Quality Control Board (RWQCB)** – California RWQCBs are responsible for implementing pollution control provisions of the Clean Water Act and California Water Code within their jurisdiction.

**Regulated Project** – Refers to projects subject to the new and redevelopment standards in Section E.12 in the Phase II MS4 Permit.

**Regulated Small MS4** – A Small MS4 that discharges to a water of the United States or to another MS4 regulated by an NPDES permit and has been designated as regulated by the SWRCB or RWQCB under criteria provided in the Phase II MS4 Permit.

**Retention** – The practice of holding storm water in ponds or basins and allowing it to slowly infiltrate to groundwater. Some portion will evaporate. Also see infiltration.

**Retrofitting** – Improving pollution and/or flow control at existing developments and facilities to protect or restore beneficial uses and watershed functions.

**Riparian Areas** – Plant communities contiguous to and affected by surface and subsurface hydrologic features of perennial or intermittent waterbodies. Riparian areas have one or both of the following characteristics: 1) distinctively different vegetative species than adjacent areas, and 2) species similar to adjacent areas but exhibiting more vigorous or robust growth forms. Riparian areas are usually transitional between wetland and upland.

**Runoff** – Water flowing across the land that does not infiltrate the soil, but drains into surface or groundwater, or when rainfall exceeds the infiltration capacity of the land.

**Run-on** – Storm water surface flow or other surface flow that enters property that did not originate onsite.

**Setback** – The minimum distance that design elements must be placed from other elements. For example, houses usually have front, side, and rear yard setbacks from streets and other buildings.

**Site Design Measure** – Typically small, distributed structural or non-structural measures that aim to reduce the volume of storm water runoff close to the source of the rainfall.

**Soil Amendment** – Minerals and organic material added to soil to increase its capacity for absorbing moisture and sustaining vegetation.

**Source Control** – Land use or site planning practices, or structural or non-structural measures, that aim to prevent pollution of runoff by reducing the potential for contact with runoff at the source of pollution. Source control measures minimize the contact between pollutants and urban runoff.

**Storm Water** – Storm water is generated when precipitation from rain and snowmelt events flows over land or impervious surfaces and does not percolate into the ground. As storm water flows over the land or impervious surfaces, it accumulates debris, chemicals, sediment or other pollutants that could adversely affect water quality if the storm water is discharged untreated.

**Storm Water Management** – The process of collecting, conveying, storing, treating, and disposing of storm water to ensure control of the magnitude and frequency of runoff to minimize the hazards associated with flooding and the impact on water quality caused by manmade changes to the land.

**Storm Water Quality Plan (SWQP)** – The SWQP documents a project's compliance with the Phase II MS4 Permit and provides a standardized application form that produces complete and accurate submittals which result in more efficient reviews and project approvals.

**Surface Loading Rate (R<sub>surf</sub>)** – A hydraulic loading factor, expressed in terms of flow over surface area, representing the flow rate of storm water runoff over the surface area of the treatment measure (i.e. a bioretention cell).

**Swale** – A shallow storm water channel that can be vegetated with some combination of grasses, shrubs, and/or trees designed to slow, filter, and often infiltrate storm water runoff.

**Total Maximum Daily Loads (TMDLs)** – The maximum amount of a pollutant that can be discharged into a water body from all sources (point and nonpoint) and still meet water quality standards. Under CWA Section 303(d), TMDLs must be developed for all water bodies that do not meet water quality standards even after application of technology-based controls, more stringent effluent limitations required by a state or local authority, and other pollution control requirements such as BMPs.

**Treatment** – The application of engineered systems that use physical, chemical, or biological processes to remove pollutants. Such processes include, but are not limited to, filtration, gravity settling, media absorption, biodegradation, biological uptake, chemical oxidation, and ultraviolet light radiation.

**Treatment Control Measure** – Any engineered system designed to remove pollutants by simple gravity settling of particulate pollutants, filtration, biological uptake, media absorption, or any other physical, biological, or chemical process.

**Tributary Area** – The physical area that drains to a specific BMP or drainage feature.

**Underdrain** – A perforated pipe used to assist the draining of soils in some LID applications that have impaired infiltration.

**Urban Runoff** – Any runoff from urbanized areas that enters the MS4 including storm water and dry weather flows from a drainage area that reaches a receiving water body or subsurface. During dry weather, urban runoff may be comprised of groundwater base flow and/or nuisance flows, such as excess irrigation water.

**Vegetated Filter Strip** – Gently sloping, densely vegetated areas that treat runoff as sheet flow from adjacent impervious areas. They function by slowing runoff velocity and filtering out suspended sediment and associated pollutants, and by providing some infiltration into underlying soils. Also known as buffer strips and grassed filter strips.

**Vegetated Swale** – A long and narrow, trapezoidal or semicircular channel, planted with a variety of trees, shrubs, and grasses or with a dense mix of grasses. Storm water runoff from impervious surfaces is directed through the swale, where it is slowed and in some cases infiltrated, allowing pollutants to settle out. Check dams are often used to create small ponded areas to facilitate infiltration.

**Volume-Based Treatment Control Measures** – Storm water quality treatment measures that rely on volume capacity to treat storm water runoff. These measures detain or retain runoff and treat it primarily through settling or infiltration. Examples: detention and infiltration basins, porous pavement and storm water planters (bioretention).

**Water Quality Flow (WQF)** – For storm water treatment BMPs that depend on flow-through processes, such as filtration, to work, the flow rate of water that must be passed through the facility to achieve maximum extent practicable pollutant removal.

**Water Quality Volume (WQV)** – For storm water treatment BMPs that depend on detention to work, the volume of water that must be detained to achieve maximum extent practicable pollutant removal.

**Water Table** – Subsurface water level defined by the level below which all the spaces in the soil are filled with water; the entire region below the water table is called the saturated zone.

**Web Soil Survey (WSS)** – An interactive, internet-based soils database developed and administered by NRCS.

**Wet Season (Rainy Season)** – For the East Placer region, the calendar period beginning October 1 and ending April 30. Note: This differs from the California Department of Fish and Wildlife’s wet weather definition, which is October 15 – April 15.



**Appendix A**  
**Automated Template for Post-Construction Storm**  
**Water Quality Plan**

**(Provided in Electronic Format Only)**

<http://www.placer.ca.gov/lowimpactdevelopment>

**Appendix B**  
**BMP Fact Sheets**

# STREAM SETBACK AND BUFFERS

## Fact Sheet SDM-1

Also known as: Aquatic buffers, riparian setbacks

### DESCRIPTION

Stream setbacks and buffers are vegetated areas that exist or are established along a stream system, lake, reservoir, or wetland area where development is restricted or prohibited. They consist of trees, shrubs, and herbaceous vegetation that separates and physically protects aquatic ecosystems and habitats from future disturbance or encroachment. Stream setbacks and buffers can either be preserved natural areas or engineered BMPs specifically designed to treat storm water runoff before it enters a stream, shore, or wetland.



Stream buffer in North Lake Tahoe, Placer County.  
Source: CDM Smith

### ADVANTAGES

- Can be used as part of a treatment train with other BMPs.
- Can provide high level water quality treatment with proper design.
- Limits development in floodplain areas.
- Improves aesthetics.
- Improves quality of aquatic ecosystems and habitats.
- Serves as foundation for present or future greenways.

### LIMITATIONS

- A minimum stream setback and buffer width of 500 feet is required to obtain storm water runoff reduction credits.
- Restrictions on available space for development.
- Potential establishment of nuisance species.
- Not suitable for treating point-source storm water discharges (i.e. end of pipe).
- Can be difficult to delineate and demarcate stream setback and buffer widths.
- Natural stream shifts may alter stream setback and buffer widths.

### KEY DESIGN FEATURES

The ability of a particular stream setback and buffer to function effectively depends on how well the buffer is planned or designed. In general, the following guidelines should be followed (for more information see *The Architecture of Urban Stream Buffers, The Practice of Watershed Protection: Article 39*):

- Maintain the stream setback and buffer in an ungraded and uncompacted condition.
- Protect the stream setback and buffer from vehicular traffic to reduce compaction.
- The contributing overland slope should be 5% or less unless a level spreader is used.
- Adopt a vegetative target based on predevelopment plant community.
- Expand the width of the middle zone to pick up wetlands, slopes and larger streams.

# STREAM SETBACK AND BUFFERS

## Fact Sheet SDM-1

- Use clear and measurable criteria to delineate the origin and boundaries of the buffer.
- The number and conditions for stream and buffer crossings should be limited.
- The use of buffer for storm water runoff treatment should be carefully prescribed.
- Buffer boundaries should be visible before, during, and after construction.
- Buffer education and enforcement are needed to protect buffer integrity.



Stream buffer in eastern Sierra Nevada  
Photo Source: CDM Smith

A minimum stream setback and buffer width of 500 feet is required to obtain runoff volume reduction credits. However, smaller stream setbacks and buffers may be required by local jurisdictions even if runoff volume reduction credits are not obtainable. For areas within the East Placer County Phase II MS4 Permit boundary, local ordinances should be reviewed to determine required stream setback widths at a particular site.

## SIZING DESIGN GOALS AND REQUIREMENTS

The Post-Construction Storm Water Quality Plan (SWQP) Form 3-6 should be used to calculate the retention volume ( $V_{ret}$ ) of the Stream Setback and Buffer. This value is then used to calculate the area of impervious surface treated, and determine if other site design measures are necessary to capture the 85<sup>th</sup> percentile, 24-hour design storm for Regulated Projects. The equation for determining  $V_{ret}$  is as follows:

$$V_{ret} = A_{imp} * V_{85} * (1/12)$$

Where:

- $V_{ret}$  = storm water retention volume (ft<sup>3</sup>);
- $A_{imp}$  = impervious area draining to the stream setback (ft<sup>2</sup>); and
- $V_{85}$  = runoff volume from the 85th percentile, 24-hour design storm (in)

## RUNOFF REDUCTION CREDIT REQUIREMENTS

- A minimum stream setback and buffer width of 500 feet is required to obtain runoff volume reduction credits.

## INSPECTION AND MAINTENANCE REQUIREMENTS

A maintenance plan shall be provided with the SWQP. The maintenance plan shall include recommended maintenance practices, state the parties responsible for maintenance and upkeep, specify the funding source for ongoing maintenance, and provide a site specific inspection checklist. At a minimum, maintenance shall include the following:

- Establish and manage distinctions of allowable and unallowable uses in each buffer zone.
- Clearly identify buffer boundaries and maintain clear signs or markers defining buffer extents.
- Inspect newly established vegetation semi-annually to determine if landscape maintenance is needed (reseeding, irrigation, trimming, weed removal, etc.).
- Inspect disturbed and revegetated slopes semi-annually for erosion and repair as needed.
- Inspect trails, paths, and bridges annually for erosion or structural issues and repair as necessary.

# STREAM SETBACK AND BUFFERS

---

## Fact Sheet SDM-1

### REFERENCES

Schueler, T. 2000. The Architecture of Urban Stream Buffers, The Practice of Watershed Protection: Article 39. Center for Watershed Protection, Ellicott City, MD. Pages 225-233. Available for download at: [http://owl.cwp.org/mdocs-posts/elc\\_pwp39/](http://owl.cwp.org/mdocs-posts/elc_pwp39/)

Storm water Center, Aquatic Buffers Fact Sheet: Buffer Zones. Available online at: <http://www.stormwatercenter.net/>

U.S. Environmental Protection Agency. Aquatic Buffer Model Ordinance. Available online at: <https://www.epa.gov/nps/urban-runoff-model-ordinances-aquatic-buffers>

# SOIL QUALITY IMPROVEMENT AND MAINTENANCE

## Fact Sheet SDM-2

Also known as: Soil amendments, engineered soils

### DESCRIPTION

The quality of existing soils on a project site can be improved by implementing soil amendments that alter the physical, chemical, and biological characteristics of the soil. Soil amendments can help restore disturbed soils by increasing organic matter content and reducing compaction. Amendments can also make soils with high clay content (i.e. hydrologic soil groups [HSG] C and D) more suitable to receive and filter/infiltrate site runoff. Soil amendments consist of humus such as compost and aged manure; fibrous materials such as peat, wood chips, and hardwood bark; inorganic materials such as vermiculite and perlite; and other soil conditioners and fertilizers as appropriate. The practice can increase infiltration rates, plant survival rates and health, enhance root growth, provide erosion stabilization, and decrease need for irrigation and fertilization.



Photo Source: CDM Smith

### ADVANTAGES

- Improves soil infiltration rates.
- Reduces surface runoff quantities and erosion.
- Improves soil filtration capabilities and pollutant removal.
- Enhances plant survival rates and health.
- Decreases need for landscape irrigation and fertilization.

### LIMITATIONS

- Not recommended for slopes steeper than 3:1.
- Could result in increased water table elevations, lateral groundwater flows and other conditions that may create unwanted seepage or flooding at down gradient locations.

### KEY DESIGN FEATURES

The type, mix, and amounts of soil amendments will vary from site to site in response to the local soil conditions and type of desired vegetation. Existing soils must be sampled and analyzed to determine soil characteristics and identify appropriate amendment types and quantities. Soil amendments should consist primarily of compost mixed with other materials as necessary.

Before soil amendments are applied, use a rototiller, soil ripper, or other equipment to loosen existing soils to the desired depth. Loosening soils below the depth of the amended soil layer will further improve infiltration. Design depths of soil amendment areas range from 6 inches minimum to several feet. Soil amendments should then be applied over the loosened soil area and incorporated into the existing soil until fully mixed. The amended soil should then be watered thoroughly and allowed to settle for at least one week prior to final grading. Seeding and planting should be performed immediately after final grading is complete.

# SOIL QUALITY IMPROVEMENT AND MAINTENANCE

## Fact Sheet SDM-2

### SIZING DESIGN GOALS AND REQUIREMENTS

A qualified Geotechnical Engineer, Geologist, or Hydrogeologist should be consulted for the implementation of this Site Design Measure. The Post-Construction Storm Water Quality Plan (SWQP) Form 3-4 should be used to calculate the retention volume ( $V_{ret}$ ) of the soil quality improvement and maintenance area. This value is then used to calculate the area of impervious surface treated, and determine if other site design measures are necessary to capture the 85<sup>th</sup> percentile, 24-hour design storm for Regulated Projects. The equation for determining  $V_{ret}$  is as follows:

$$V_{ret} = (A_{pond} * D_{pond}) + (A_{sa} * D_{sa} * n)$$

Where:

$V_{ret}$  = storm water retention volume (ft<sup>3</sup>);  
 $A_{pond}$  = ponding area (ft<sup>2</sup>);  
 $D_{pond}$  = ponding depth (ft);  
 $A_{sa}$  = soil amendment area (ft<sup>2</sup>);  
 $D_{sa}$  = depth of amended soil (ft); and  
 $n$  = porosity of amended soil

Soil quality improvement and maintenance areas must meet the ideal bulk densities provided in Table 1 below. Soil porosity ( $n$ ) in the above equation is calculated as follows:

$$n = 1 - (\rho_{sa} / 2.65 \text{ g/cm}^3)$$

Where:

$n$  = porosity of amended soil; and  
 $\rho_{sa}$  = bulk density of amended soil (g/cm<sup>3</sup>)

**Table 1. Ideal Bulk Densities or Amended Soils (grams/cm<sup>3</sup>)**

Sands, loamy sands	<1.6
Sandy loams, loams	<1.4
Sandy clay loams, clay loams	<1.4
Silts, silt loams	<1.3
Silt loams, silty clay loams	<1.1
Sandy clays, silty clays, clay loams	<1.1
Clays (>45% clay)	<1.1

Data source: USDA NRCS

### INSPECTION AND MAINTENANCE REQUIREMENTS

A maintenance plan shall be provided with the SWQP. The maintenance plan shall include recommended maintenance practices, state the parties responsible for maintenance and upkeep, specify the funding source for ongoing maintenance, and provide a site specific inspection checklist. At a minimum, maintenance shall include the following:

- Soil should be planted and mulched after installation. No part of the site should have bare soil exposed.
- Compaction of amended soils should be avoided.
- Amended soils should be inspected annually for signs of compaction, waterlogging, loss of vegetated cover, or erosion.
- Corrective actions include application of additional amendments and mechanical aeration.

# SOIL QUALITY IMPROVEMENT AND MAINTENANCE

---

## REFERENCES

USDA Natural Resources Conservation Service. June 2008. Soil Quality Indicators. Available online at: [https://www.nrcs.usda.gov/Internet/FSE\\_DOCUMENTS/nrcs142p2\\_053256.pdf](https://www.nrcs.usda.gov/Internet/FSE_DOCUMENTS/nrcs142p2_053256.pdf)

Low Impact Development Center, Inc. 2010. Low Impact Development Manual for Southern California: Technical Guidance and Site Planning Strategies. Available online at: <https://www.casqa.org/resources/lid/socal-lid-manual>

U.S. Environmental Protection Agency. 2007. The Use of Soil Amendments for Remediation, Revitalization, and Reuse. Available online at: <http://nepis.epa.gov/Exe/ZyPDF.cgi/60000LQ7.PDF?Dockey=60000LQ7.PDF>

# TREE PLANTING AND PRESERVATION

## Fact Sheet SDM-3

Also known as: Interceptor Trees

### DESCRIPTION

Tree planting and preservation involves planting of new trees and preservation of existing trees to reduce storm water runoff volumes from a new development or redevelopment site. Trees intercept rain water on their leaves and branches before it lands on impervious surface below, allowing rain water to evaporate or run down the branches and trunk of the tree where it readily infiltrates into the soil. Trees absorb infiltrated runoff through their roots and further reduce storm water runoff by means of transpiration. Trees also provide shade over impervious surfaces which reduces the “heat island” effects of urban areas. Tree planting and preservation should be implemented on residential lots, throughout landscape corridors, in commercial and industrial parking lots, and along street frontages.



Tree protection during construction  
Photo Source: CDM Smith

### ADVANTAGES

- Reduces storm water runoff volumes and the amount of pollutants entering downstream BMPs and the storm drain system.
- Enhances aesthetic value.
- Provides shade to cool pavement and reduces surface runoff temperatures.
- Aids in removal of air pollutants and noise reduction.
- Trees required by the permitting agency may be counted as interceptor trees.
- Establishes habitat for birds and other pollinators like butterflies and bees.
- Extends life of asphalt paving.

### LIMITATIONS

- Great care must be exercised when work is conducted near existing trees to be preserved.
- New and existing trees may require irrigation.
- New and existing trees must have adequate setback from buildings, structures, and utilities.
- Incorrect tree selection can result in high irrigation costs and pest infestation.
- Runoff reductions are dependent on the canopy area over the impervious surfaces created by the project.

### KEY DESIGN FEATURES

- Appropriate new trees must be selected according to site and soil characteristics. Refer to the [Local Landscape Design Guidelines](#) for more information.
- Involve an arborist in the design process.
- Fire safety must be a consideration in areas with increased risk of fire hazard.

# TREE PLANTING AND PRESERVATION

---

## Fact Sheet SDM-3

- Consider the future size/canopy and root zone of the fully-grown mature species when locating trees on the site, providing proper clearance from building foundations, pavement and overhead/underground utilities. Ideally, provide a setback of 10 to 15 feet from the expected 10-year canopy to overhead lines.
- Utilize approved root barriers when trees are planted in near proximity to infrastructure, per the local permitting agency standards.
- Evergreen trees provide the greatest benefit to water quality due to their retention of leaves throughout the rainy season.
- Install irrigation systems according to local specifications.
- Do not install grass or turf within 24 inches of the tree trunk.
- Use mulch around the base of newly planted trees to reduce irrigation needs and protect bare soils from erosion. Consult an Arborist or nursery on appropriate amounts and types.

## SIZING DESIGN GOALS AND REQUIREMENTS

The Post-Construction Storm Water Quality Plan (SWQP) Form 3-4 should be used to calculate the retention volume associated with tree planting and preservation. This value is then used to calculate the area of impervious surface treated, and determine if other site design measures are necessary to capture the 85<sup>th</sup> percentile, 24-hour design storm for Regulated Projects. The equation for determining  $V_{ret}$  is as follows:

$$V_{ret} = ((n_e * 218) + (n_d * 109) + A_{tc}) * (V_{85} * 1 \text{ ft}/12\text{in})$$

Where:

$V_{ret}$	= storm water retention volume (ft <sup>3</sup> );
$n_e$	= number of new evergreen trees;
$n_d$	= number of new deciduous trees;
$A_{tc}$	= canopy area of existing trees to remain on the property (ft <sup>2</sup> )
$V_{85}$	= runoff volume from the 85th percentile, 24-hour design storm (in)

## INSPECTION AND MAINTENANCE REQUIREMENTS

A maintenance plan shall be provided with the SWQP. The maintenance plan shall include recommended maintenance practices, state the parties responsible for maintenance and upkeep, specify the funding source for ongoing maintenance, and provide a site specific inspection checklist. At a minimum, maintenance shall include the following:

- Irrigate as necessary to establish and maintain trees.
- Remove fallen leaves and debris annually to prevent materials from being transported in storm water runoff.
- Prune dead vegetation from trees on a regular basis.
- Minimize the use of chemical fertilizers and pesticides.
- Maintain lawn and turf at least 24 inches from trunk of tree.
- Remove and replace dead trees as needed.

## REFERENCES

Placer County Planning Services Division. 2013. Placer County Landscape Design Guidelines.

Available online at: <http://www.placer.ca.gov/departments/communitydevelopment/planning/documentlibrary/designguidelines/>

Sacramento County, et al. 2014. Storm water Quality Design Manual for the Sacramento Region. Available online at: <http://www.beriverfriendly.net/newdevelopment/stormwaterqualitydesignmanual/>

# ROOFTOP & IMPERVIOUS AREA DISCONNECTION, AND SNOW STORAGE

## Fact Sheet SDM-4

Including: Downspout Disconnection, Pavement Disconnection, Flowpath Disconnection.

### OVERVIEW

Rooftop and impervious area disconnection are techniques that reduce the volume of storm water delivered to storm drains or receiving waters by disconnecting the runoff from these areas and redirecting it to permeable locations that promote soil filtration and runoff infiltration. This can be accomplished by configuring roof gutter downspouts and impervious areas (e.g., driveways, pathways, small parking areas, and patios) to discharge runoff into landscaped areas, rain barrels and cisterns, or designed storm water management areas such as vegetated swales, stream buffers, amended soil areas, and bioretention cells.

In cold climate regions, snow removal from roadways, parking lots, driveways and other areas is common and snow storage needs must be considered as part of the site design. Runoff from melting snow can mobilize and transport pollutants such as traction sand, salt, oil and grease, heavy metals, trash and any other material that may be present in the flow path. As snow is handled, it can also pick up and mix with these pollutants and release them during the melting process. Proper planning for snow storage is a highly effective method for reducing the risk of pollutant discharge from a developed site.

Snow driven hydrology includes a winter time build-up of snow pack followed by spring snow melt and infiltration. Because snow melts slowly, all of the water that is produced will generally infiltrate if the snow lies over a permeable soil surface. Storing removed snow over a permeable area provides the opportunity for this natural melt and infiltration process to occur. Placing snow over impervious areas or in locations where the melt water will enter a drainage conveyance alters this hydrology and facilitates pollutant transport.

This Fact Sheet is organized to include separate sections for rooftop and impervious area disconnection, and snow storage. Details on specific storm water management strategies discussed herein, including stream setbacks and buffers, soil quality improvement and maintenance, porous pavement, vegetated swales, rain barrels and cisterns, and bioretention, can be found in other Fact Sheets included in this manual.

### **ROOFTOP DISCONNECTION**

Roof drains and downspouts can be disconnected from the storm drain system by routing discharge to vegetated areas or into subsurface infiltration systems. The two rooftop disconnection methods discussed in this Fact Sheet include splash blocks and bubble-up emitters which both provide means of dissipating flow energy and spreading flows over the pervious area. Rooftop drainage is also ideal for harvest/reuse applications; refer to the Rain Barrels and Cisterns Fact Sheet for more information.



Rooftop disconnection. Source: LID Center



Store snow on pervious surfaces to minimize runoff entering storm drains. Source: CDM Smith

# ROOFTOP & IMPERVIOUS AREA DISCONNECTION, AND SNOW STORAGE

## Fact Sheet SDM-4

In cold climate regions, snow will either accumulate on rooftops and slowly melt, or, if the roof is metal or steeply sloped, it may slide from the roof and accumulate adjacent to the building. Most structures do not include roof gutters and downspouts because they are easily damaged by snow and ice. In these cases, snow melt drips from edge of the roof and can be managed in the same way as rainfall runoff using dry wells or infiltration trenches along drip line (See Fact Sheet SDM-8). In cases where the roof sheds the snow, special consideration should be given to the areas that will receive these avalanches. Snow sliding from a roof is highly hazardous and can easily damage anything that it lands on. Pervious areas that are sloped away from the building are ideal. Snow should never be allowed to shed onto

walkways or other areas where people or pets may be present. If snow does shed to an impervious surface, it should drain to pervious area, or the snow should be removed to a pervious area.

### **SPLASH BLOCK**

Splash blocks are a low tech and cost efficient option to hard piped downspout systems. Existing downspouts can easily be retrofitted using splash blocks that reduce the velocity and impact of runoff discharging from downspouts. This reduces soil erosion and promotes infiltration.

#### **ADVANTAGES**


- Reduces peak flow rates and total runoff volumes.
- Directs runoff away from foundations and structures.
- Simple to implement in retrofit applications.
- Reduces the size of downstream BMPs.

#### **LIMITATIONS**

- Adjacent buildings and overflow requirements need to be considered in design.
- Only appropriate for sites with pervious areas near downspouts.
- If groundwater exists within two feet of the ground surface, seasonal fluctuations may result in periods of decreased infiltration and/or standing water.
- Runoff reduction credits cannot be claimed for rooftop disconnection if credits for stream setbacks and buffers or vegetated swales are being claimed in the same sub-watershed areas (DMA).

#### **KEY DESIGN FEATURES**

- Sites should be evaluated to ensure that splash blocks won't have negative impacts.
- Rain water must be directed away from foundations and footings.
- Do not compact soils in areas where infiltration of storm water is planned.
- Downspouts must extend at least six feet from a basement and two feet from a crawl space or concrete slab.
- The area of rooftop connecting to each downspout must be 600 square feet or less.
- Downspouts should not be directed to paved areas or across sidewalks.
- Landscaped areas receiving roof water should be adequately sized to prevent runoff or erosion. A maximum impervious:pervious ratio of 2:1 should be applied.

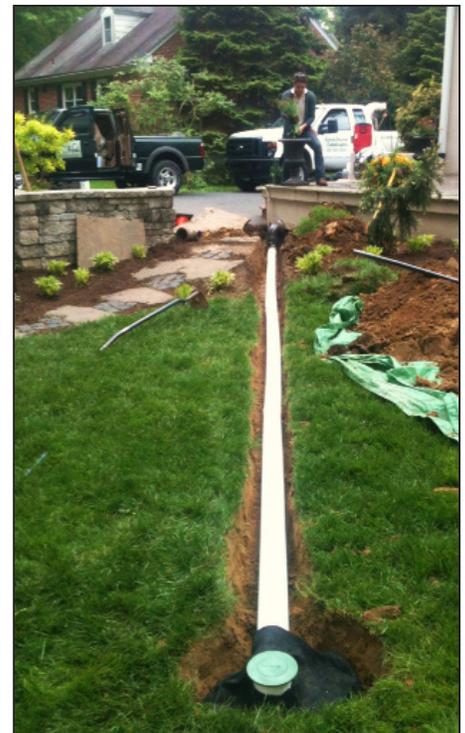

Bubble-up emitter installation.  
Photo Source: green-weaver.com

# ROOFTOP & IMPERVIOUS AREA DISCONNECTION, AND SNOW STORAGE

## Fact Sheet SDM-4

- Flow spreaders should be implemented downstream of splash blocks for sites with steep slopes.

### **BUBBLE-UP EMITTER**

Bubble-up emitters function very much like splash blocks, but allow for roof drainage to be discharged into vegetated areas that are not directly adjacent to the building. Downspouts are connected to underground pipes then released through a valve that opens with water pressure.

### **ADVANTAGES**

- Reduces peak flow rates and total runoff volumes.
- Directs runoff away from foundations and structures.
- Can discharge to vegetated areas not adjacent to buildings.
- Reduces the size of downstream BMPs.

### **LIMITATIONS**

- Overflow requirements need to be considered in design.
- Increased maintenance and cost over splash blocks.
- Runoff reduction credits cannot be claimed for rooftop disconnection if credits for stream setbacks and buffers or vegetated swales are being claimed in the same sub-watershed areas (DMA).

### **KEY DESIGN FEATURES**

- The area of rooftop connecting to each downspout should be 600 square feet or less.
- Landscaped areas receiving roof water should be adequately sized to prevent runoff or erosion. A maximum impervious:pervious ratio of 2:1 should be applied.
- Overflow systems and backflow prevention should be incorporated into design.
- Piping and valves must be able to convey the design storm event.

### **IMPERVIOUS AREA DISCONNECTION**

Disconnecting impervious areas involves routing runoff from paved areas such as roads, parking lots, pathways, courtyards, and patios to adjoining vegetated areas as sheet flow. As the sheet flow passes over vegetated areas it is filtered by the soil and infiltrated thereby reducing the volume of storm water discharged to receiving waters or the storm drain system. Examples of vegetated areas to accept sheet flow runoff include vegetated swales, stream buffers, amended soil areas, and bioretention cells. Another alternative for disconnecting impervious surfaces involves implementation of pervious pavement; refer to the Pervious Pavement Fact Sheet for more information.

In general, curb and gutter should be avoided to reduce concentrated flows from impervious surfaces. However, curb cuts can be effectively implemented to direct runoff from roads and parking lots into permeable storm water management areas. Level spreaders should be considered for energy dissipation and promotion of sheet flow to the pervious areas. This technique works well for retrofitting existing sites at a relatively low cost. Care must be taken to provide adequate clearances between vegetated infiltration areas and building foundations and paved surfaces.

In cold climate areas, snow removal activities require adequately sized storage areas to be accessible from parking lots, driveways, and other areas to be kept clear during winter months. Open pervious areas used for impervious disconnection are ideal for this purpose.



Impervious Area Disconnection.  
Photo Source: City of Kitchener, ON

# ROOFTOP & IMPERVIOUS AREA DISCONNECTION, AND SNOW STORAGE

## Fact Sheet SDM-4

### ADVANTAGES

- Reduces peak flow rates and total runoff volumes.
- Eliminates need for storm water conveyance infrastructure.
- Promotes groundwater recharge and is aesthetically pleasing.
- Reduces the size of downstream BMPs.

### LIMITATIONS

- Soil permeability may limit use of existing vegetated areas.
- Not suitable for sites with high concentrations of oil & grease or potential spills.
- Could result in increased water table elevations, lateral groundwater flows and other conditions that may create unwanted seepage or flooding at down gradient locations.
- Runoff reduction credits cannot be claimed for impervious area disconnection if credits for stream setbacks and buffers are being claimed in the same sub-watershed areas (DMA).

### KEY DESIGN FEATURES

- The area of impervious surface discharging to a single vegetated area must be 5,000 square feet or less.
- The size of the pervious area receiving runoff or stored snow should be at least 50% of the contributing impervious area (i.e. use a maximum impervious:pervious ratio of 2:1).
- The maximum contributing impervious flow length should be less than 75 feet. If equal or greater than 75 feet, a storage device (e.g. French drain, bioretention area, gravel trench) should be implemented as a buffer prior to discharging to the impervious area.
- Water barriers may be required when infiltrating adjacent to paved surfaces in order to prevent undermining of pavement and baserock.
- If flow is to be introduced through curb cuts, place pavement slightly above the elevation of the pervious area. Curb cuts should be at least 12 inches wide to prevent clogging.
- Snow storage areas should be sited in low lying pervious areas. Snowmelt should not be directly discharged into receiving waters or the storm drain system.
- Do not store snow in areas where it will restrict flows through inlets and storm drains.
- Avoid storing snow on compacted or poorly draining soils or on unpaved parking areas roadways.
- Size snow storage areas to accommodate the expected volume of snow. The snow storage footprint should be at least 20 percent of the plowed area.
- Snow storage areas should be vegetated or covered with gravel to reduce soil disturbance and soil compaction from snow removal equipment. When possible, maintain a layer of packed snow to protect soil and vegetation.
- If snow storage must be sited on impervious surfaces, direct snowmelt to pervious areas, vegetated swales, or subsurface infiltration systems.
- Clearly mark the snow storage areas to be visible under winter conditions.
- If adequate on-site snow storage cannot be provided, snow should be removed from the site and stored elsewhere.
- When storing snow in landscaped areas, plant with native and adapted species tolerant of snow storage (perennials that die back annually and shrubs/trees that can bend with weight, but not break).

### SIZING DESIGN GOALS AND REQUIREMENTS

The Post-Construction Storm Water Quality Plan (SWQP) Form 3-4 should be used to calculate the retention volume ( $V_{ret}$ ) associated with rooftop and impervious area disconnection. This value is then used to calculate the area of impervious surface treated, and determine if other site design measures are necessary to capture the 85<sup>th</sup> percentile, 24-hour design storm for Regulated Projects. The equation for determining  $V_{ret}$  is as follows:

# ROOFTOP & IMPERVIOUS AREA DISCONNECTION, AND SNOW STORAGE

## Fact Sheet SDM-4

$$V_{ret} = A_{imp} * V_{85} * (1/12)$$

Where:

- $V_{ret}$  = storm water retention volume (ft<sup>3</sup>);
- $A_{imp}$  = impervious drainage area or impervious area to be kept clear of snow (ft<sup>2</sup>); and
- $V_{85}$  = runoff volume from the 85<sup>th</sup> percentile, 24-hour design storm (in)

### RUNOFF REDUCTION CREDIT REQUIREMENTS

- Downspouts and any extensions must extend at least six feet from a basement and two feet from a crawl space or concrete slab.
- The area of rooftop connecting to each disconnected downspout must be 600 square feet or less.
- Roof runoff from the design storm must be fully contained in a landscaped area.
- The impervious area discharging to an impervious disconnection area must be 5,000 square feet or less.
- The maximum contributing impervious flow path length for impervious area disconnection must be less than 75 feet or, if equal or greater than 75 feet, a storage device (e.g. French drain, bioretention area, gravel trench) is required to achieve the required disconnection length.
- The snow storage footprint should be a minimum of 20 percent of the plowed area.
- Credit for rooftop and impervious area disconnection, and snow storage cannot be obtained if stream setbacks and buffers or vegetated swales are being used for credits in the same drainage management area.

### REFERENCES

Low Impact Development Center, Inc. 2010. Low Impact Development Manual for Southern California: Technical Guidance and Site Planning Strategies. Available online at: <https://www.casqa.org/resources/lid/socal-lid-manual>

Sacramento County, et al. 2014. Storm Water Quality Design Manual for the Sacramento Region. Available online at: <http://www.beriverfriendly.net/newdevelopment/stormwaterqualitydesignmanual/>

Tahoe Regional Planning Agency. 2012. Best Management Practices Handbook. Available online at: <http://tahoebmp.org/bmphandbook.aspx>

# POROUS PAVEMENTS

## Fact Sheet SDM-5

Also known as: Pervious pavement and permeable pavement.

### DESCRIPTION

Porous Pavement is a system comprised of a load-bearing, durable surface coupled with an underlying drainage layer that temporarily stores water prior to infiltration or drainage to a controlled outlet. The surface can be porous such that water infiltrates across the entire surface of the material, or it can be constructed of impermeable blocks separated by spaces and joints, through which the water can drain. There are many types of porous pavement including pervious concrete and asphalt, modular block, reinforced grass, cobblestone block, and gravel.



Pervious Concrete road in North Lake Tahoe, Placer County. Source: CDM Smith

Porous pavement is well-suited for low traffic roadways, parking lots, walking paths, sidewalks, playgrounds, plazas, tennis courts, and other similar uses. It has been widely applied in retrofit situations where existing standard pavements are replaced. Porous pavements should not be used in industrial and commercial applications where pavement areas are used for material storage or the potential for surface clogging is increased due to high traffic of construction vehicles.

### ADVANTAGES

- Reduces peak flow rates and total runoff volumes.
- Significant flow attenuation and improvement in water quality.
- Can replace existing pavements eliminating the need for additional land.
- Roof runoff can be piped into the subsurface storage area directly, which would increase the level of flow attenuation.
- Sometimes more attractive than traditional pavement.
- Reduces size of downstream BMPs.

### LIMITATIONS

- Can become clogged if improperly installed or maintained and may require replacement.
- Use should be limited level areas such as parking lots and other lightly trafficked or non-trafficked areas.
- Not suitable for areas of slope instability where infiltrated storm water may cause failure.
- Not suitable in locations that can negatively impact building foundation or footings.
- Not suitable for sites with high concentrations of oil & grease or potential spills.
- Not suitable in industrial and commercial applications where pavement areas are used for material storage or high traffic of construction vehicles.
- High groundwater may slow infiltration, create standing water in the subsurface storage layers and destabilize pavement and/or result in seepage to the surface.


# POROUS PAVEMENTS

## Fact Sheet SDM-5

### KEY DESIGN FEATURES

There are several types of porous pavement available, including pervious concrete, pervious asphalt, modular block, reinforced grass, cobblestone block, and gravel. The applicability of each porous pavement type should be carefully evaluated based on land uses and site characteristics. For detailed information and design guidance on all porous pavement types, refer to the [Storm Water Quality Design Manual for the Sacramento Region](#). General siting and design recommendations for all porous pavement are as follows:

- Consult a geotechnical engineer to determine what types of porous pavement are suitable for the expected traffic load, speed, and volume.
- Consult a geotechnical engineer to determine set back from building, or use 10 feet.
- Determine site soil type and permeability before selecting porous pavement as a runoff reduction strategy.
- Porous pavements are generally not suitable for sloped areas. Low points should be carefully evaluated and underdrains must be placed appropriately to avoid flooding.
- May be used over soils with low permeability in selected situations if underdrain is provided.
- Underdrains should tie into an open landscape area or treatment control measure to quickly relieve the water pressure in the pavement section and prolong the pavement life.
- Access ports should be provided for underdrain systems to allow for routine inspection and cleaning.
- Address seasonal shrink/swell in sites with expansive subgrade. Use the expansion index test (ASTM D4828) to provide insight as to degree of surface deformation in choosing paving sections.
- Consider opportunities for directing runoff from impervious surfaces across porous pavement to achieve runoff volume reduction credits. See the Rooftop and Impervious Area Disconnection Fact Sheet included in this manual.
- Select the porous pavement type based on the type of anticipated pedestrian traffic; most types of porous pavement can be designed to be Americans with Disabilities Act (ADA) compliant.
- A water barrier or interceptor drain will be required where porous material abuts regular asphalt/concrete pavement and there is concern about water infiltrating the regular pavement sub-base. The water barrier should run down the 12-inch deep excavation and 12 inches under the drain rock.
- For manufactured products, check the manufacturer's specifications for any additional siting considerations.

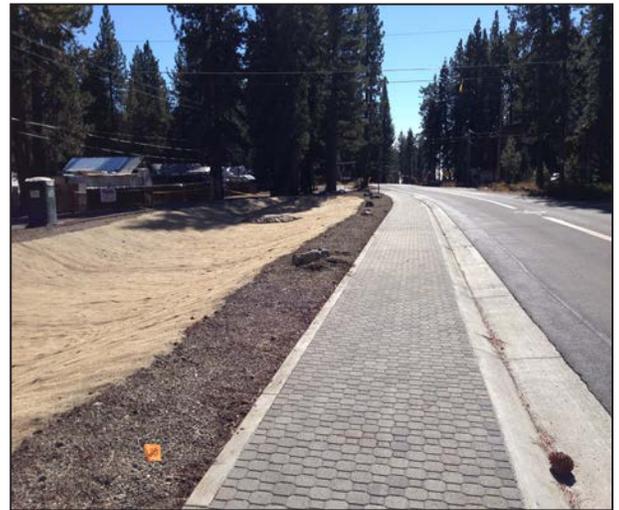

Pervious paver sidewalk. Source: CDM Smith

### SIZING DESIGN GOALS AND REQUIREMENTS

The Post-Construction Storm Water Quality Plan (SWQP) Form 3-4 should be used to calculate the retention volume ( $V_{ret}$ ) for porous pavement areas. This value is then used to calculate the area of impervious surface treated, and determine if other site design measures are necessary to capture the 85<sup>th</sup> percentile, 24-hour design storm for Regulated Projects. The equation for determining  $V_{ret}$  is as follows:

$$V_{ret} = A_{res} * D_{res} * n_{agg} * C$$

Where:

- $V_{ret}$  = storm water retention volume (ft<sup>3</sup>);
- $A_{res}$  = area of permeable storage reservoir (ft<sup>2</sup>);
- $D_{res}$  = depth of permeable storage reservoir (ft);
- $n_{agg}$  = porosity of aggregate; and
- $C$  = efficiency factor

# POROUS PAVEMENTS

---

## Fact Sheet SDM-5

Efficiency factors for different types of porous pavements are provided in Table 1 below.

**Table 1. Porous Pavement Efficiency factors**

Pervious Concrete or Asphalt (15% void space)	0.60
Modular Block Pavement (20% void space)	0.75
Reinforced Grass Pavement	1.00
Cobblestone Block Pavement (8% void space)	0.40

Source: Urban Drainage and Flood Control District, Denver, CO, Urban Storm Drainage Criteria Manual Volume 3 – Best Management Practices, September, 1999 (Rev. June, 2002)

## INSPECTION AND MAINTENANCE REQUIREMENTS

A maintenance plan shall be provided with the SWQP. The maintenance plan shall include recommended maintenance practices, state the parties responsible for maintenance and upkeep, specify the funding source for ongoing maintenance, and provide a site specific inspection checklist. At a minimum, maintenance shall include the following:

- Post signs identifying porous pavement areas.
- Keep landscaped areas well-maintained and prevent soil from being transported onto the pavement.
- Clean the surface using vacuum sweeping machines.
- If routine cleaning does not restore infiltration rates, then reconstruction of part of the porous pavement may be required.
- For modular and cobblestone block, periodically add joint material (sand) to replace material that has been transported or removed.
- Monitor regularly to ensure that the paving surface drains properly after storms.
- Do not seal or repave with impermeable materials.
- Inspect the surface annually for deterioration.
- Reinforced grass requires mowing and periodic reseeding to fill in bare spots.
- Clean out underdrain systems at regular intervals.
- Inspect outlets annually and maintain as needed.

## REFERENCES

Low Impact Development Center, Inc. 2010. Low Impact Development Manual for Southern California: Technical Guidance and Site Planning Strategies. Available online at: <https://www.casqa.org/resources/lid/socal-lid-manual>

Santa Clara Valley Urban Runoff Pollution Prevention Program. 2012. Pervious Pavement, Storm water Control for Small Projects. Available online at: [http://scvurppp-w2k.com/pdfs/1213/BASMAA\\_Pervious\\_Paving\\_Fact\\_Sheet\\_082312\\_APPROVED\\_online\\_ver.pdf](http://scvurppp-w2k.com/pdfs/1213/BASMAA_Pervious_Paving_Fact_Sheet_082312_APPROVED_online_ver.pdf)

Urban Drainage and Flood Control District, Denver, CO, Urban Storm Drainage Criteria Manual Volume 3 – Best Management Practices, September, 1999 (Rev. June, 2002). <http://udfcd.org/criteria-manual>

# VEGETATED SWALE

## Fact Sheet SDM-6

Also known as: Bioretention Swale, Treatment Swale, and Grassed Swale

### DESCRIPTION

Vegetated swales are essentially bioretention cells that are configured as linear channels, but are typically not designed with an engineered soil matrix and underlying gravel layer below the vegetation layer to accommodate additional treatment, storage, and infiltration. They function as a soil and plant-based filtration and infiltration feature that removes pollutants through a variety of natural physical, biological, and chemical treatment processes. Vegetated swales are open, shallow channels with vegetation covering the side slopes and bottom that collect and slowly convey storm water runoff to downstream discharge points. They are designed to treat runoff through vegetation filtration, biological uptake, evapotranspiration, and/or infiltration into the underlying soils. They trap particulate pollutants (suspended solids and trace metals), promote infiltration, and reduce the flow velocity of storm water runoff.



Grassed swale. Photo Source: CDM Smith

Vegetated swales can serve as part of a storm water drainage system and can replace curbs, gutters and storm sewer systems. They are best suited to capture runoff from small impervious areas and should not be implemented in areas with highly contaminated runoff. They can be used as part of treatment train approach and are effective at providing pretreatment for other BMPs.

### ADVANTAGES

- Reduces peak flow rates and total runoff volumes.
- Provides effective pretreatment for downstream BMPs by trapping, filtering, and infiltrating particulates and associated pollutants.
- Can serve as a cost-effective alternative to traditional curb and gutter.
- Can be integrated into landscape design to improve aesthetic appeal.

### LIMITATIONS


- Can be difficult to avoid channelization, which may cause erosion and limit infiltration potential.
- Not suitable for steep slopes.
- May not be appropriate for industrial sites or locations where spills may occur.
- Best suited for small drainage areas with low flow rates.
- A thick vegetative cover is needed for these features to function properly.

### KEY DESIGN FEATURES

In order to receive runoff volume reduction credits, vegetated swales must be designed in accordance with Treatment Control BMP 30 (TC-30) from the California Storm water BMP Handbook, New Development and Redevelopment. Key design elements are summarized below:

# VEGETATED SWALE

## Fact Sheet SDM-6

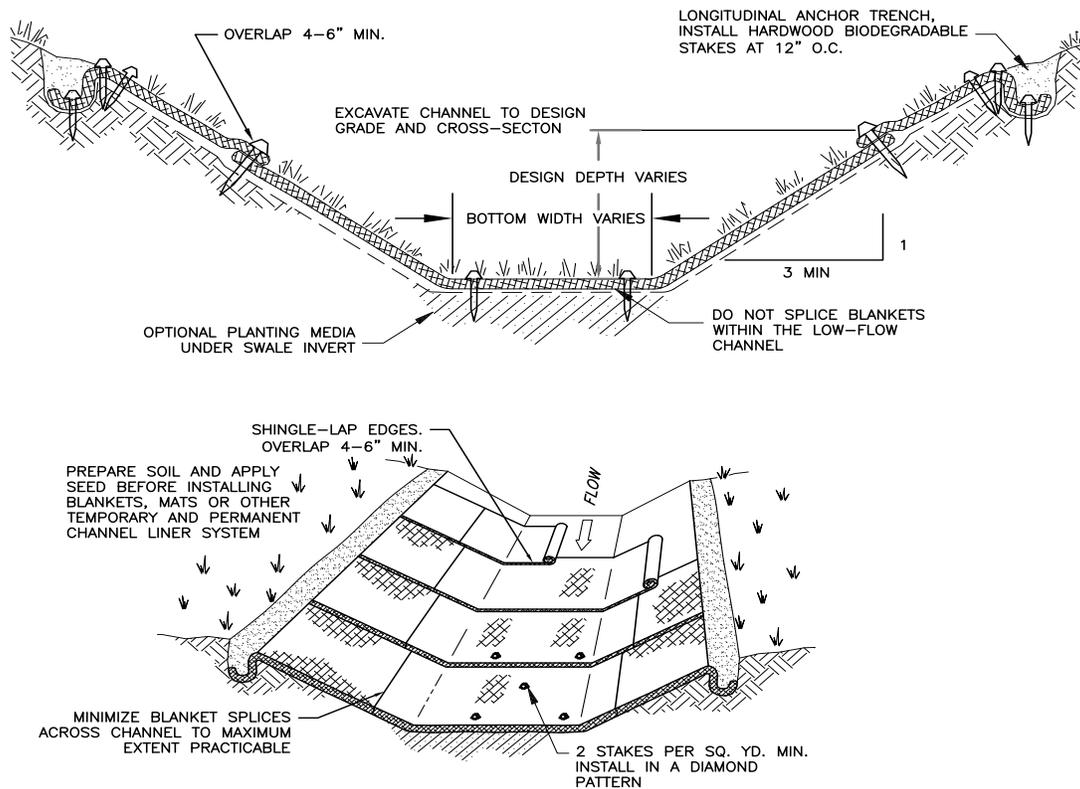

VEGETATED SWALE TYPICAL INSTALLATION

- Maximum flow velocity from the design storm event shall not exceed 1.0 foot per second.
- Vegetated swales should be designed so that the water level does not exceed 2/3rds the height of the grass or 4 inches, whichever is less, at the design treatment rate.
- Longitudinal slopes between 0.5% and 2.5% are recommended.
- Provide sufficient length to achieve a desired treatment contact time of 10 minutes. Regardless of contact time, the swale should not be less than 100 feet in length.
- Implement check dams for longitudinal slopes > 2.5% as a means to reduce slopes and promote infiltration. Space as required to maintain maximum longitudinal bottom slope < 2.5%.
- Implement entrance/outlet energy dissipation measures to limit erosion and promote retention.
- Do not compact soils beneath vegetated swales.
- Trapezoidal channels are normally recommended but other configurations, such as parabolic, can also provide substantial water quality improvement and may be easier to mow than designs with sharp breaks in slope.
- Swales constructed in cut are preferred, or in fill areas that are far enough from an adjacent slope to minimize the potential for gopher damage. Do not use side slopes constructed of fill, which are prone to structural damage by gophers and other burrowing animals.
- A diverse selection of low growing, plants that thrive under the specific site, climatic, and watering conditions should be specified. Vegetation whose growing season corresponds to the wet season are preferred. Drought tolerant vegetation should be considered especially for swales that are not part of a regularly irrigated landscaped area.
- The width of the swale should be determined using Manning's Equation, at the peak of the design storm, and a

# VEGETATED SWALE

## Fact Sheet SDM-6

value of 0.25 for Manning's n.

- If flow is to be introduced through curb cuts, place pavement slightly above the elevation of the vegetated areas. Curb cuts should be at least 12 inches wide to prevent clogging.
- Swales must be vegetated in order to provide adequate treatment and reduction of runoff. It is important to maximize water contact with vegetation and the soil surface. For general purposes, select fine, close-growing, water-resistant grasses. Refer to the Placer County Landscape Design Guidelines for more information.
- If possible, divert runoff (other than necessary irrigation) during the period of vegetation establishment. Where runoff diversion is not possible, cover graded and seeded areas with suitable erosion control materials. Diverted runoff must be managed and retained onsite to avoid violation of the Phase II MS4 Permit.
- Swales used as primary storm water conveyance facilities (i.e. without high flow bypass) must be designed according to requirements in the Placer County Storm water Management Manual. These swales will not qualify for volume reduction credits unless the design criteria specified above are also satisfied.

### SIZING DESIGN GOALS AND REQUIREMENTS

The Post-Construction Storm Water Quality Plan (SWQP) Form 3-4 should be used to calculate the retention volume ( $V_{ret}$ ) associated with vegetated swales. This value is then used to calculate the area of impervious surface treated, and determine if other site design measures are necessary to capture the 85<sup>th</sup> percentile, 24-hour design storm for Regulated Projects. The equation for determining  $V_{ret}$  is as follows:

$$V_{ret} = A_{imp} * V_{85} * (1/12)$$

Where:

- $V_{ret}$  = storm water retention volume (ft<sup>3</sup>);
- $A_{imp}$  = impervious area draining to vegetated swale (ft<sup>2</sup>); and
- $V_{85}$  = Runoff volume from 85<sup>th</sup> percentile, 24-hour design storm (in)

### RUNOFF REDUCTION CREDIT REQUIREMENTS

- Vegetated swales must be designed in accordance with Treatment Control BMP 30 (TC-30 - Vegetated Swale) from the California Storm water BMP Handbook, New Development and Redevelopment (available at [www.cabmphandbooks.com](http://www.cabmphandbooks.com)).
- The maximum flow velocity for runoff from the design storm event must be less than or equal to 1.0 foot per second.

### INSPECTION AND MAINTENANCE REQUIREMENTS

A maintenance plan shall be provided with the SWQP. The maintenance plan shall include recommended maintenance practices, state the parties responsible for maintenance and upkeep, specify the funding source for ongoing maintenance, and provide a site specific inspection checklist. At a minimum, maintenance shall include the following:

- Inspect on a semi-annual basis to assess slope integrity, soil moisture, vegetative health, soil stability, compaction, erosion, ponding, and sedimentation.
- Mow at least once per year, but do not cut grass shorter than the design flow depth because the effectiveness of the vegetation in reducing flow velocity and pollutant removal may be reduced. Grass cuttings should be removed from the swale and composted.
- Remove accumulated sediment when it is 3" deep or higher than the turf to minimize potential concentrated flows and sediment resuspension.
- Irrigate only as necessary to prevent vegetation from dying.

# VEGETATED SWALE

---

## Fact Sheet SDM-6

- Integrated pest management should be used for pest control. The designer should ideally select vegetation that does not require fertilizers.
- Reseed periodically to maintain dense turf.
- Remove trash or obstructions that cause standing water.
- Prevent off-street parking or other activities that can cause rutting or soil compaction.

## REFERENCES

California Department of Transportation (Caltrans). 2010. Treatment BMP Technology Report. CTSW-RT-09-239.06. Available online at: <http://www.dot.ca.gov/hq/env/stormwater/pdf/CTSW-RT-09-239-06.pdf>

California Storm water Quality Association (CASQA). 2003. California Storm Water BMP Handbook – New Development and Redevelopment. BMP Factsheet TC-30: Vegetated Swale. Available online at: <https://www.casqa.org/resources/bmp-handbooks/new-development-redevelopment-bmp-handbook>

County of San Diego. 2007. Low Impact Development Handbook. Available online at: <http://www.sandiegocounty.gov/content/sdc/dpw/watersheds/susmp/lid.html>

Placer County Planning Services Division. 2013. Placer County Landscape Design Guidelines. Available online at: <http://www.placer.ca.gov/departments/communitydevelopment/planning/documentlibrary/designguidelines>

# RAIN BARRELS AND CISTERNS

## Fact Sheet SDM-7


Also known as: Rainwater Harvesting, and Rainwater Collection

### DESCRIPTION

Rainwater harvesting is the practice of collecting, conveying, and storing rainfall for future indoor and outdoor use such as landscape irrigation, toilet flushing, and vehicle washing. The purpose of this harvesting is to collect high quality runoff to offset potable water demands while simultaneously reducing storm water runoff volumes. Rooftop runoff is the storm water most often harvested for use because it typically contains lower pollutant loads than surface runoff and provides accessible locations for collection. However, runoff from other clean impervious surfaces, such as driveways, walkways, and patios, may also be harvested effectively.

Rainwater harvesting typically utilizes rain barrels or cisterns:

- Rain barrels are small containers, typically ranging from 50 to 100 gallons installed adjacent to individual downspouts to capture rainwater runoff from roofs. Rain barrels are inexpensive, easy to install and maintain, and well suited to small-scale sites.
- Cisterns are typically much larger than rain barrels, ranging from 200 gallons for small installations to 10,000 gallons or more for large facilities. They can be installed above or below ground, or even on the roof, depending upon site conditions.

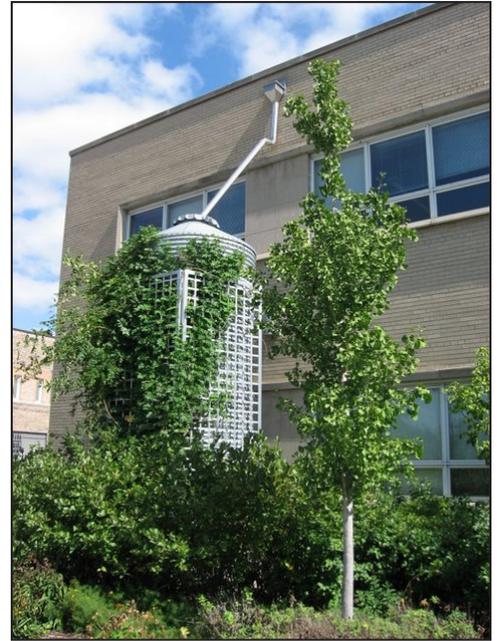

Source: EPA

The irrigation of harvested rainwater may utilize a simple gravity system for small systems or use pumps for larger systems. The pump and wet well should be automated with a rainfall sensor to provide irrigation only during periods when required infiltration rates can be realized.

### ADVANTAGES


- Applicable with limited space constraints and under all soil conditions.
- Reduces runoff volumes and peak flows while disconnecting impervious surfaces.
- Does not add additional pollutants to runoff.
- Cisterns can be combined with pervious parking areas.
- Helps reduce demand on municipal treated water supplies.
- Can be retrofitted into existing property.

### LIMITATIONS

- Rain barrels have limited storage capacity.
- Stored runoff must be used between storm events to maintain storage capacity.
- Does not provide water quality treatment.
- May require a system of pumps and valves to fill containers and reuse stored water.
- Irrigation systems may be expensive to operate and maintain.
- Inadequate maintenance can result in mosquito breeding and/or algae production.
- May require building permits. Contact the governing agency for requirements.
- Reuse of harvested rainwater may involve regulatory obstacles.
- May require screening or landscaping to improve aesthetics.

# RAIN BARRELS AND CISTERNS

## Fact Sheet SDM-7

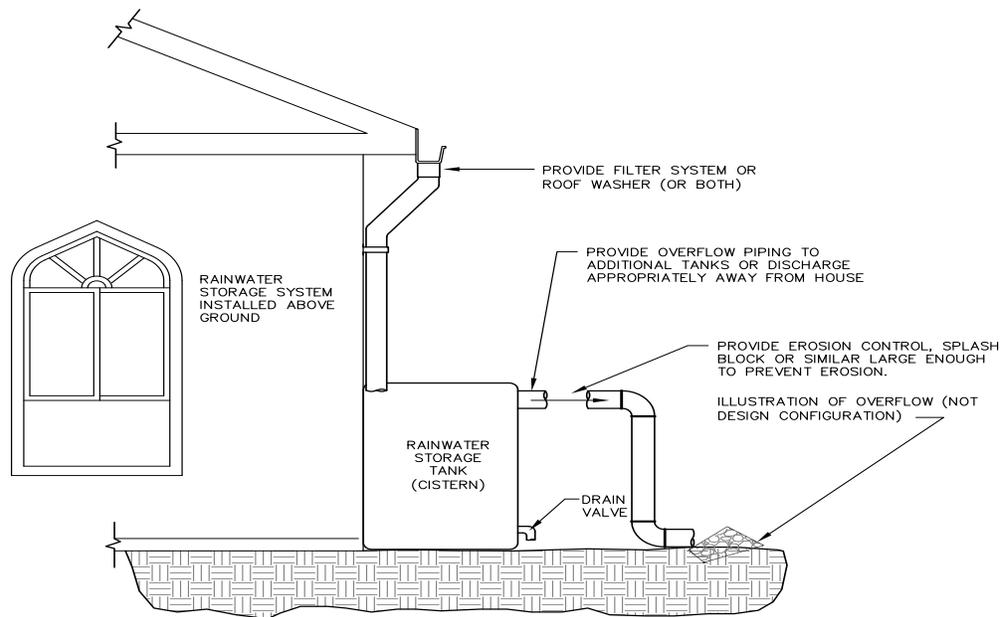

### NOTE:

1. REFER TO SWDS SECTION 3.4 TABLE 1 FOR SETBACKS OR PER PROJECT GEOTECHNICAL ENGINEER, WHICHEVER IS GREATER. TANKS LOCATED WITHIN 10 FEET OF THE STRUCTURE NEED TO BE RESTRAINED TO PREVENT DAMAGE IN THE EVENT OF AN EARTHQUAKE.
2. TANKS SHALL BE DESIGNED TO DRAIN IN 48 TO 72 HOURS OVER A LANDSCAPED AREA EQUAL TO ATLEAST 25% OF IMPERVIOUS TRIBUTARY AREA.

Source: City of Salinas

## KEY DESIGN FEATURES

- Site storage tanks underground, indoors, on roofs, or adjacent to buildings, outside of existing utility easement and County right-of-way.
- Make tanks water tight to avoid ponding or saturation of soils within 10' of building foundations.
- Locate rain barrels or above ground cisterns with gravity distribution systems up-gradient from irrigated areas.
- Locate underground cisterns in native, rather than fill soil for stability.
- Roof surfaces shall not include copper or materials treated with fungicides or herbicides.
- Roof gutters must be fully screened and installed at continuous grade.
- Containers must be opaque, water tight, vented, completely covered and screened.
- Pretreat runoff to remove debris, dust, leaves, and other debris. Use leaf and mosquito screens (1 mm mesh size), first-flush diverter, or in-tank filter.
- Use settling compartment for tanks over 2,500 gallons.
- Use a water pump for underground cisterns. Indoor systems usually require a pump, pressure tank, back-up water supply line and backflow preventer.
- Overflow device must be equal in size to the total of all inlets and must lead to an approved discharge location with approved air gap.
- Install safety labels (non-potable, vector hazard, drowning hazard icons).
- Refer to local ordinances for siting and size constraints.
- Both rain barrels and above-ground cisterns must be sited in a stable, flat area. Rain barrels and cisterns may not block the path of travel for fire safety access.

# RAIN BARRELS AND CISTERNS

## Fact Sheet SDM-7

- Overflow locations, which can include bioretention units, additional rain barrels or cisterns, or a discharge point to the storm drain system, must be designed to both direct outflow away from building foundations and prevent nuisance flows to adjacent properties.
- Tanks should be opaque and placed in a cool or shaded area to avoid algal growth.

### SIZING DESIGN GOALS AND REQUIREMENTS

The Post-Construction Storm Water Quality Plan (SWQP) Form 3-4 should be used to calculate the retention volume ( $V_{ret}$ ) associated with rain barrels and cisterns. This value is then used to calculate the area of impervious surface treated, and determine if other site design measures are necessary to capture the 85<sup>th</sup> percentile, 24-hour design storm for Regulated Projects. The equation for determining  $V_{ret}$  is as follows:

$$V_{ret} = N * V_a * 0.5$$

Where:

- $V_{ret}$  = storm water retention volume (ft<sup>3</sup>);
- $N$  = number of rain barrels and/or cisterns; and
- $V_a$  = average volume of rain barrels and/or cisterns (ft<sup>3</sup>)

### INSPECTION AND MAINTENANCE REQUIREMENTS

A maintenance plan shall be provided with the SWQP. The maintenance plan shall include recommended maintenance practices, state the parties responsible for maintenance and upkeep, specify the funding source for ongoing maintenance, and provide a site specific inspection checklist. Maintenance requirements for rainwater harvesting systems vary according to use. At a minimum, maintenance shall include the following:

- Perform regular inspections every six months during the spring and fall seasons for the following:
  - o Confirm that all the parts, pumps, and valves are operable and not leaking;
  - o Keep leaf screens, roof gutters, and downspouts free of leaves and other debris;
  - o Check screens and patch holes or gaps;
  - o Clean and maintain first flush diverters and filters, especially those on drip irrigation systems;
  - o Inspect and clean storage tank lids, paying special attention to vents and screens on inflow and outflow spigots; and
  - o Replace damaged system components as needed.
- Clean tanks annually with a non-toxic cleaner, such as vinegar and dispose of wash water in a sink, bathtub or sewer cleanout.
- Flush cisterns annually to remove sediment. For buried structures, vacuum removal of sediments is required.
- Test all backflow prevention assemblies for proper function annually.
- Regular use of the water stored in systems between rain events is critical to ensure that storage is available for the next storm event.



Photo Source: City of Portland

# RAIN BARRELS AND CISTERNS

---

## REFERENCES

California Storm water Quality Association (CASQA). 2003. California Storm Water BMP Handbook – New Development and Redevelopment. BMP Factsheet TC-12: Retention/Irrigation. Available online at: <https://www.casqa.org/sites/default/files/BMPHandbooks/>

Low Impact Development Center, Inc. 2010. Low Impact Development Manual for Southern California: Technical Guidance and Site Planning Strategies. Available online at: <https://www.casqa.org/resources/lid/socal-lid-manual>

San Francisco Public Utilities Commission, et al. 2010. San Francisco Storm Water Design Guidelines. Appendix A, Storm water BMP Fact Sheets. Available online at: <http://www.sfwater.org/Modules/ShowDocument.aspx?documentID=2779>

Santa Clara Valley Urban Runoff Pollution Prevention Program. 2012. Rain Barrels and Cisterns, Storm Water Control for Small Projects. Available online at: [http://www.scvurppp-w2k.com/pdfs/1213/BASMAA\\_Rain\\_Barrel\\_Fact\\_Sheet\\_082312\\_APPROVED\\_online\\_ver.pdf](http://www.scvurppp-w2k.com/pdfs/1213/BASMAA_Rain_Barrel_Fact_Sheet_082312_APPROVED_online_ver.pdf)

# SUBSURFACE INFILTRATION

## Fact Sheet SDM-8

Including: Dry Wells, Infiltration Trenches, and Infiltration Galleries

### OVERVIEW

Subsurface infiltration is an effective method for reducing storm water runoff volumes in cold weather climates where freezing temperatures and snow accumulations can limit the effectiveness of infiltration at the ground surface. Several types of subsurface infiltration facilities are described in this fact sheet including: dry wells, infiltration trenches, and infiltration galleries. Similar to surface infiltration structures, these facilities are designed to receive runoff, provide temporary storage, and allow percolation into the soils below. With proper design and construction, subsurface facilities reduce freezing of runoff, thereby facilitating winter-time infiltration. Storage can be provided in a variety of ways including vaults with weep holes or open bottoms, perforated piping, any number of commercially available products. Excavations are typically backfilled with a porous media, such as washed gravel, to further increase storage volumes. Subsurface infiltration facilities can be installed beneath parking lots, or other structures, to save space but require careful siting and design by an appropriately licensed and qualified professional. Designers must consider and evaluate many factors such as soil type, groundwater, nearby structures and utilities, and other site characteristics to determine whether subsurface infiltration is feasible and safe.

### DRY WELLS

A dry well, or Class V Injection Well, is generally defined as an excavation that is deeper than it is wide, and is designed to convey non-hazardous storm water runoff to the subsurface and groundwater. Dry wells can be installed to penetrate through clay, or other low-permeability soil layers, to bring the runoff into contact with more permeable underlying soils for increased infiltration. Dry wells can reduce surface runoff and flooding, recharge groundwater supplies and protect natural resources from the impacts of storm water runoff. They can be scaled to treat a wide range of flow rates and their small footprint allows for installation in space constrained locations. A schematic of a typical dry well design is provided in Figure 1.



Slotted drain discharging to dry well  
Photo Source: Placer County Low Impact Development Guidebook

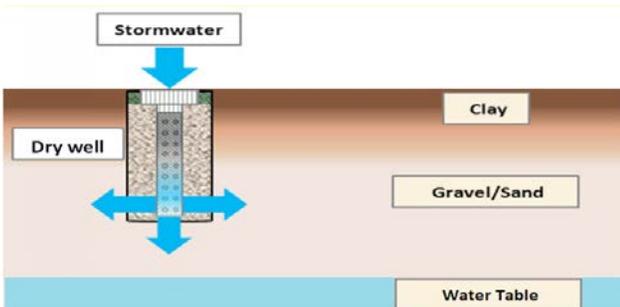


Figure 1. Typical Dry Well Schematic  
Source: California Environmental Protection Agency, 2014

Due to their increased infiltration capacity, dry wells also have potential to contaminate groundwater if pollutants are allowed to enter them. For this reason, dry wells should never be installed in areas when there is potential for hazardous materials spills such as gas stations or some industrial sites. Additionally, the maximum depth of a dry well should be a minimum of 10 feet above the seasonal high groundwater elevation. To prevent clogging and reduce the spread of pollutants, storm water runoff should also be pre-treated to remove sediment prior to entering a dry well.

### REGULATORY INFORMATION

Dry wells receiving runoff from anything other than single-family homes must comply with the U.S. Environmental Protection Agency Underground Injection Control (UIC) regulations available at: <https://www.epa.gov/uic/federal-requirements-class-v-wells>.

In California, Regional Water Quality Control Boards have the discretion to issue waste discharge requirements for dry wells to protect the beneficial uses of the local groundwater resources.

County or City environmental management departments should be consulted for additional permitting requirements prior to installing any dry well.

# SUBSURFACE INFILTRATION

## Fact Sheet SDM-8

### INFILTRATION TRENCHES

Infiltration trenches are open-bottomed linear facilities that are often installed along roof driplines, or the edges of driveways, roadways, and parking lots. Their geometry promotes runoff entering via sheetflow but drain inlets and piping can also be used. Perforated piping and gravel typically provides temporary storage until the runoff can infiltrate into the soils below. To prevent clogging and reduce the spread of pollutants, storm water runoff should be appropriately pre-treated prior to entering an infiltration trench.

Infiltration trenches can be scaled to manage a large range of runoff rates and volumes to match project requirements, but their locations and sizes should be determined by an appropriately qualified and licensed professional.

Examples of large and small scale infiltration trenches are shown in the photos to the right. A schematic of a typical infiltration trench is provided in Figure 2.

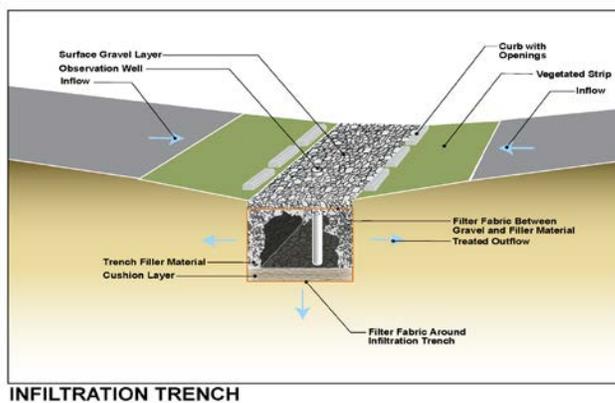


Figure 2. Typical Infiltration Trench Schematic  
Source: Caltrans, 2010

### INFILTRATION GALLERIES

Infiltration galleries typically consist of a larger scale underground structures that can include multiple rows of perforated piping, or other proprietary products to provide high storage volumes. Their design and function is similar to infiltration trenches, except infiltration galleries usually have a larger footprint and therefore greater infiltration capabilities. With proper design, infiltration galleries can be installed under impervious surfaces or near outfall locations at sites where space is limited and large volume reduction is needed. They are best suited to receive storm water discharges from larger catchments such as large driveways, roadways, parking lots, or buildings.

A schematic of a typical infiltration gallery is provided in Figure 3.



Larger scale infiltration trench sized to receive roadway runoff  
Photo: City of South Lake Tahoe, CA



An infiltration trench follows the topography to carry roof runoff safely away from the building on a multifamily residential site.  
Photo: TRCA, 2010



Large infiltration gallery consisting of perforated pipe embedded in gravel.  
Photo Source: City of South Lake Tahoe, CA

# SUBSURFACE INFILTRATION

## Fact Sheet SDM-8

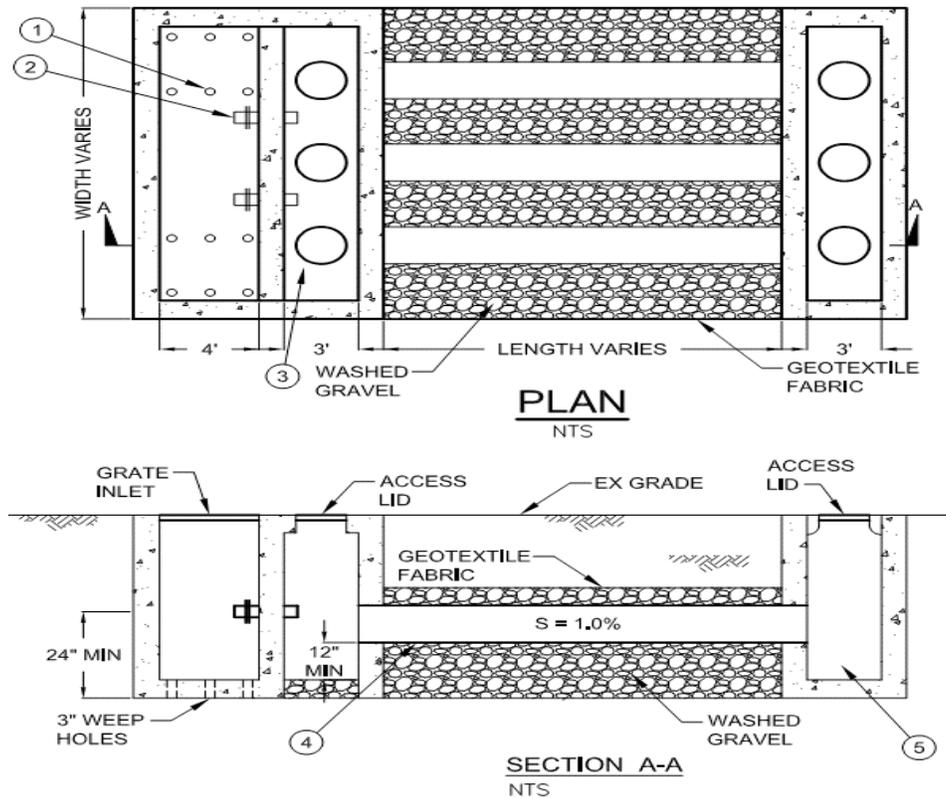


Figure 3. Typical Infiltration Gallery Schematic  
Source: CDM Smith

### NOTES:

1. SEDIMENTATION CHAMBER WITH OPTIONAL GRATED INLET AND 3" WEEP HOLES TO DRAIN STANDING WATER.
2. INLET PIPE WITH ORIFICE SIZED TO CONVEY PEAK FLOW RATE FROM DESIGN STORM. 6" MIN PIPE SIZE.
3. INLET CHAMBER WITH ACCESS LIDS AND GRAVEL BOTTOM.
4. PERFORATED PIPE (12" MIN) ENCASED IN WASHED GRAVEL BED. PIPE SLOPED TO INLET CHAMBER.
5. MAINTENANCE CHAMBER WITH ACCESS LIDS.

### ADVANTAGES

- Reduces peak flow rates and total runoff volumes.
- Reduces the impacts of freezing on infiltration.
- Reduces the impacts of stored snow within the infiltration facility.
- Designs are adaptable to fit in space constrained locations, along margins, perimeters, and in unused sections of developed sites, under roof eaves, or under impervious surfaces.
- Reduces the size of downstream BMPs.
- Reduces localized flooding or ponding problems.
- Recharges groundwater supplies

### LIMITATIONS

- Adjacent buildings and overflow requirements need to be considered in design.
- Requires permeable soils.

# SUBSURFACE INFILTRATION

---

## Fact Sheet SDM-8

- The excavation floor of infiltration trenches and galleries must be level to maximize the infiltrating surface area. The longitudinal slope of the infiltration trench should not exceed 3 percent.
- Appropriate pretreatment is needed to reduce the spread of pollutants to groundwater and/or prevent clogging.
- Complete reconstruction may be required if the system fails due to clogging.

### KEY DESIGN FEATURES

- Soil infiltration rates and the groundwater table depth must be evaluated to ensure that conditions are satisfactory for proper operation of subsurface infiltration systems.
- Appropriate soil conditions must be demonstrated through infiltration testing, soil logs, and the written opinion of a licensed civil engineer.
- Appropriate infiltration rates of existing site soils are 0.5 in/hr minimum and 2.4 in/hr maximum.
- Subsurface infiltration systems should be sited at least 20 ft. away from building foundations.
- An average 10 ft. separation, and minimum 5 ft., is required between the bottom of the infiltration facility and groundwater.
- Infiltration trenches installed on slopes greater than 3 percent require baffles, headers, or terraces to provide a level bottom for uniform infiltration.
- Water barriers such as geomembrane or clay liners may be required when siting adjacent to utilities or structures.
- Filter fabric should be installed around the sides of subsurface infiltration systems to prevent soil intrusion into the crushed rock or gravel layer. Do not install fabric over the floor of the infiltration facility.
- Overflow and/or high flow bypass systems must be incorporated into the design of all subsurface infiltration systems.
- Pretreatment is highly recommended to prevent the spread of pollution and prolong operational life. Pretreatment may consist of sediment traps, vegetated swales, vegetated filter strips, and/or bioretention depending on site characteristics and sediment loading rates.
- Crushed rock or gravel media should be thoroughly washed prior to installation to remove fines that may result in clogging and failure.
- Perforated pipe may be installed within the gravel storage layers to provide extra void space and convey runoff horizontally and/or vertically.
- For highly compacted or low permeability soil conditions, soils underlying infiltration trenches or galleries may be over-excavated, amended by mixing in 15 to 30 percent coarse sand, and replaced uniformly without compaction.
- Maintenance cleanouts and inspection ports should be provided.
- Perforated pipe used in subsurface infiltration should have a minimum diameter of 6 inches for infiltration trenches and 12 inches for infiltration galleries. Pipe perforation patterns should conform to applicable AASHTO specifications.

### SIZING DESIGN GOALS AND REQUIREMENTS

The Post-Construction Storm Water Quality Plan (SWQP) template should be used to calculate the retention volume ( $V_{ret}$ ) associated with subsurface infiltration. For Regulated Projects, the template uses the retention volume to calculate the area of impervious surface treated, and determine if additional control are necessary to capture the 85th percentile, 24-hour design storm. The equation for determining  $V_{ret}$  is as follows:

# SUBSURFACE INFILTRATION

---

## Fact Sheet SDM-8

$$V_{\text{ret}} = V_{\text{total}} * 0.5$$

Where:

$V_{\text{ret}}$  = storm water retention volume (ft<sup>3</sup>); and

$V_{\text{total}}$  = total volume of subsurface infiltration facility (ft<sup>3</sup>).

## REFERENCES

- California Department of Transportation (Caltrans). 2010. Treatment BMP Technology Report. CTSW-RT-09-239.06. Available online at: [http://www.dot.ca.gov/hq/env/storm\\_water/pdf/CTSW-RT-09-239-06.pdf](http://www.dot.ca.gov/hq/env/storm_water/pdf/CTSW-RT-09-239-06.pdf)
- Placer County. March 2012. Low Impact Development (LID) Guidebook. Available online at: <https://www.placer.ca.gov/departments/communitydevelopment/planning/tahoeplanning/lidguidelines>.
- Tahoe Regional Planning Agency. 2012. Best Management Practices Handbook. Available online at: <http://tahoebmp.org/bmphandbook.aspx>.
- Credit Valley Conservation and Toronto and Region Conservation (TRCA). 2010. Low Impact Development Storm water Management Planning and Design Guide. Fact Sheet: Soakaways.
- City of Elk Grove, in collaboration with Cal/EPA Ecotoxicology Program, Pesticide & Environmental Toxicology Branch, Office of Environmental Health Hazard Assessment. 2014. Dry Wells: Uses, Regulations, and Guidelines in California and Elsewhere. Available online at: [http://www.waterboards.ca.gov/board\\_reference/2014fall/docs/dry\\_wells\\_fs.pdf](http://www.waterboards.ca.gov/board_reference/2014fall/docs/dry_wells_fs.pdf)

# BIORETENTION

## Fact Sheet TR-1

Bioretention facilities, also known as rain gardens and storm water planters, are planted depressions that slow, treat, and infiltrate storm water to improve water quality and manage hydromodification. They can be located in a variety of settings such as along roadsides or incorporated into a site's landscaping but should be designed by a qualified professional. Bioretention cells receive runoff from roofs and other impervious surfaces and provide treatment through settling, filtration, and biological processes as storm water ponds and percolates through planting soil media and into a subsurface gravel storage bed. Runoff volume is reduced by evapotranspiration and, if conditions are suitable, by infiltration into the underlying soils and groundwater. Bioretention facilities are effective at removing a variety of pollutants including trash, sediment, metals, nutrients, bacteria and hydrocarbons. Bioretention areas are usually designed to allow shallow ponding, with an overflow outlet to prevent flooding during heavy storms. The overflow can be directed to a storm drain system or to another BMP.

Two general types of bioretention facilities are allowable in the Permit including infiltrating bioretention and flow-through planters. Flow-through planters are used in locations not suitable for infiltration and include impermeable liners and an underdrain pipe to collect the treated water and discharge it to the municipal storm drain or other appropriate location.



Roadside bioretention. Source: sitephocus.com

### ADVANTAGES

- Protects and improves water quality by removing pollutants from storm water runoff.
- Reduces surface runoff volumes and attenuates peak flows.
- Wide range of scales and site applicability.
- Attractive and relatively easy and inexpensive to install and maintain.
- Improves air quality and reduces heat island effects.
- Increases groundwater recharge.
- Creates habitat and increases biodiversity.

### LIMITATIONS

- Infiltration of storm water can negatively impact structural foundations and increase other geological hazards. Locations shall be approved by a licensed Geotechnical Engineer.
- High groundwater can slow infiltration rates or even seep into bioretention cells and discharge as surface water. An average 10 ft. separation, and a minimum of 5 ft., between the bottom of the BMP and groundwater is recommended.
- Contaminants in soil and groundwater can be mobilized by infiltrating water.
- Existing infrastructure such as underground utilities and drainage infrastructure may constrain bioretention design.
- Vegetation requires maintenance and can look overgrown or weedy; seasonally it may appear dead.

### KEY DESIGN FEATURES

The design of bioretention facilities involves many considerations and planning activities should be started at the earliest possible stage of a projects. It is critical that the facilities achieve the required performance standards

# BIORETENTION

## Fact Sheet TR-1

while also protecting public health and safety, infrastructure and property. Bioretention design should begin during the site assessment and layout phase when determining building and parking locations and footprints and before the site grading plan is prepared. For infiltration type planters, consult a licensed geotechnical engineer about site suitability.

The key design features and considerations for bioretention facilities include the following:

1. **Topography:** In appropriate conditions and with careful design, bioretention facilities can be located on slopes by incorporating check dams, terracing, or other methods to pond the water. Infiltration on slopes can create, or increase, the potential for downgradient seepage, landslides, and other geotechnical hazards. Infiltration is generally not recommended on slopes exceeding 10 percent.
2. **Adjacent structures:** Where bioretention facilities are located next to structures such as curb and gutter, sidewalks, buildings, additional structural support may be required between the adjacent road or parking surface and bioretention soil media. Vertical cutoff walls or impervious liners should be considered to keep storm water from migrating into structural fill or road base materials. In expansive (C, D) soils, locate storm water planters far enough from structures to avoid damage to foundations (as determined by a structural or geotechnical engineer). 10 feet is a typical rule-of-thumb.  
  
Subsurface utilities should not be located within the bioretention facility and utility trenches should be isolated from the infiltrating areas to prevent the formation of preferential flow paths along trenches, migration of backfill materials, and flooding of utility vaults.
3. **Inlet design:** Inlets can include a variety of structures and configurations including curb cuts, open channels, and pipes. The design must provide the width and geometry needed to direct flows into the facility and its elevation must provide adequate hydraulic head for filtration and storage volume. To prevent storm water runoff from eroding the soil surface as it enters the facility, a concrete splash pad or rock energy dissipater (3"-5" -size rounded rock, 6" depth) should be placed at the inlets.
4. **Overflow:** Provisions to bypass flows that exceed the design ponding depth must be included in bioretention designs. Overflow systems should be located near the entrance of the bioretention facility to prevent scouring of the system and mobilization of the mulch layer. Overflow provisions shall not impact structures. Overflow structures may consist of a raised overflow structure connected via pipe to an approved discharge point, or a surface conveyance route (e.g., curb cuts, open channel, or pipe). Overflow structures must be sized to convey peak flood flows, per Placer County SWMM requirements, and include provisions for clogging. Elevations must be set to provide storage of the required water quality volume.
5. **Surface ponding:** A minimum design depth of 6 inches is required for surface ponding to provide additional storm



LID vegetated swale parking lot. Shellito Indoor Pool, Roseville. Photo: Greg Bates

# BIORETENTION

---

## Fact Sheet TR-1

water storage capacity, with a maximum depth of 12 inches. Ensure that the design does not allow ponding to persist for longer than 72 hours for vector control.

6. Aggregate layer: A minimum 12-inch thick layer of  $\frac{3}{4}$ -inch washed aggregate below the planting media increases the facility's water storage capacity and promotes positive drainage through the underdrain system. A 3-inch layer of smaller aggregate (washed pea gravel) between the planting media and  $\frac{3}{4}$ -inch aggregate layer can omit the need for filter fabric, which is known to cause clogging.
7. Bioretention soil media: A minimum 18-inch thick mixture of 60-70 percent sand meeting the specifications of the American Society for Testing and Materials (ASTM) C33 and 30-40 percent compost may be used to provide filtration of runoff while supporting healthy plant growth. It may be possible in some cases to use native soil or to amend the native soil so that it is suitable. Use of native soil will depend on the evaluation of the criteria in "Section 3 - Site Assessment" as well as consideration of structural needs and may require evaluation by a licensed Geotechnical Engineer.
8. Mulch: If the area will be mulched, initial excavation depth must anticipate the total combined media depth, to avoid having to reduce soil depth during construction to accommodate mulch at final grades. If mulch is used as a top dressing avoid wood chips or other material that will float and potentially clog overflow structures. Mulch should not be installed just before or during the rainy season.
9. Underdrain: An underdrain system should be included with the discharge elevation at the top of the aggregate layer to convey runoff not infiltrated into the native soil to the storm water system or other appropriate discharge point. The underdrain may be eliminated in areas of high groundwater, rapidly infiltrating soils or where connection of the underdrain to a surface discharge point or to a subsurface storm drain are infeasible. The perforations in the underdrain must be directed down or else water flowing through the planting media into the gravel layer will immediately be collected and discharged through the underdrain. Maintenance access and cleanout ports should be provided so that underdrain system can be routinely inspected and cleaned as needed.
10. Liners: Facilities with documented high concentrations of pollutants in underlying soil or groundwater, facilities located where infiltration could contribute to a geotechnical hazard, and facilities located on elevated plazas or other structures may incorporate an impervious liner and may locate the underdrain discharge at the bottom of the subsurface aggregate layer.
11. Plants: A list of recommended plant species recommended is provided in the table below. Use a variety of trees, shrubs and herbaceous plant materials. Native grass meadows are especially effective at controlling and treating storm water over a large area. Choose moisture-tolerant plants for the bottom of a bioretention swale or basin. Choose plants that can tolerate both fluctuating water conditions and drought conditions for the side edges. Guidance on planting and general landscape design is provided in the Placer County Landscape Design Guidelines (Placer County Planning Services Division, 2013).
12. Pre-treatment: Runoff from industrial sites or locations where spills may occur or areas with excessive erosion or sediment sources should be pre-treated to address pollutants of concern prior to discharging into bioretention systems.
13. Underlying soils: Soils beneath the facility must be protected from compaction during construction activities. If soils have been compacted previously they should be ripped as deeply as necessary to loosen the soils and re-establish natural infiltration rates.

# BIORETENTION

## Fact Sheet TR-1

Plant Selection Guidance for Low Impact Development Features in the Placer County Sierra Nevada								
PLANTS <sup>1</sup>		Common Name	Optimal Site Conditions Habitat/water requirements, sun, shade, part shade, special notes	Drought & Inundation Tolerance <sup>2</sup>			Defensible Space Considerations <sup>3</sup>	Origin
Scientific Name	Common Name			Tolerant of both Wet and Dry Periods	Better with Supplemental Irrigation	Requires Supplemental Irrigation		
<i>Acer circinatum</i>	Vine Maple	wet to moderately wet, shade to part sun, accent, California native	●	●	●	●	Adapted Non-Native	
<i>Acer ginnala</i>	Amur Maple	moderately wet, sun to part shade	●	●	●	Unknown	●	
<i>Acer glabrum</i>	Rocky Mountain Maple	wet to moderately wet, part shade	●	●	○	Unknown	●	
<i>Alnus tenuifolia</i>	Mountain Alder	wet, sun to part shade	●	●	○	●	●	
<i>Amelanchier alnifolia</i>	Western Serviceberry	moderately wet to dry, sun to part shade	●	●	○	Unknown	●	
<i>Arctostaphylos patula</i>	Greenleaf Manzanita	dry, sun, rarely available	●	○	○	●	●	
<i>Artemisia tridentata</i>	Sagebrush	dry, sun	○	○	○	●	●	
<i>Betula occidentalis</i>	Western River Birch	wet to moderately wet, sun to part shade	●	●	●	●	●	
<i>Ceanothus cordulatus</i>	Mountain Whitethorn	moderately wet to dry, pale yellow sun to part shade	○	○	○	●	●	
<i>Chrysolepis sempervirens</i>	Chinquapin	moderately wet to dry, sun	○	○	○	●	●	
<i>Chrysothamnus nauseosus</i>	Rabbitbrush	dry, sun	○	○	○	●	●	
<i>Cornus sericea</i>	Redstem Dogwood	wet to moderately wet, sun to part shade	●	●	●	○	●	
<i>Holodiscus discolor</i>	Creambush	moderately wet to dry, white sun to part shade	●	●	○	Unknown	●	
<i>Lonicera involucrata</i>	Twinberry	wet to moderately wet, part shade	●	●	○	Unknown	●	
<i>Lonicera tatarica</i>	Tatarian Honeysuckle	wet to moderately wet, full sun to part shade, poisonous berries	●	●	●	Unknown	●	
<i>Physocarpus capitatus</i>	Ninebark	wet to moderately wet, sun to part shade	●	●	●	Unknown	●	
<i>Pinus mugo mugo</i>	Dwarf Mugo Pine	moderately wet to dry, sun to part shade	●	●	●	●	●	
<i>Potentilla fruticosa</i>	Shrubby Cinquefoil	wet to moderately wet, sun to part shade, many cultivars	●	●	●	Unknown	●	
<i>Prunus cistena</i>	Western Sandcherry	moderately wet, sun to part shade, unsuitable for upper elevation snow loads	●	●	●	●	●	

# BIORETENTION

## Fact Sheet TR-1

Plant Selection Guidance for Low Impact Development Features in the Placer County Sierra Nevada						
PLANTS <sup>1</sup>			Drought & Inundation Tolerance <sup>2</sup>		Defensible Space Considerations <sup>3</sup>	Origin
Scientific Name	Common Name	Optimal Site Conditions Habitat/water requirements, sun, shade, part shade, special notes	Tolerant of both Wet and Dry Periods	Better with Supplemental Irrigation	Requires Supplemental Irrigation	
<i>Prunus emarginata</i>	Bittercherry	moderately wet, sun to part shade	●	○	○	Adapted Non-Native
<i>Prunus virginiana</i> var. <i>demissa</i>	Western Chokecherry	moderately wet, sun to part shade	●	○	○	Native
<i>Purshia tridentata</i>	Bitterbrush	dry, sun	○	○	○	●
<i>Quercus vaccinifolia</i>	Huckleberry Oak	moderately wet to dry, sun	○	○	○	●
<i>Rhamnus rubra</i>	Sierra Coffeeberry	moderately wet to dry, sun	○	○	○	●
<i>Rhus trilobata</i>	Skunkbrush Sumac	moderately wet to dry, sun to part shade	○	○	○	●
<i>Ribes alpinum</i>	Alpine Currant	wet to moderately wet, sun to part shade	●	●	●	●
<i>Ribes aureum</i>	Golden Currant	moderately wet to dry, sun to part shade	●	●	●	●
<i>Ribes cereum</i>	Wax Currant	moderately wet to dry, sun	●	○	○	●
<i>Ribes nevadense</i>	Sierra Currant (Mountain Pink Currant)	wet to moderately wet, sun part shade	●	○	○	●
<i>Ribes roezlii</i>	Sierra Gooseberry	moderately wet to dry, sun to part shade	●	○	○	●
<i>Ribes viscosissimum</i>	Sticky Currant	moderately wet to dry, sun	●	○	○	●
<i>Rosa rubrifolia</i>	Redleaf Rose	moderately wet, sun to part shade	●	●	○	●
<i>Rosa rugosa</i>	Tomatoe Rose	moderately wet, sun to part shade, accent	●	●	○	●
<i>Rosa woodsii</i>	Wood's Rose	moderately wet, pink sun to part shade	●	○	○	●
<i>Salix exigua</i>	Narrow-leaved Willow	wet, sun to part shade, SEZ, invasive	●	●	○	●
<i>Salix beyeriana</i>	Geyer's Willow	wet, sun to part shade, SEZ	●	●	○	●
<i>Salix lemmonii</i>	Lemmon's Willow	wet, sun to part shade, SEZ	●	●	○	●
<i>Salix purpurea</i> 'nana'	Dwarf Arctic Willow	wet to moderately wet, sun to part shade	●	●	●	●
<i>Salix scouleriana</i>	Scouler's Willow	wet to moderately wet, sun to part shade	●	●	○	●
<i>Sambucus cerulea mexicana</i>	Blue Elderberry	wet to dry, sun to part shade	●	○	○	●
<i>Sambucus racemosa</i>	Red Elderberry	wet to moderately wet, sun to part shade	●	○	○	●
<i>Sorbus californica</i>	Mountain Ash	wet to moderately wet, part shade, rarely available	●	●	●	●

# BIORETENTION

## Fact Sheet TR-1

Plant Selection Guidance for Low Impact Development Features in the Placer County Sierra Nevada								
PLANTS <sup>1</sup>		Common Name	Optimal Site Conditions Habitat/water requirements, sun, shade, part shade, special notes	Drought & Inundation Tolerance <sup>2</sup>			Defensible Space Considerations <sup>3</sup>	Origin
Scientific Name	Common Name			Tolerant of both Wet and Dry Periods	Better with Supplemental Irrigation	Requires Supplemental Irrigation		
<i>Spiraea densiflora</i>	Mountain Spirea		wet to moderately wet, sun to part shade	●	○	○	Unknown	●
<i>Spiraea</i> spp.	Spiraea species - Snowmound, Goldflame, etc		wet to moderately wet, sun to part shade, many varieties	●	●	●	Unknown	●
<i>Symphoricarpos albus</i> var. <i>laevigat</i>	Snowberry		wet to moderately wet, sun to part shade	●	○	○	Unknown	●
<i>Syringa</i> spp	Lilac Hybrids		moderately wet, sun to part shade, accent, many cultivars	●	●	●	●	
<i>Syringa vulgaris</i>	Common Lilac		moderately wet, sun to part shade, accent	●	●	●	●	
<i>Viburnum</i> spp.	Viburnum species		moderately wet, sun to part shade, many species and cultivars	●	●	●	Unknown	●
<i>Aconitum napellus</i>	Monkshood		wet to moderately wet, part shade	●	○	○	○	●
<i>Aconitum columbianum</i>	Columbian Monkshood		wet to moderately wet, part shade	●	●	●	○	●
<i>Aquilegia formosa</i>	Crimson/Western Columbine		wet to moderately wet, sun to part shade	●	○	○	○	●
<i>Aquilegia</i> spp.	Columbine		moderately wet, sun to part shade, many cultivars	●	●	●	○	
<i>Arnica chamissonis</i> ssp. <i>foliosa</i>	Arnica		moderately wet, sun	●	○	○	○	●
<i>Aster occidentalis</i>	Western Mountain Aster		wet to moderately wet, sun to part shade	●	○	○	○	●
<i>Aster</i> species	Aster		wet to moderately wet, sun to part shade, many cultivars	●	●	●	○	●
<i>Astilbe chinensis</i>	Meadowsweet		moderately wet, shade to part shade, accent	○	●	●	○	●
<i>Balsamorhiza sagittata</i>	Arrowleaf Balsam Root		moderately wet to dry, sun to part shade	●	○	○	○	●
<i>Delphinium glaucum</i>	Mountain Larkspur		wet to moderately wet, sun to part shade	●	○	○	○	●
<i>Delphinium</i> spp.	Larkspur/Delphinium		wet to moderately wet, sun to part shade, many cultivars, accent	●	●	●	○	●
<i>Dianthus</i> spp.	Sweet William, Pinks		moderately wet sun to part shade	●	●	●	○	●
<i>Dicentra</i> spp.	Bleeding Heart		moderately wet, shade, accent	○	●	●	○	●

# BIORETENTION

## Fact Sheet TR-1

Plant Selection Guidance for Low Impact Development Features in the Placer County Sierra Nevada						
PLANTS <sup>1</sup>			Drought & Inundation Tolerance <sup>2</sup>		Defensible Space Considerations <sup>3</sup>	Origin
Scientific Name	Common Name	Optimal Site Conditions <small>Habitat/water requirements, sun, shade, part shade, special notes</small>	Tolerant of both Wet and Dry Periods	Better with Supplemental Irrigation	Requires Supplemental Irrigation	Fire Hazard
<i>Digitalis</i> spp.	Foxglove	moderately wet, sun to part shade, accent	●	●	○	○
<i>Echinacea purpurea</i>	Purple Coneflower	moderately wet to dry, sun, accent	●	●	○	○
<i>Epiobium angustifolium</i>	Fireweed	wet to moderately wet, sun to part shade	●	●	○	○
<i>Epiobium canum</i> spp latifolium	California Fuchsia	moderately wet to dry, sun	○	○	○	○
<i>Eriogonum umbellatum</i>	Sulphur-Flower Buckwheat	sun, dry	○	○	○	○
<i>Eschscholzia californica</i>	California Poppy	moderately wet to dry, sun to part shade, annual	○	●	○	○
<i>Gaillardia</i> spp.	Blanket Flower	moderately wet to dry, sun to part shade	○	●	○	○
<i>Geranium richardsonii</i>	Richardson's Cranesbill	wet to moderately wet, part shade	●	●	●	●
<i>Geranium</i> spp.	Hardy/Cranesbill Geranium	wet to dry, sun to part shade	●	●	○	○
<i>Gilia aggregata</i>	Scarlet Gilia	moderately wet to dry, sun to part shade	○	○	○	○
<i>Hemerocallis</i> spp.	Daylily species	moderately wet, sun to part shade, many cultivars, accent	○	●	●	○
<i>Hemerocallis</i> 'Stella D'Oro'	Stella D'Oro Daylily	yellow sun to part shade, 12-14'	○	●	●	○
<i>Heracleum lanatum</i>	Cow Parsnip	wet to moderately wet, sun to part shade	●	●	○	○
<i>Heuchera</i> species	Coral Bells, Alumroot	wet to moderately wet, shade to part shade	○	●	●	○
<i>Iberis sempervirens</i>	Candytuft	moderately wet to dry, sun, accent	○	●	○	Unknown
<i>Iris missouriensis</i>	Western Blue Flag Iris	wet to moderately wet, sun to part shade	●	●	○	○
<i>Iris</i> spp.	Bearded Iris, Siberian Iris,	wet to dry, sun to part shade, many cultivars, accent	○	●	●	○
<i>Lavandula angustifolia</i>	English Lavander	dry, sun	○	●	○	○
<i>Leucanthemum x superbum</i>	Shasta Daisy	moderately wet to dry, sun to part shade	●	●	○	○
<i>Ligularia stenocephala</i>	Ligularia 'The Rocket'	wet to moderately wet, shade, accent	○	●	●	○
<i>Lilium pardalinum</i>	Leopard Lily	wet, sun to part shade	●	●	○	○

# BIORETENTION

## Fact Sheet TR-1

Plant Selection Guidance for Low Impact Development Features in the Placer County Sierra Nevada						
PLANTS <sup>1</sup>			Drought & Inundation Tolerance <sup>2</sup>		Defensible Space Considerations <sup>3</sup>	Origin
Scientific Name	Common Name	Optimal Site Conditions requirements, sun, shade, part shade, special notes	Tolerant of both Wet and Dry Periods	Better with Supplemental Irrigation	Requires Supplemental Irrigation	Fire Hazard
<i>Lilium parvum</i>	Alpine Lily	wet to moderately wet, sun to part shade	●	●	○	○
<i>Lilium</i> spp	Asiatic, Ornamental Hybrid Lily	wet to moderately wet, sun to part shade, many cultivars, accent	●	●	●	○
<i>Linum lewisii</i>	Mountain Blue Flax	moderately wet to dry, sun	●	○	○	○
<i>Lupinus breweri</i>	Brewer's Lupine	dry, sun	●	○	○	○
<i>Lupinus polyphyllus</i>	Large-leaved Lupine	wet to medium, sun to part shade	●	●	○	○
<i>Lupinus</i> spp.	Lupine	moderately wet to dry, many species and cultivars, accent	●	●	●	○
<i>Mimulus guttatus</i>	Yellow Monkeyflower	wet to moderately wet, shade to sun	●	●	○	○
<i>Mimulus lewisii</i>	Lewis' Monkeyflower	wet to moderately wet, shade to part shade	●	●	○	○
<i>Monarda didyma</i>	Bee Balm	moderately wet, part shade	●	●	●	○
<i>Monardella odoratissima</i>	Mountain Pennyroyal	dry, sun	○	○	○	○
<i>Paeonia</i> spp.	Peony	wet to moderately wet, sun to part shade, many cultivars, accent	●	●	●	○
<i>Papaver oriental</i>	Oriental Poppy	moderately wet to dry, sun to part shade, accent	●	●	○	○
<i>Penstemon azureus</i>	Azure Penstemon	moderately wet, sun	●	○	○	○
<i>Penstemon heterodoxus</i>	Whorled Penstemon	moderately wet to dry, sun to part shade	●	●	○	○
<i>Penstemon newberryi</i>	Mountain Pride Penstemon	moderately wet to dry, sun to part shade	○	○	○	○
<i>Penstemon rydbergii</i>	Meadow Penstemon	wet to moderately wet, sun to part shade	○	●	○	○
<i>Penstemon strictus</i>	Rocky Mountain Penstemon	moderately wet to dry, sun to part shade	●	●	○	○
<i>Phlox paniculata</i>	Garden Phlox	moderately wet to dry, sun to part shade	●	●	○	○
<i>Polemonium occidentale</i>	Jacob's Ladder	wet to moderately wet, shade to part shade	●	●	○	○
<i>Potentilla glandulosa</i>	Sticky Cinquefoil	wet to moderately wet, sun to part shade	○	●	○	○

# BIORETENTION

## Fact Sheet TR-1

Plant Selection Guidance for Low Impact Development Features in the Placer County Sierra Nevada							
PLANTS <sup>1</sup>		Common Name	Optimal Site Conditions Habitat/water requirements, sun, shade, part shade, special notes	Drought & Inundation Tolerance <sup>2</sup>		Defensible Space Considerations <sup>3</sup>	Origin
Scientific Name	Common Name			Tolerant of both Wet and Dry Periods	Better with Supplemental Irrigation		
<i>Potentilla gracilis</i> var. <i>fastigiata</i>	Graceful Cinquefoil	wet to moderately wet, part shade	●	○	○	○	Native
<i>Rubus parviflorus</i>	Thimbleberry	wet to moderately wet, sun to part shade	●	○	○	○	●
<i>Solidago canadensis</i>	Canada Goldenrod	moderately wet, sun	○	○	○	○	●
<i>Stachys byzantia</i>	Lamb's Ear	moderately wet to dry, sun to part shade, groundcover type habit, accent	●	○	○	○	●
<i>Abies concolor</i>	White Fir	moderately wet, sun to part shade, plant 5g or smaller	○	●	○	●	●
<i>Abies magnifica</i>	Red Fir	moderately wet, shade to sun, slow growing	○	●	○	●	●
<i>Acer ginnala</i>	Amur Maple	moderately wet, sun to part shade, shrub habit ☐ prune to multi-stemmed tree	○	●	●	Unknown	●
<i>Betula occidentalis fonalis</i>	Western River Birch	wet to moderately wet, sun to part shade, shrub habit ☐ prune to multi-stemmed tree, plant from high elevation seed source	●	●	○	○	●
<i>Calocedrus decurrens</i>	California Incense Cedar	moderately wet to dry, sun to part shade	○	●	○	●	●
<i>Crataegus</i> spp.	Hawthorn	moderately wet, sun to part shade, many cultivars, accent	○	●	●	Unknown	●
<i>Juniperus occidentalis</i> var. <i>occidentalis</i>	Western Juniper	dry, sun, slow growing	○	●	○	●	●
<i>Malus</i> spp.	Crabapple species	moderately wet, sun to part shade, many cultivars, accent	○	●	○	Unknown	●
<i>Pinus contorta</i> var. <i>murrayana</i>	Lodgepole Pine	wet to dry, sun to part shade	●	●	●	●	●
<i>Pinus jeffreyi</i>	Jeffrey Pine	moderately wet to dry, sun to part shade	●	●	○	●	●
<i>Pinus lambertiana</i>	Sugar Pine	moderately wet, generally	○	●	○	●	●
<i>Pinus ponderosa</i>	Ponderosa Pine	moderately wet to dry, sun to part shade, SEZ, invasive roots	○	●	○	●	●
<i>Populus tremuloides</i>	Quaking Aspen	wet, sun to part shade SEZ, invasive roots	○	●	●	○	●
<i>Populus trichocarpa</i>	Black Cottonwood	wet, sun to part shade SEZ, invasive roots	●	●	●	Unknown	●

# BIORETENTION

## Fact Sheet TR-1

Plant Selection Guidance for Low Impact Development Features in the Placer County Sierra Nevada								
PLANTS <sup>1</sup>		Common Name	Optimal Site Conditions Habitat/water requirements, sun, shade, part shade, special notes to multi-stemmed tree	Drought & Inundation Tolerance <sup>2</sup>			Defensible Space Considerations <sup>3</sup>	Origin
Scientific Name	Tolerant of both Wet and Dry Periods			Better with Supplemental Irrigation	Requires Supplemental Irrigation	Fire Hazard		
<i>Salix scouleriana</i>	Scouler's Willow		wet to moderately wet, sun/part shade, prune to multi-stemmed tree	●	○	○	○	●
<i>Sequoiadendron giganteum</i>	Giant Sequoia		moderately wet, sun to part shade, California Native	○	○	○	Unknown	●
<i>Sorbus aucuparia</i>	European Mountain Ash		moderately wet, sun to part shade, accent, protect from Sap Suckers	○	●	●	○	●
<i>Aegopodium podagraria 'variegatum'</i>	Bishop's Weed		wet to moderately wet, shade to part shade, aggressive	○	●	●	○	●
<i>Arctostaphylos nevadensis</i>	Pinemat Manzanita		dry, sun, rarely available	○	○	○	●	
<i>Arctostaphylos uva-ursi</i>	Bearberry Manzanita, Kinnikinnick		moderately wet to dry, sun to part shade	○	●	○	●	●
<i>Asperula odorata</i>	Sweet Woodruff		wet to moderately wet, shade to part shade, fast	○	●	●	○	●
<i>Bergenia spp.</i>	Bergenia		moderately wet, shade to part shade	○	●	●	○	●
<i>Ceanothus prostratus</i>	Mahala Mat (Squaw Carpet)		moderately wet to dry, sun to part shade	○	○	○	Unknown	●
<i>Cotoneaster dammeri</i>	cultivars 'Eicholz', 'Coralberry', 'Bearberry'		moderately wet to dry, sun to part shade	○	●	●	Unknown	●
<i>Dianthus spp.</i>	Creeping Pinks		moderately wet, sun to part shade	○	●	●	○	●
<i>Erigeron coulteri</i>	Coulter's Daisy		wet to moderately wet, sun	●	○	○	○	●
<i>Eriogonum umbellulatum</i>	Sulphur-Flower Buckwheat		dry, sun	○	○	○	Unknown	●
<i>Fragaria vesca</i>	Wood Strawberry		wet to moderately wet, part shade	○	●	○	○	●
<i>Fragaria virginiana</i>	Mountain Strawberry		wet to moderately wet, sun to part shade	○	●	○	○	●
<i>Lupinus breweri</i>	Brewer's Lupine		dry, sun	○	○	○	○	●
<i>Penstemon newberryi</i>	Mountain Pride		moderately wet to dry, sun	○	○	○	○	●



# BIORETENTION

## Fact Sheet TR-1

Plant Selection Guidance for Low Impact Development Features in the Placer County Sierra Nevada							
PLANTS <sup>1</sup>		Common Name	Optimal Site Conditions Habitat/water requirements, sun, shade, part shade, special notes	Drought & Inundation Tolerance <sup>2</sup>		Defensible Space Considerations <sup>3</sup>	Origin
Scientific Name	Common Name			Tolerant of both Wet and Dry Periods	Better with Supplemental Irrigation		
Grasses							
<i>Elytrigia intermedia</i> 'Tegmar'	Dwarf Intermediate/Pubescent Wheatgrass		dry, sun, drought tolerant, excellent erosion control	●	○	○	Native
<i>Festuca arundinacea</i>	Tall Fescue		moderately wet, sun part shade, turf types and dwarfs, not suitable for SEZ	●	?	○	
<i>Festuca glauca</i>	Blue Fescue		moderately wet, sun part shade, ornamental bunch grass	●	?	○	
<i>Festuca idahoensis</i>	Idaho Fescue		wet to dry, sun part shade	●	○	○	
<i>Festuca ovina</i> var. <i>duriuscula</i>	Hard Fescue		moderately wet to dry, sun part shade, cultivars 'Durai', 'Sierra', 'Scaldis'	●	○	●	
<i>Festuca rubra</i>	Red Fescue		moderately wet to wet, shade, turf	●	?	○	
<i>Festuca rubra</i> ssp. <i>comutata</i>	Chewings Fescue		moderately wet, sun part shade, turf	?	?	○	
<i>Festuca trachyphylla</i>	Sheep Fescue		dry, sun part shade	?	○	○	
<i>Hordeum barachyantherum</i>	Meadow Barley		wet to dry, sun part shade	●	○	○	
<i>Juncus articulatus</i>	Jointleaf Rush		wet to dry, sun part shade	●	○	○	
<i>Juncus balticus</i>	Baltic Rush		wet to dry, sun part shade	●	○	○	
<i>Koeleria macrantha</i>	Prarie Junegrass		wet to dry, sun part shade	●	○	○	
<i>Lolium perenne</i>	Perennial Ryegrass		moderately wet to dry, turf	●	○	○	
<i>Miscanthus sinensis</i>	Maiden Grass		wet to moderately wet, accent	○	●	○	
<i>Poa ampala</i> 'Canby's'	Bluegrass, big		moderately wet to dry, sun part shade	?	○	○	
<i>Poa ampala</i> 'Sherman's'	Bluegrass, big		moderately wet to dry, sun part shade	?	○	○	
<i>Poa pratensis</i>	Kentucky Bluegrass		wet to moderately wet, sun part shade, turf	●	●	○	
<i>Poa sandbergii</i>	Sandberg Bluegrass		wet to dry, sun part shade	●	○	○	
<i>Pseudoroegneria spicata</i>	Bluebunch Wheatgrass		dry, sun	?	○	○	

# BIORETENTION

## Fact Sheet TR-1

Plant Selection Guidance for Low Impact Development Features in the Placer County Sierra Nevada						
PLANTS <sup>1</sup>		Drought & Inundation Tolerance <sup>2</sup>		Defensible Space Considerations <sup>3</sup>	Origin	
Scientific Name	Common Name	Optimal Site Conditions requirements, sun, shade, part shade, special notes		Habitat/water		
		Tolerant of both Wet and Dry Periods	Better with Supplemental Irrigation	Requires Supplemental Irrigation	Fire Hazard	Adapted Non-Native
<p>We would like to acknowledge the author Robie Wilson Litchfield, ASLA Principal, Certified Green Building Professional L+P DesignWorks, Landscape Architecture + Planning for her development of this document. Special thanks also to Sarah Trebilcock, Botanist and Plant Ecologist, The Villager Nursery, Truckee, California, who reviewed this document.</p>						
<p><b>Acknowledgements</b></p>						
<p><b>Disclaimer</b></p>						
<p>This list is a compilation of information based upon the author's long term experience with Sierra botany and environs beginning in the early 1970's and as a Landscape Architect in the Tahoe-Truckee region since 1990. This information is supplemented and verified by the references listed below. The author acknowledges that opinions and other lists will vary as to the appropriateness of certain plant materials for the recommended uses. As experience with emerging practices in Stormwater Management and Wildfire Management evolves, recommended uses will likely change. The information contained in this list is complete and true to the best of the author's knowledge to date. No guarantee is made as to the recommendations written herein and the author and publisher shall not be held liable in connection with the use of this information.</p>						
<p><b>Legend</b></p>						
●	Indicates good, or yes for drought and inundation tolerance; indicates high for fire hazard					
◐	Indicates fair for drought and inundation tolerance; indicates medium for fire hazard					
○	Indicates poor, or no for drought and inundation tolerance; indicates low for fire hazard					
<p><b>Footnotes</b></p>						
1	Because hardness zones vary significantly in the Sierra, it is highly recommended that your local landscape professional or nursery be consulted to verify that chosen species are appropriate for the project area. A consulting fee may be required.					
2	Refers to established plant material					
3	Opinions on Fire Hazard levels will vary from fire district to fire district, this list is meant as a general guide in planning LID facilities and not as a Defensible Space guide. Consult your local fire district to verify what will be allowed in your area.					
<p><b>References</b></p>						
Home Landscaping Guide for Lake Tahoe and Vicinity - EB-02-0. 2008. University of Nevada Cooperative Extension. John Coburn et al.						
Ed Kleiner, owner Comstock Seed Company, Minden, Nevada						
Fact Sheet 01-33 Fireescaping, 2008 University of Nevada Cooperative Extension. JoAnne Skelly						
Fact Sheet 08-26 Combine Defensible Space and Best Management Practices, 2008 University of Nevada Cooperative Extension. John Cobourn						
Fact Sheet 97-36. Greenstrips: Another Tool to Manage Wildfire, 1997. University of Nevada Cooperative Extension. Jason Davison, Ed Smith						
Special Publication 05-16. A compilation of Good Plant Choices for Nevada's High Fire Hazard Areas, 2005 University of Nevada Cooperative Extension. Ed Smith, Sonya Sistare						
Invasive Weeds of the Tahoe National Forest and Invasive Weeds of the Lake Tahoe Basin, 2009, United States Forest Service Publication R5-TP-024, Susan Donaldson, Susie Urte						
Jepson Interchange website <a href="http://ucjeps.berkeley.edu/interchange.html">http://ucjeps.berkeley.edu/interchange.html</a>						
Micki Kelly, Kelly Biological Consulting, Truckee, California						
Sarah Trebilcock, Botanist and Plant Ecologist, The Villager Nursery, Truckee, California						

# BIORETENTION

---

## Fact Sheet TR-1

### SIZING DESIGN GOALS AND REQUIREMENTS

The Post-Construction Storm Water Quality Plan (SWQP) Form 3-2 should be used to calculate the Water Quality Volume (WQV) of bioretention facilities. This value is then used to iteratively determine the necessary bioretention area sizing to capture the remainder of the 85<sup>th</sup> percentile, 24-hour design storm not retained by Site Design Measures. The equation for determining the WQV is as follows:

$$WQV = \text{Unit WQV} * A_{imp} * R_c$$

Where:

WQV	= Water Quality Volume (ft <sup>3</sup> );
Unit WQV	= design storm based on elevation and drawdown time;
A <sub>imp</sub>	= impervious drainage area untreated by Site Design Measures (ft <sup>2</sup> ); and
R <sub>c</sub>	= Runoff Coefficient (default 0.9).

Sites with documented high concentrations of pollutants in underlying soil or groundwater, sites located where infiltration could contribute to a geotechnical hazard, and sites located on elevated plazas or other structures may incorporate an impervious liner and may locate the underdrain discharge at the bottom of the gravel layer to create a “Flow-Through Planter.” These Flow-Through Planters must be sized according to Water Quality Flow (WQF) using Form 3-5 and Form 3-7 of the SWQP. The equation for determining the WQF for Flow-Through Planters is as follows:

$$WQF = A_{imp} * P_f / 43,200$$

Where:

WQF	= Water Quality Flow (cfs);
A <sub>imp</sub>	= impervious drainage area untreated by Site Design Measures (ft <sup>2</sup> ); and
P <sub>f</sub>	= flow based design storm intensity (0.2 inch/hr).

### CONSTRUCTION PHASE CONSIDERATIONS

#### *Protection and Excavation*

Protecting bioretention areas during all phases of construction is a top priority. In project specifications, and during pre-bid and pre-construction meetings, communicate requirements and expectations to the contractor. From the start of construction, areas should be fenced to define limits and keep heavy equipment out. Erosion and sediment control measures should be placed so that construction sediment and wastes cannot enter the facility. Excavation activities should avoid compacting the facility base and sidewalls and should not take place during wet weather. Inlets should be blocked until construction sediment sources are removed and plants are sufficiently established to hold up to storm water flows. Plant establishment times will depend on plant species. Storm water directed away from bioretention areas during plant establishment must be managed using temporary BMPs.

#### *Structures and Materials*

Structures such as curbs, inlets, checkdams, bypass and underdrain systems and containment walls are critical to facility function. During construction, verify that the elevations of these elements match the design drawings. For example, the raised overflow structures used in bioretention facilities may look like a plan error to contractors not experienced with LID. Clearly communicating design objectives will help avoid uninformed field adjustments.

The bioretention soil mix and aggregate layers are also key components to achieving the desired performance. During pre-bid and pre-construction meetings, explain the characteristics and purpose of these materials to contractors and follow up by thoroughly reviewing construction material submittals.

# BIORETENTION

## Fact Sheet TR-1

### INSPECTION AND MAINTENANCE REQUIREMENTS

A maintenance plan shall be provided with the Final SWQP. The maintenance plan shall include recommended maintenance practices, state the parties responsible for maintenance and upkeep, specify the funding source for ongoing maintenance, with provisions for full replacement when necessary, and provide site specific inspection checklist.

At a minimum the following inspections and maintenance activities should be conducted on an annual basis or more frequently if necessary:

Maintenance Indicator	Required Maintenance Activit
Is litter, excess sediment or debris present in the upstream drainage or in the bioretention facility?	Remove litter, sediment/debris. Inspect the areas upstream of the bioretention facility to make sure the tributary area is properly stabilized.
Is standing water present in the facility for longer than 72 hours after a storm?	Remove any accumulated sediment and flush drainage system including underdrain. Remove and replace top few inches of soil. Remove and replace all soil, re-grade and re-plant.
Are dead plants, weeds present?	Remove dead vegetation and replace as necessary. Pull weeds and trim excess plant growth.
Is erosion occurring within the facility or drainage system?	Repair erosion and stabilize to prevent recurrence
Are holes or voids present in the facility?	Inspect underdrain and replace soil if needed.
Are unwanted rodents or other pests present?	Implement environmentally friendly pest control practices. Do not use pesticides or herbicides in the bioretention facility.

### REFERENCES


City of Salinas Department of Engineering and Transportation. 2014. Storm water Standard Plans (SWSPs). Available online at: <https://www.cityofsalinas.org/search/site/stormwater%20standard%20plans>

Placer County, 2012. Placer County Low Impact Development (LID) Guidebook. Available online at: <http://www.placer.ca.gov/departments/communitydevelopment/planning/documentlibrary>


# BIORETENTION FACILITIES

Fact Sheet TR-1

DESIGN DETAILS

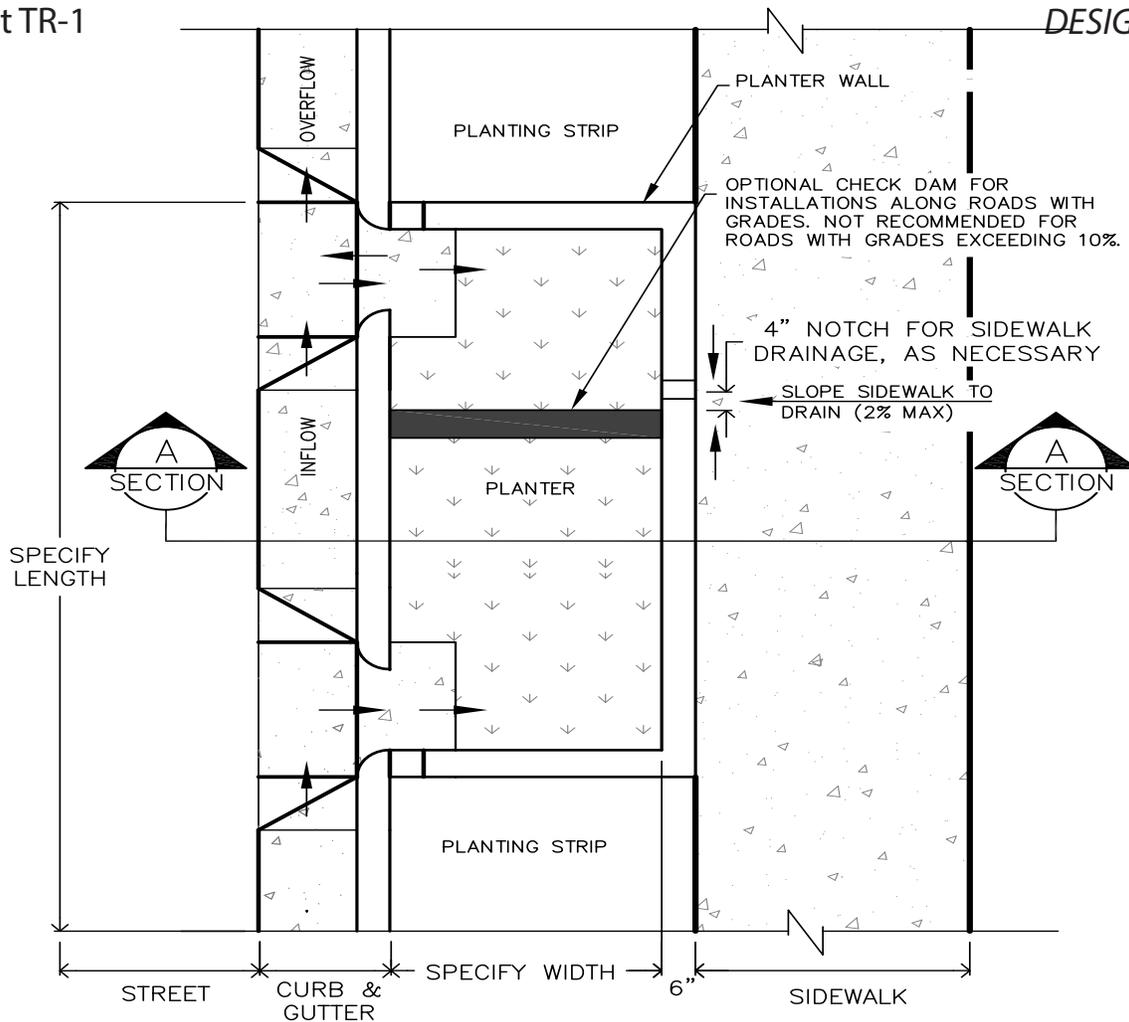

## PLAN VIEW

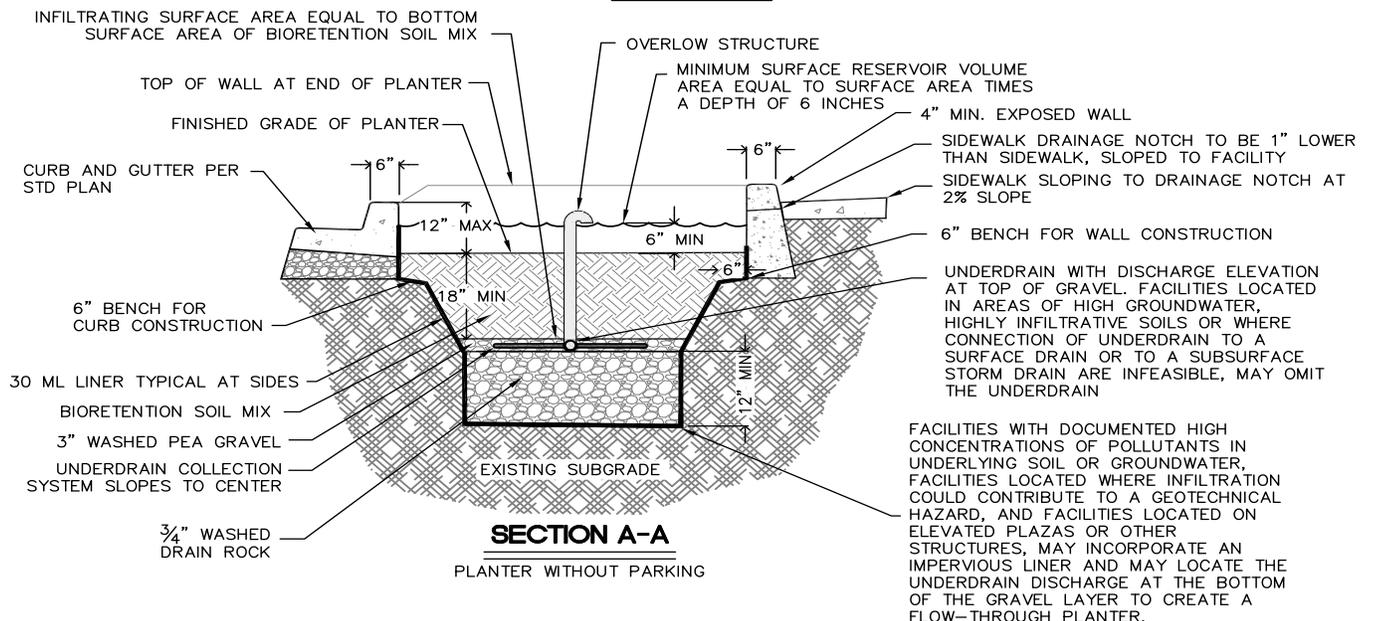

## IN STREET BIORETENTION - WITHOUT PARKING


### Plan & Section Views

DRAWING NOT TO SCALE  
Source: Adapted from City of Salinas


# BIORETENTION FACILITIES

Fact Sheet TR-1

DESIGN DETAILS

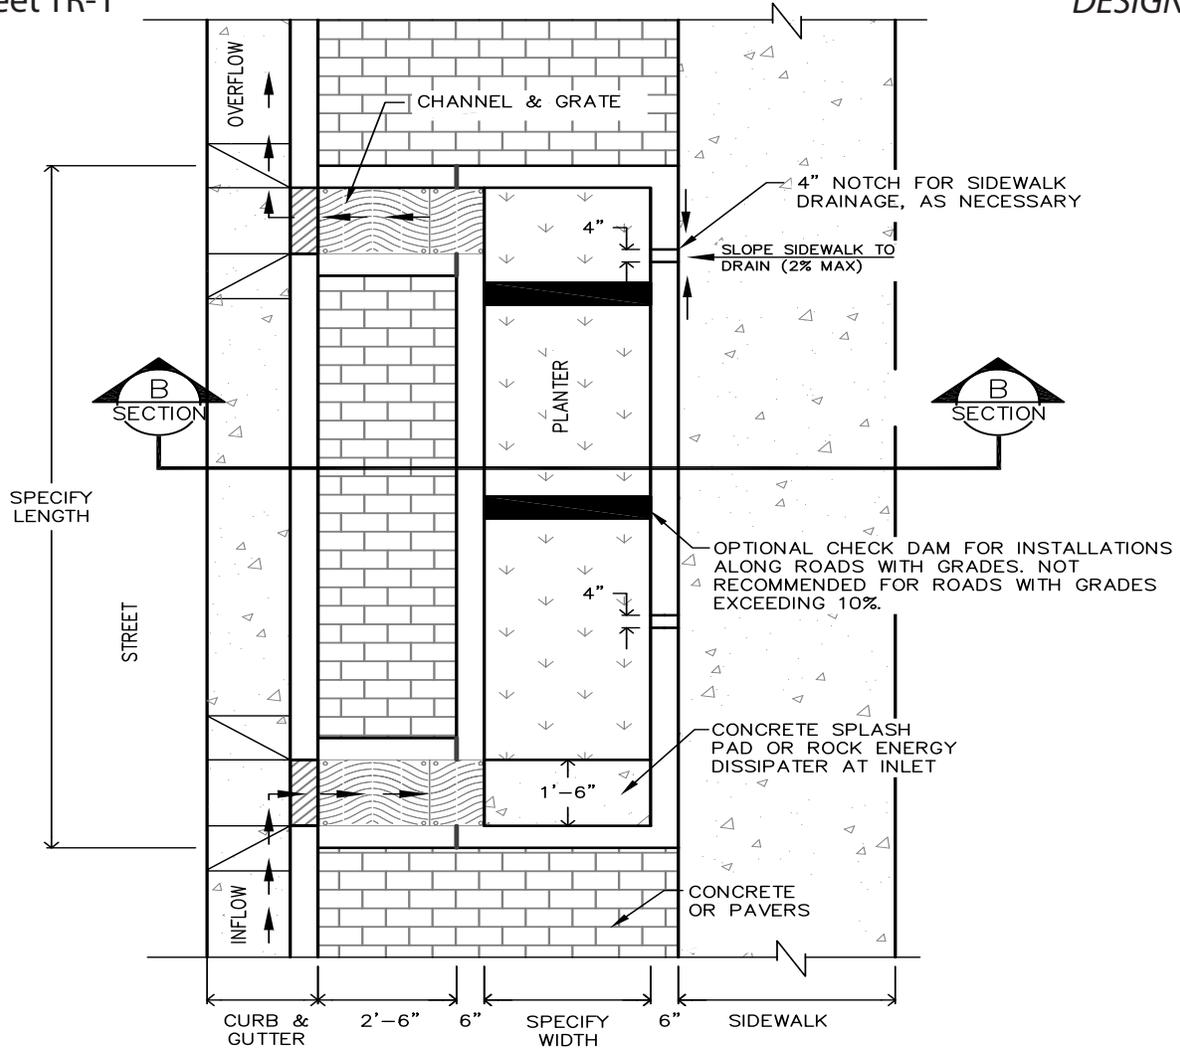

## PLAN VIEW

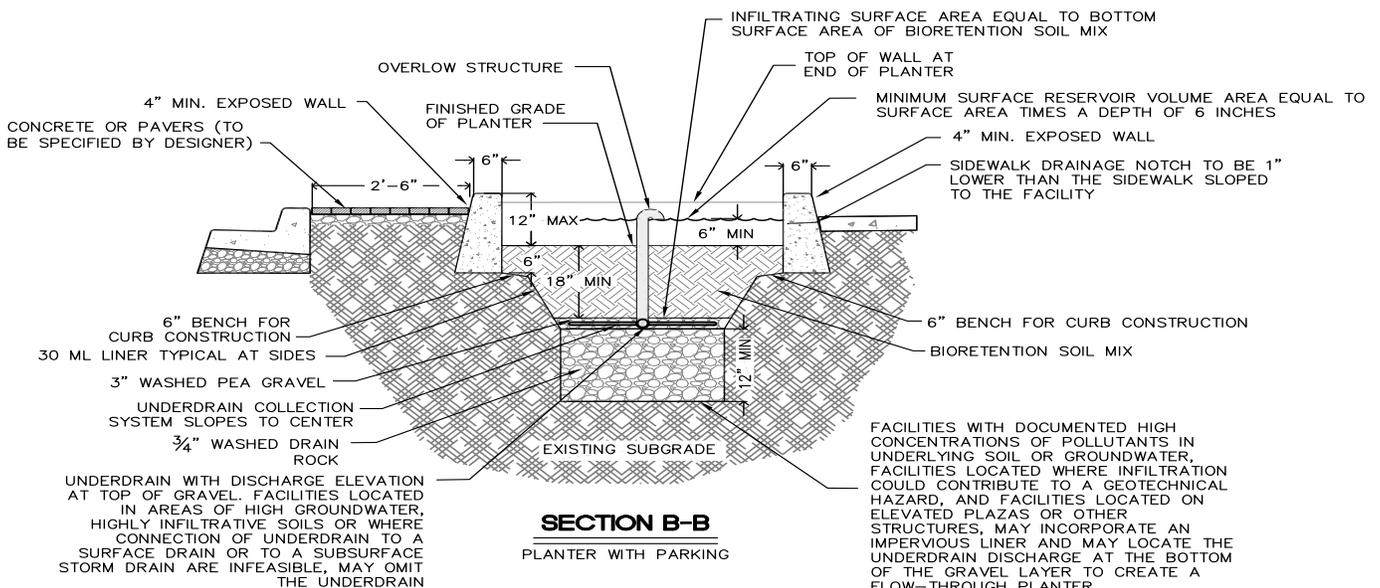

## IN STREET BIORETENTION - WITH PARKING


### Plan and Section Views

DRAWING NOT TO SCALE  
Source: Adapted from City of Salinas

# BIORETENTION FACILITIES


Fact Sheet TR-1

DESIGN DETAILS

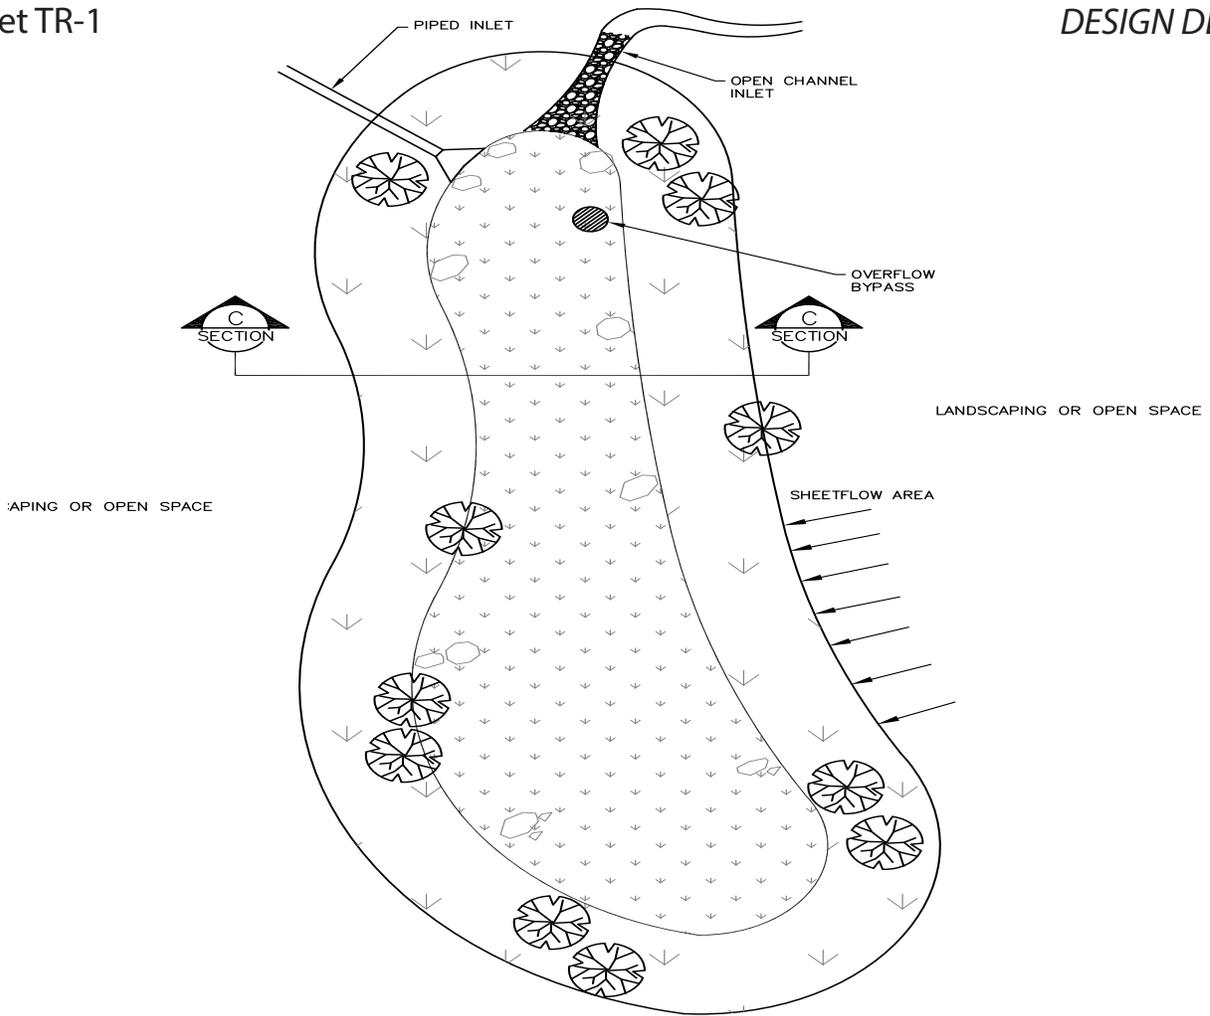

MINIMUM SURFACE RESERVOIR VOLUME AREA EQUAL TO SURFACE AREA TIMES A DEPTH OF 6 INCHES

**PLAN VIEW**

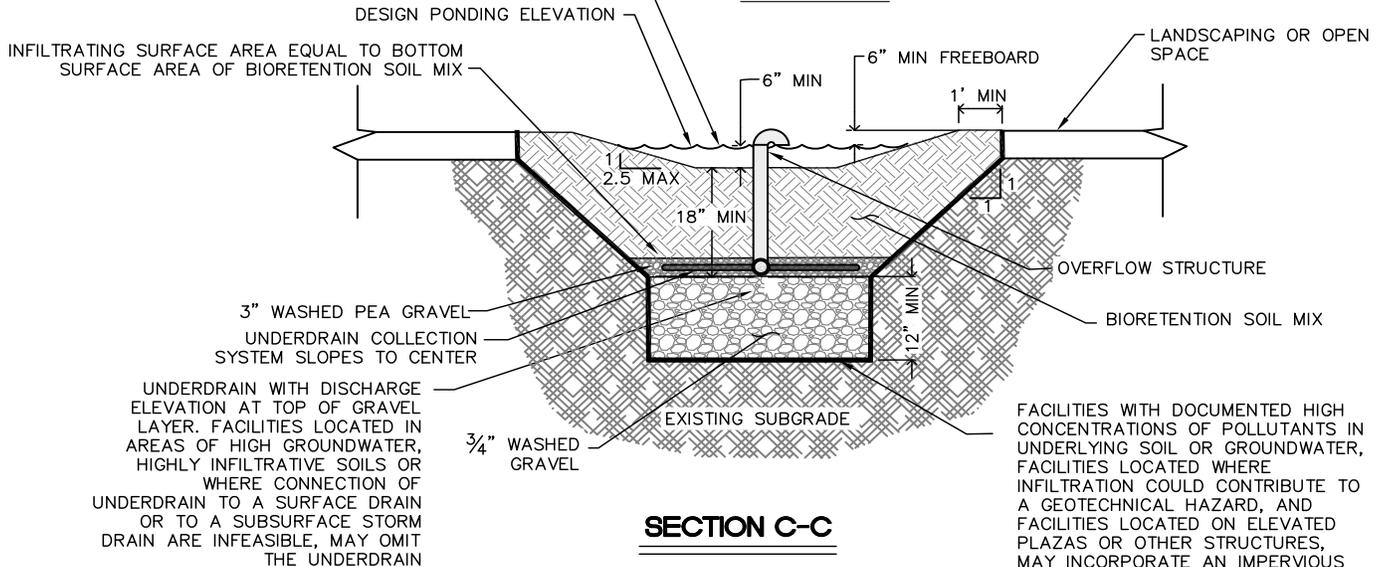

**SECTION C-C**

## BIORETENTION IN LANDSCAPE OR OPEN SPACE AREAS

### Plan and Section Views

FACILITIES WITH DOCUMENTED HIGH CONCENTRATIONS OF POLLUTANTS IN UNDERLYING SOIL OR GROUNDWATER, FACILITIES LOCATED WHERE INFILTRATION COULD CONTRIBUTE TO A GEOTECHNICAL HAZARD, AND FACILITIES LOCATED ON ELEVATED PLAZAS OR OTHER STRUCTURES, MAY INCORPORATE AN IMPERVIOUS LINER AND MAY LOCATE THE UNDERDRAIN DISCHARGE AT THE BOTTOM OF THE SUBSURFACE DRAINAGE / STORAGE LAYER TO CREATE A FLOW-THROUGH PLANTER.

DRAWING NOT TO SCALE  
Source: Adapted from City of Salinas

# MEDIA FILTER

## Fact Sheet TR-2

### DESCRIPTION

Storm water media filters are typically two-chambered including a pretreatment settling basin and a filter consisting of sand, gravel, or other adsorptive filtering media. As storm water flows into the first chamber, large particles settle out, and then finer particles and other pollutants are removed as storm water flows through the filtering media in the second chamber. There are a number of design variations including the Austin sand filter, Delaware sand filter, multi-chambered treatment train (MCTT), and manufactured storm water filters. Treated storm water is collected in an effluent chamber or underdrain, and subsequently discharged to a storm water conveyance system or other appropriate location.

Manufactured storm water filters are typically underground systems that utilize membranes of various materials or cartridges filled with different types of media to filter storm water runoff. For cartridge systems, the media used can be inert, such as sand, or adsorptive, such as peat or manufactured media. The effectiveness of these systems depends on the type of membrane or media being implemented, the filter loading rate, and the characteristics of the influent storm water. For some systems, the water chemistry will also determine the effectiveness of the filter in removing dissolved constituents.



Photo Source: Portland BES

### ADVANTAGES

- Protects and improves water quality by removing pollutants from storm runoff.
- Customizable sizing (small footprint).
- Customizable filter media to target key site pollutants.
- May be located underground.
- Does not require irrigation.

### LIMITATIONS

- Minimal reduction in runoff volume in comparison to other systems that promote infiltration, evaporation, or evapotranspiration.
- Designs that maintain permanent standing water may create vector concerns
- Confined space training may be required for maintenance on vault systems.
- Failure to maintain media filter may result in clogging and system failure.
- Significant head loss through filters may limit use on flat sites.
- High installation and maintenance costs.

### KEY DESIGN FEATURES

Media filters may only be implemented for Regulated Projects that demonstrate use of bioretention facilities to be infeasible. Regulated Projects implementing media filters must meet the following requirements:

1. Projects creating or replacing an acre or less of impervious area, and located in a designated pedestrian-oriented commercial district (i.e., smart growth projects), and having at least 85% of the entire project site covered by permanent structures;
2. Facilities receiving runoff solely from existing (pre-project) impervious areas; and
3. Historic sites, structures or landscapes that cannot alter their original configuration in order to maintain their historic integrity.

# MEDIA FILTER

## Fact Sheet TR-2

The performance of any media filter is governed primarily by the following factors which should be carefully evaluated when designing the facility:

- Hydraulic Loading Rate – The application rate of untreated water to the surface of the filter media usually expressed as a flow rate per filter surface area (i.e. gpm/ft<sup>2</sup>);
- Filter Media Gradation – A finer media gradation reduces hydraulic conductivity and increases the capture efficiency for fine particulate pollutants. Finer media also has a greater surface area which increases sorption rates for chemically active media. A more homogenous media gradation increases voids volume in a media bed. Finer media is more susceptible to surface clogging.
- Residence Time - Residence time is a function of media gradation, hydraulic loading rate and the media bed depth and configuration. A longer residence time generally improves pollutant removal performance.
- Media Chemical Properties – Filter media can be inert (i.e. sand) or can be selected to target specific pollutants of concern (i.e. activated carbon for trace organics). Chemically active options may be organic, mineral or synthetic or a combination of types. Media should be selected with consideration of the type and load of pollutants requiring removal.
- Pretreatment – Integrate adequate pretreatment facilities into media filter designs to reduce sediment loading and maintenance frequency. The level of pretreatment required is dependent on the tributary drainage area, but typical pretreatment consists of a sedimentation chambers, hydrodynamic separator, vegetated buffer strips, and vegetated swales.
- Hydraulic Head – Different media filters types have varying hydraulic head requirements that must be considered during design. Certain media filter configurations may not be suitable for flat sites.

### SIZING DESIGN GOALS AND REQUIREMENTS

The Post-Construction Storm Water Quality Plan (SWQP) Form 3-5 should be used to calculate the Water Quality Flow (WQF) of media filters for Regulated Projects. This value is then used in Form 3-7 to iteratively determine the necessary media filter sizing to capture the remainder of the 85<sup>th</sup> percentile, 24-hour design storm not retained by Site Design Measures. The equation for determining the WQF for media filters is as follows:

$$WQF = A_{imp} * P_F / 43,200$$

Where:

- WQF = Water Quality Flow (cfs);
- A<sub>imp</sub> = impervious drainage area untreated by Site Design Measures (ft<sup>2</sup>); and
- P<sub>F</sub> = flow based design storm intensity (0.2 inch/hr).

### CONSTRUCTION PHASE CONSIDERATIONS

- Divert flow around the sand filter to protect it from sediment loads during construction. If sediment does enter the facility during construction, the sediment will require removal after the tributary area has been stabilized. Diverted flow must be managed using temporary BMPs.
- Where underdrains are used, ensure that the minimum slope of the pipe is 0.5 (1/2) percent.
- Ensure that the inverts of notches, orifices, or weirs dividing chambers correspond with design elevations to ensure proper function.
- The surface of bed filters should be completely level to promote uniform filtration.
- If precast concrete lids are used, provide lifting rings or threaded sockets to allow easy removal with standard lifting equipment.
- Once construction is complete, stabilize the entire tributary area to the media filter before allowing runoff to enter the unit.

# MEDIA FILTER

## Fact Sheet TR-2

### MAINTENANCE CONSIDERATIONS

Media filters may exhibit decreased effectiveness after a single year of operation, depending on the activities occurring in the drainage area and filter loading. They clog easily when subjected to high sediment loads, and sediment reducing pretreatment practices placed upstream of the filter should be maintained properly to reduce sediment loads into the filter.

Maintenance efforts will need to focus on basic housekeeping practices such as removal of sediment and debris accumulations to prevent clogs and/or ponds of standing water. To minimize the potential for clogging, frequent maintenance and inspection practices are required. Waste sand, gravel, membranes, or filter media must be disposed of properly and in accordance with all applicable laws.

Media filters can become a nuisance due to mosquito or midge breeding if not properly designed and maintained. Installations should dewater completely (recommended 96 hour or less residence time) to prevent creating mosquito and other vector habitats.

### AVAILABLE VENDOR PRODUCTS

The names of vendor products listed below are for informational purposes only. Their appearance here is not an endorsement of the products or manufacturers by Placer County.

- BayFilter™
- Fabco Filter Cartridges
- Jellyfish®
- Media Filtration System (MFS)
- Perk Filter™
- Puristorm™
- Up-Flo™
- StormFilter®
- VortFilter™

### REFERENCES

California Department of Transportation (Caltrans). 2010. Treatment BMP Technology Report. CTSW-RT-09-239.06. Available online at: <http://www.dot.ca.gov/hq/env/stormwater/pdf/CTSW-RT-09-239-06.pdf>

California Storm water Quality Association (CASQA). 2003. California Storm water BMP Handbook – New Development and Redevelopment. BMP Fact Sheet TC-40: Media Filter and BMP Fact Sheet MP-40: Media Filter. Available online at:

<https://www.casqa.org/resources/bmp-handbooks/new-development-redevelopment-bmp-handbook>

Low Impact Development Center, Inc. 2010. Low Impact Development Manual for Southern California: Technical Guidance and Site Planning Strategies. Available online at: <https://www.casqa.org/resources/lid/socal-lid-manual>

Sacramento County, et al. 2014. Storm water Quality Design Manual for the Sacramento Region. Available online at: <http://www.beriverfriendly.net/newdevelopment/stormwaterqualitydesignmanual/>



# TREE BOX FILTER

## Fact Sheet TR-3

### DESCRIPTION

Tree box filters are typically manufactured systems that provide biofiltration and media filtration to treat storm water runoff. Storm water typically flows into a pretreatment chamber to remove large sediment, debris and trash before passing into the biotreatment chamber where physical straining, and biological and chemical reactions in the mulch, root zone, and soil matrix occurs. Tree box filters are similar in concept to bioretention areas in function and application, with the major distinction that a tree box filter has been optimized for high volume/flow treatment, therefore the ratio of impervious area to treatment area is less. A tree box filter takes up little space and may be used on highly developed sites in areas such as landscaping, green space, parking lots and streetscapes.



Photo Source: Oldcastle Storm water Solutions™

An underdrain in the tree box filter collects treated storm water to be discharged to the storm water conveyance system or other appropriate location. Manufactured tree box filters typically incorporate a high flow bypass to prevent scouring in the bioretention basin and mobilization of treated pollutants. The overflow can be directed to another treatment system or the municipal storm system.

### ADVANTAGES

- Protects and improves water quality by removing pollutants from storm runoff.
- Customizable sizing (small footprint).
- Trees can reduce heat island effects.
- Can be integrated into landscaping and is aesthetically pleasing.
- Customizable vegetation.

### LIMITATIONS

- Minimal reduction in runoff volume in comparison to other systems that promote infiltration.
- Designs that maintain permanent standing water may create vector concerns
- Vegetation may develop slowly, though treatment is still provided.
- Confined space training may be required for maintenance.
- Failure to maintain may result in clogging and system failure.
- High installation and maintenance costs.

### KEY DESIGN FEATURES

Tree box filters may only be implemented for Regulated Projects that demonstrate use of bioretention facilities to be infeasible. Regulated Projects implementing tree box filters must meet the following requirements:

1. Projects creating or replacing an acre or less of impervious area, and located in a designated pedestrian-oriented commercial district (i.e., smart growth projects), and having at least 85% of the entire project site covered by permanent structures;
2. Facilities receiving runoff solely from existing (pre-project) impervious areas; and
3. Historic sites, structures or landscapes that cannot alter their original configuration in order to maintain their historic integrity.

# TREE BOX FILTER

## Fact Sheet TR-3

The performance of a tree box filter is governed primarily by the following factors which should be carefully evaluated when designing the facility:

- Hydraulic Loading Rate – The application rate of untreated water to the surface of the filter media usually expressed as a flow rate per filter surface area (i.e. gpm/ft<sup>2</sup>);
- Filter Media Gradation – A finer media gradation reduces hydraulic conductivity and increases the capture efficiency for fine particulate pollutants. Finer media also has a greater surface area which increases sorption rates for chemically active media. A more homogenous media gradation increases voids volume in a media bed. Finer media is more susceptible to surface clogging.
- Residence Time - Residence time is a function of media gradation, hydraulic loading rate and the media bed depth and configuration. A longer residence time generally improves pollutant removal performance.
- Media Chemical Properties – Filter media can be inert (i.e. sand) or can be selected to target specific pollutants of concern (i.e. activated carbon for trace organics). Chemically active options may be organic, mineral or synthetic or a combination of types. Media should be selected with consideration of the type and load of pollutants requiring removal.
- Pretreatment – Integrate adequate pretreatment facilities into media filter designs to reduce sediment loading and maintenance frequency. The level of pretreatment required is dependent on the tributary drainage area, but typical pretreatment consists of a sedimentation chambers, hydrodynamic separator, vegetated buffer strips, and vegetated swales.
- Vegetation – Choose moisture-tolerant plants that can tolerate both fluctuating water conditions and drought conditions. Guidance on planting and general landscape design is provided in the [Placer County Landscape Design Guidelines](#) (Placer County Planning Services Division, 2013). Refer to fact sheet TR-1 for more information on recommended plant species.

### CONSTRUCTION PHASE CONSIDERATIONS

- Divert flow around the tree box filter to protect it from sediment loads during construction. If sediment does enter the facility during construction, the sediment will require removal after the tributary area has been stabilized. Diverted flow must be managed using temporary BMPs.
- Where underdrains are used, ensure that the minimum slope of the pipe is 0.5 (1/2) percent.
- Once construction is complete, stabilize the entire tributary area to the media filter before allowing runoff to enter the unit.

### SIZING DESIGN GOALS AND REQUIREMENTS

The Post-Construction Storm Water Quality Plan (SWQP) Form 3-5 should be used to calculate the Water Quality Flow (WQF) of tree box filters for Regulated Projects. This value is then used in Form 3-7 to iteratively determine the necessary tree box filter sizing to capture the remainder of the 85<sup>th</sup> percentile, 24-hour design storm not retained by Site Design Measures. The equation for determining the WQF for tree box filters is as follows:

$$WQF = A_{imp} * P_F / 43,200$$

Where:

- WQF = Water Quality Flow (cfs);
- $A_{imp}$  = impervious drainage area untreated by Site Design Measures (ft<sup>2</sup>); and
- $P_F$  = flow based design storm intensity (0.2 inch/hr).

# TREE BOX FILTER

## Fact Sheet TR-3

### MAINTENANCE CONSIDERATIONS

Maintenance activities and frequencies are specific to each manufactured product. Semiannual maintenance is typical and should be performed per manufacturer specifications. Maintenance agreements are available from some manufacturers.

Tree box filters may exhibit decreased effectiveness after a single year of operation, depending on the activities occurring in the drainage area and filter loading. They clog easily when subjected to high sediment loads, and sediment reducing pretreatment practices placed upstream of the filter should be maintained properly to reduce sediment loads into the filter.

Maintenance efforts will need to focus on basic housekeeping practices such as removal of sediment and debris accumulations to prevent clogs and/or ponds of standing water. To minimize the potential for clogging, frequent maintenance and inspection practices are required. Waste sand, gravel, soil, mulch, or filter media must be disposed of properly and in accordance with all applicable laws.

Tree box filters can become a nuisance due to mosquito or midge breeding if not properly designed and maintained. Installations should dewater completely (recommended 72 hour or less residence time) to prevent creating mosquito and other vector habitats.

### AVAILABLE VENDOR PRODUCTS

The names of vendor products listed below are for informational purposes only. Their appearance here is not an endorsement of the products or manufacturers by Placer County.

- DeepRoot® Silva Cell
- Filterra® Bioretention System
- TreePod® Biofilter
- UrbanGreen™ Biofilter



Photo Source: Contech®

### REFERENCES

Alameda Countywide Clean Water Program. C.3 Storm water Technical Guidance, A Handbook for Developers, Builders, and Project Applicants, Version 3.1. 2012. Available online at:

<http://cleanwaterprogram.org/c3-guidance-table/item/c3-guidance-table.html>

California Department of Transportation (Caltrans). 2010. Treatment BMP Technology Report. CTSW-RT-09-239.06. Available online at: [http://www.dot.ca.gov/hq/env/storm\\_water/pdf/CTSW-RT-09-239-06.pdf](http://www.dot.ca.gov/hq/env/storm_water/pdf/CTSW-RT-09-239-06.pdf)

Low Impact Development Center, Inc. 2010. Low Impact Development Manual for Southern California: Technical Guidance and Site Planning Strategies. Available online at: <https://www.casqa.org/resources/lid/socal-lid-manual>

**Appendix C**  
**Source Control Measures Selection Table**

## Source Control Measures Selection Table

Potential Pollutant Source or Activity	Source Control Measure and General Implementation Protocols	CASQA BMP Handbook with Additional Information	CASQA Fact Sheet No.
Accidental spills or leaks	<b>Spill Prevention, Control and Cleanup</b> <ul style="list-style-type: none"> <li>▪ Develop procedures to prevent/mitigate spills to storm drain systems.</li> <li>▪ Develop and standardize reporting procedures, containment, storage, and disposal activities, documentation, and follow-up procedures.</li> <li>▪ Establish procedures and/or controls to minimize spills and leaks.</li> <li>▪ Recycle, reclaim, or reuse materials whenever possible.</li> </ul>	Industrial and Commercial (2014)	SC-11
Interior floor drains	<b>Non-Stormwater Discharges</b> <ul style="list-style-type: none"> <li>▪ Visually inspect and inventory all interior floor drains.</li> <li>▪ Do not connect to MS4. Floor drains should discharge to sumps for pumping and disposal or to the sanitary sewer in compliance with local agency requirements.</li> <li>▪ For redevelopment, identify and disconnect interior floor drains from the MS4.</li> <li>▪ Isolate problem areas and plug illicit discharge points.</li> </ul>	Industrial and Commercial (2014)	SC-10
Parking/Storage Areas and Maintenance	<b>Parking/Storage Area Maintenance</b> <ul style="list-style-type: none"> <li>▪ Encourage advanced designs and maintenance strategies for impervious parking lots.</li> <li>▪ Keep accurate maintenance logs to evaluate BMP implementation.</li> </ul>	Industrial and Commercial (2014)	SC-43
Indoor and structural pest control	<b>Building and Grounds Maintenance</b> <ul style="list-style-type: none"> <li>▪ Follow all federal, state, and local laws and regulations governing the use, storage, and disposal of pesticides.</li> <li>▪ Do not mix, prepare, or apply pesticides near storm drain inlets.</li> <li>▪ Encourage use of Integrated Pest Management techniques for pest control.</li> </ul>	Industrial and Commercial (2014)	SC-41
	<b>Safer Alternative Products</b> <ul style="list-style-type: none"> <li>▪ Use less toxic pesticides that will do the job when applicable. Avoid use of copper-based pesticides if possible.</li> </ul>	Industrial and Commercial (2014)	SC-35
Pools, spas, ponds, decorative fountains, and other water features	<b>Mobile Cleaning - Swimming Pools and Spas</b> <ul style="list-style-type: none"> <li>▪ Never discharge wash water or wastewater from cleaning swimming pools and spas to the driveway, street, gutter, or near a storm drain.</li> </ul>	Industrial and Commercial (2014)	BG-63

Potential Pollutant Source or Activity	Source Control Measure and General Implementation Protocols	CASQA BMP Handbook with Additional Information	CASQA Fact Sheet No.
	<ul style="list-style-type: none"> <li>▪ Follow local regulations for draining swimming pools and spas into the sanitary sewer system.</li> </ul> <p><b>Fountains and Pools Maintenance</b></p> <ul style="list-style-type: none"> <li>▪ Prevent algae problems with regular cleaning, consistent adequate chlorine levels, and well-maintained water filtration and circulation systems.</li> <li>▪ Manage pH and water hardness to minimize corrosion of copper pipes.</li> <li>▪ Do not use copper-based algaecides. Control algae with chlorine or other alternatives, such as sodium bromide.</li> <li>▪ Reduce fertilizer use in areas around the water body. High nitrogen fertilizers may contribute to excessive algae growth.</li> </ul>	Municipal (2003)	SC-72
Landscaping/outdoor pesticide use	<p><b>Building and Grounds Maintenance</b></p> <ul style="list-style-type: none"> <li>▪ Follow all federal, state, and local laws and regulations governing the use, storage, and disposal of fertilizers and pesticides.</li> <li>▪ Use non-toxic chemicals to the maximum extent possible.</li> <li>▪ Encourage use of Integrated Pest Management techniques for pest control.</li> <li>▪ Encourage proper onsite recycling of yard trimmings.</li> <li>▪ Do not use pesticides if rain is expected.</li> <li>▪ Do not mix, prepare, or apply fertilizers and pesticides near storm drain inlets.</li> <li>▪ Use the minimum amount of fertilizer and pesticides needed for the job.</li> <li>▪ Calibrate fertilizer distributors to avoid excessive application.</li> <li>▪ Employ techniques to minimize off-target application (e.g., spray drift) of pesticides, including consideration of alternative application techniques.</li> <li>▪ Apply pesticides only when wind speeds are low.</li> </ul>	Industrial and Commercial (2014)	SC-41
	<p><b>Safer Alternative Products</b></p> <ul style="list-style-type: none"> <li>▪ Use less toxic pesticides that will do the job when applicable. Avoid use of copper-based pesticides if possible.</li> </ul>	Industrial and Commercial (2014)	SC-35
	<p><b>Site Design and Landscape Planning</b></p> <ul style="list-style-type: none"> <li>▪ Integrate and incorporate appropriate landscape planning methodologies into the project design to minimize surface and groundwater contamination from stormwater.</li> </ul>	New Development and Redevelopment (2003)	SD-10

Potential Pollutant Source or Activity	Source Control Measure and General Implementation Protocols	CASQA BMP Handbook with Additional Information	CASQA Fact Sheet No.
	<b>Efficient Irrigation</b> <ul style="list-style-type: none"> <li>▪ Design and implement irrigation methods that minimize runoff of excess irrigation water into the stormwater conveyance system.</li> </ul>	New Development and Redevelopment (2003)	SD-12
Restaurants, grocery stores, and other food service operations	<b>Food Service Facilities</b> <ul style="list-style-type: none"> <li>▪ Minimize exposure of rain and runoff to outdoor cleaning and storage areas by using cover and containment.</li> <li>▪ Use good housekeeping to minimize the generation of pollutants.</li> <li>▪ Make stormwater pollution prevention BMPs a part of standard operating procedures and the employee training program.</li> <li>▪ Provide employee education materials in the first language of employees.</li> </ul>	Industrial and Commercial (2014)	BG-30
	<b>Mobile Cleaning – Food Service Related</b> <ul style="list-style-type: none"> <li>▪ Perform dry cleanup before washing with water.</li> <li>▪ Wash without soaps and solvents.</li> <li>▪ Keep polluted water out of storm drains.</li> <li>▪ Dispose of wastewater correctly and legally</li> </ul>	Industrial and Commercial (2014)	BG-61
Refuse areas	<b>Waste Handling and Disposal</b> <ul style="list-style-type: none"> <li>▪ Cover storage containers with leak proof lids.</li> <li>▪ Cover all waste piles (plastic tarps are acceptable coverage) and prevent stormwater run-on and runoff with a berm.</li> <li>▪ Recycle materials whenever possible.</li> <li>▪ Use the entire product before disposing of the container.</li> <li>▪ Take special care when loading or unloading wastes to minimize losses. Loading systems can be used to minimize spills and fugitive emission losses such as dust or mist. Vacuum transfer systems can minimize waste loss.</li> <li>▪ Use dry methods when possible (e.g., sweeping, use of absorbents. If water must be used after sweeping, collect water and discharge through grease interceptor to the sanitary sewer.</li> </ul>	Industrial and Commercial (2014)	SC-34

Potential Pollutant Source or Activity	Source Control Measure and General Implementation Protocols	CASQA BMP Handbook with Additional Information	CASQA Fact Sheet No.
Industrial Processes	<p><b>Non-Stormwater Discharges</b></p> <ul style="list-style-type: none"> <li>▪ Develop clear protocols and lines of communication for effectively prohibiting non-stormwater discharges, especially those that are not classified as hazardous.</li> <li>▪ Stencil or demarcate storm drains, where applicable, to prevent ignorant, unintentional, and illegal disposal of pollutants. Storm drain inlets should have messages such as “Dump No Waste Drains to Stream” or similar.</li> <li>▪ Manage and control sources of water such as hose bibs, faucets, wash racks, irrigation heads, etc. Identify hoses and faucets in the SWPPP, and post signage for appropriate use.</li> </ul>	Industrial and Commercial (2014)	SC-10
Outdoor storage of equipment or materials	<p><b>Outdoor Loading/Unloading</b></p> <ul style="list-style-type: none"> <li>▪ Park tank trucks or delivery vehicles in designated areas so that spills or leaks can be contained.</li> <li>▪ Limit exposure of material to rainfall whenever possible.</li> <li>▪ Prevent stormwater run-on.</li> <li>▪ Check equipment regularly for leaks.</li> </ul>	Industrial and Commercial (2014)	SC-30
	<p><b>Outdoor Liquid Container Storage</b></p> <ul style="list-style-type: none"> <li>▪ Educate employees about pollution prevention measures and goals.</li> <li>▪ Keep an accurate, up-to-date inventory of the materials delivered and stored onsite.</li> <li>▪ Try to keep chemicals in their original containers, and keep them well labeled.</li> <li>▪ Develop an operations plan that describes procedures for loading and/or unloading.</li> <li>▪ Protect materials from rainfall, run-on, runoff, and wind dispersal.</li> </ul>	Industrial and Commercial (2014)	SC-31
	<p><b>Outdoor Equipment Operations</b></p> <ul style="list-style-type: none"> <li>▪ Perform the activity during dry periods whenever possible.</li> <li>▪ Install secondary containment measures where leaks and spills may occur.</li> <li>▪ Use non-toxic chemicals for maintenance and minimize or eliminate the use of solvents.</li> <li>▪ Connect process equipment area to public sanitary sewer or facility wastewater treatment system. Do not connect drains from secondary containment areas to the storm drain.</li> </ul>	Industrial and Commercial (2014)	SC-32

Potential Pollutant Source or Activity	Source Control Measure and General Implementation Protocols	CASQA BMP Handbook with Additional Information	CASQA Fact Sheet No.
Outdoor storage of equipment or materials (cont.)	<p><b>Outdoor Storage of Raw Materials</b></p> <ul style="list-style-type: none"> <li>▪ Emphasize employee education for successful BMP implementation.</li> <li>▪ Store materials that could contaminate stormwater inside or under permanent cover and bermed to prevent stormwater contact.</li> <li>▪ Elevate and tarp solid materials such as beams, metal, etc.</li> <li>▪ Minimize the inventory of raw materials kept outside.</li> <li>▪ Keep an accurate, up-to-date inventory of the materials delivered and stored on-site.</li> <li>▪ Stormwater runoff that could potentially be contaminated by materials stored outdoors should be drained to the sanitary sewer. The drain must have a positive control such as a lock, valve, or plug to prevent release of contaminated liquids.</li> </ul>	Industrial and Commercial (2014)	SC-33
Vehicle and equipment cleaning	<p><b>Vehicle and Equipment Cleaning</b></p> <ul style="list-style-type: none"> <li>▪ If possible, use properly maintained off-site commercial washing and steam cleaning businesses whenever possible.</li> <li>▪ Use dry cleaning methods to remove debris and sweep area when possible.</li> <li>▪ Good housekeeping practices can minimize the risk of contamination from wash water discharges.</li> <li>▪ Use biodegradable, phosphate-free detergents for washing vehicles as appropriate.</li> <li>▪ Emphasize the connection between the storm drain system and runoff, help reinforce that vehicle and equipment washing activities affect local water quality through storm drain stenciling programs.</li> <li>▪ Map on-site storm drain locations to avoid discharges to the storm drain system.</li> <li>▪ Designate specific wash area with clarifier or place wash areas away from storm drain connections.</li> </ul>	Industrial and Commercial (2014)	SC-21
Vehicle and equipment repair and maintenance	<p><b>Vehicle and Equipment Repair</b></p> <ul style="list-style-type: none"> <li>▪ Designate a vehicle maintenance area designed to prevent stormwater pollution.</li> <li>▪ Minimize contact of stormwater with outside operations through berming and appropriate drainage routing.</li> <li>▪ Keep accurate maintenance logs to evaluate materials removed and improvements made.</li> </ul>	Industrial and Commercial (2014)	SC-22

Potential Pollutant Source or Activity	Source Control Measure and General Implementation Protocols	CASQA BMP Handbook with Additional Information	CASQA Fact Sheet No.
	<ul style="list-style-type: none"> <li>▪ Switch to non-toxic chemicals for maintenance when possible.</li> <li>▪ Choose cleaning agents that can be recycled.</li> <li>▪ Use drop cloths and drip pans.</li> </ul>		
Fuel dispensing areas	<p><b>Vehicle and Equipment Fueling</b></p> <ul style="list-style-type: none"> <li>▪ Use properly maintained off-site fueling stations whenever possible.</li> <li>▪ Focus pollution prevention activities on containment of spills and leaks, most of which may occur during liquid transfers.</li> </ul>	Industrial and Commercial (2014)	SC-20
Loading docks	<p><b>Outdoor Loading/Unloading</b></p> <ul style="list-style-type: none"> <li>▪ Develop an operations plan that describes procedures for loading and/or unloading.</li> <li>▪ Conduct loading and unloading in dry weather if possible.</li> <li>▪ Cover designated loading/unloading areas to reduce exposure of materials to rain.</li> <li>▪ Consider placing a seal or door skirt between delivery vehicles and building to prevent exposure to rain.</li> <li>▪ Design loading/unloading area to prevent stormwater run-on, which would include grading or berming the area, and position roof downspouts so they direct stormwater away from the loading/unloading areas.</li> <li>▪ Pave loading areas with concrete instead of asphalt.</li> <li>▪ Avoid placing storm drains inlets in the area.</li> <li>▪ Grade and/or berm the loading/unloading area with drainage to sump; regularly remove materials accumulated in sump.</li> </ul>	Industrial and Commercial (2014)	SC-30
Fire sprinkler test water	<p><b>Non-Stormwater Discharges</b></p> <ul style="list-style-type: none"> <li>▪ Develop a plan to eliminate discharge to the storm drain system.</li> </ul>	Industrial and Commercial (2014)	SC-10
	<p><b>Building and Grounds Maintenance</b></p> <ul style="list-style-type: none"> <li>▪ Dispose fire sprinkler line test water into the sanitary sewer.</li> <li>▪ Do not allow discharge to storm drain or infiltration due to potential high levels of pollutants in fire sprinkler line water.</li> </ul>	Industrial and Commercial (2014)	SC-41
Drain or wash water from boiler drain lines, condensate drain lines, rooftop equipment, drainage sumps, and other sources	<p><b>Non-Stormwater Discharges</b></p> <ul style="list-style-type: none"> <li>▪ Manage and control sources of water from drain lines.</li> <li>▪ Eliminate discharge of water from drain lines to the storm drain system.</li> <li>▪ Repair drain line leaks immediately.</li> </ul>	Industrial and Commercial (2014)	SC-10

Potential Pollutant Source or Activity	Source Control Measure and General Implementation Protocols	CASQA BMP Handbook with Additional Information	CASQA Fact Sheet No.
Drain or wash water from boiler drain lines, condensate drain lines, rooftop equipment, drainage sumps, and other sources (cont.)	<p><b>Building and Grounds Maintenance</b></p> <ul style="list-style-type: none"> <li>▪ In situations where soaps or detergents are used and the surrounding area is paved, use a water collection device that enables collection of wash water and associated solids for subsequent removal and proper disposal.</li> <li>▪ If soaps or detergents are not used, and the surrounding area is paved, wash runoff does not have to be collected but must be screened.</li> <li>▪ If washing on a grassed area (with or without soap), runoff must be dispersed as sheet flow as much as possible, rather than as a concentrated stream. The wash runoff must remain on the grass and not drain to pavement.</li> </ul>	Industrial and Commercial (2014)	SC-41
Unauthorized non-storm water discharges	<p><b>Non-Stormwater Discharges</b></p> <ul style="list-style-type: none"> <li>▪ Effectively eliminate unauthorized non-stormwater discharges to the storm water drainage system through implementation of measures to detect, correct, and enforce against illicit connections and illegal discharges of pollutants onto streets and into the storm drain system and downstream water bodies.</li> </ul>	Industrial and Commercial (2014)	SC-10
Building and grounds maintenance	<p><b>Building and Grounds Maintenance</b></p> <ul style="list-style-type: none"> <li>▪ Switch to non-toxic chemicals for maintenance to the maximum extent possible.</li> <li>▪ Choose cleaning agents that can be recycled.</li> <li>▪ Encourage proper lawn management and landscaping, including use of native vegetation.</li> <li>▪ Encourage use of Integrated Pest Management techniques for pest control.</li> <li>▪ Encourage proper onsite recycling of yard trimmings.</li> <li>▪ Recycle residual paints, solvents, lumber, and other material as much as possible.</li> </ul>	Industrial and Commercial (2014)	SC-41

**Appendix D**  
**SWQP Examples**

# **Small Project**

# Post-Construction Storm Water Quality Plan

For:

**Doe Residence**

**Placer County, California**

APN: 000-0000-001

Prepared for:

**John Doe**

**Owner**

**12345 X St.**

**Placer City, CA 99999**

**555-555-5555**

Prepared by:

**Residential Engineers, Inc.**

**12345 Y St**

**Placer City, CA 99999**

**555-555-6666**

Preparation Date: **May 1 , 2017**

Approval Date: \_\_\_\_\_

## Section 1 General Project Information

The undersigned owner of the subject property, is responsible for the implementation of the provisions of this Storm Water Quality Plan (SWQP), including ongoing operations and maintenance (O&M), consistent with the requirements of the East Placer Storm Water Quality Design Manual and the State of California Phase II Small MS4 General Permit (Order No: 2013-0001-DWQ). If the undersigned transfers its interest in the property, its successors-in-interest shall bear the aforementioned responsibility to implement the SWQP.

For all Regulated Projects (As identified in Form 1-2 below), the undersigned owner hereby grants access to all representatives of Placer County for the sole purpose of performing O&M inspections of the installed treatment system(s) and hydromodification control(s) if any.

A copy of the final signed and fully approved SWQP shall be available on the subject site for the duration of construction and then stored with the project approval documentation and improvement plans in perpetuity.

<b>Form 1-1 Project Identification and Owner's Certification</b>		
Project Site Address:	44 X St., Placer City, CA 99999	
<b>Owner Name:</b>	John Doe	
Title	Owner	
Company	0	
Address	12345 X St.	
City, State, Zip Code	Placer City, CA 99999	
Email	<a href="mailto:jdoe@network.com">jdoe@network.com</a>	
Telephone #	555-555-5555	
Signature	Date	
<b>Engineer:*</b>	NA - Small Project	<b>PE Stamp*</b> (Required for all Regulated Projects)
Title		
Company	Residential Engineers, Inc.	
Address	12345 Y St	
City, State, Zip Code	Placer City, CA 99999	
Email		
Telephone #	555-555-6666	
Signature		
Brief Description of Project:  (Attach additional sheets as necessary)	3,000 sq ft detached single family home that is not part of a larger scale of development.	

\* Not required for Small Projects as determined in Form 1-2 below. Project owners are responsible for ensuring that all storm water facilities are designed by an appropriately licensed and qualified professional.

## Form 1-2 Project Category

### Development Category

(Indicate project category by checking the appropriate box and enter corresponding impervious area)

<sup>1</sup> <b>Small Project</b> – All projects, except LUPs, that create and/or replace between 2,500-5,000 ft <sup>2</sup> of impervious surface or detached single family homes that create and/or replace 2,500 ft <sup>2</sup> or more of impervious surface and are not part of a larger plan of development.	X
<sup>2</sup> Enter total new and/or replaced impervious surface (ft <sup>2</sup> )	3000
<sup>3</sup> <b>Regulated Project</b> – All projects that create and/or replace 5,000 ft <sup>2</sup> or more of impervious surface.	
<sup>4</sup> <b>Regulated Redevelopment Project</b> with equal to, or greater than 50 percent increase in impervious area	
<sup>5</sup> <b>Regulated Redevelopment Project</b> with less than 50 percent increase in impervious area	
<sup>6</sup> Enter total pre-project impervious surface (ft <sup>2</sup> )	
<sup>7</sup> Enter total new and/or replaced impervious surface (ft <sup>2</sup> )	
<sup>8</sup> <b>Regulated Road or linear underground/overhead project (LUP)</b> creating 5,000 ft <sup>2</sup> or more of newly constructed contiguous impervious surface.	
<sup>9</sup> Enter total new and/or replaced impervious surface (ft <sup>2</sup> )	
<sup>10</sup> <b>Regulated Hydromodification Management Project</b> – Regulated projects that create and/or replace 1 acre or more of impervious surface. A project that does not increase impervious surface area over the pre-project condition is not a hydromodification management project.	
<sup>11</sup> Enter total new and/or replaced impervious surface (ft <sup>2</sup> )	

## Section 2 Small Projects

### Form 2-1 Site Assessment and Layout Documentation

	Has this Item been considered in the Site Layout and depicted in the Site Plan?	
	Yes	Not Applicable (Include brief explanation)
Define the development envelope and protected areas, identifying areas that are most suitable for development and areas to be landscaped , or left undisturbed, and used for infiltration and/or snow storage.	X	
Minimize overall impervious coverage (paving and roofs) of the site.	X	
Set back development from creeks, wetlands, and riparian habitats in accordance with local ordinances.		No creeks on site
Preserve significant trees and native vegetation.	X	
Conform site layout along natural landforms.	X	
Avoid excessive grading and disturbance of vegetation and soils and stabilize disturbed areas.	X	
Replicate the site's natural drainage patterns.	X	

**Attach a Site Plan that incorporates the applicable considerations above. Ensure that the following items are included in the Site Plan:**

- Site Boundary
- Topographic data with 1 ft. contours (5 ft. contours are acceptable on steeper sites).
- Existing natural hydrologic features (depressions, watercourses, wetlands, riparian corridors)
- Environmentally sensitive areas and areas to be preserved.
- Proposed locations and footprints of improvements creating new, or replaced, impervious surfaces
- Proposed snow storage areas
- Proposed site drainage with flow directions and site run-on and discharge locations
- Proposed Site Design Measures to reduce runoff

<b>Form 2-2 Runoff Reduction Calculator for Site Design Measures on Small Projects</b>				
<sup>1</sup> Project Site Elevation (ft. above seal level)	6500			
<b>Site Design Measure</b>	<b>Runoff Reduction Parameters</b>			<b>Runoff Reduction (ft<sup>3</sup>)</b>
<sup>2</sup> Adjacent/On-Site Stream Setbacks and Buffers	A <sub>imp</sub> (ft <sup>2</sup> )	impervious drainage area		0
	V <sub>85</sub> (in)	runoff volume from 85th percentile, 24-hour storm	1.1	
<sup>3</sup> Soil Quality Improvement and Maintenance	A <sub>pond</sub> (ft <sup>2</sup> )	ponding area		0
	D <sub>pond</sub> (ft)	ponding depth		
	A <sub>sa</sub> (ft <sup>2</sup> )	soil amendment area		
	D <sub>sa</sub> (ft)	depth of amended soil		
	n	porosity of amended soil		
<sup>4</sup> Tree Planting and Preservation	n <sub>e</sub>	number of new evergreen trees		0
	n <sub>d</sub>	number of new deciduous trees		
	A <sub>tc</sub> (ft <sup>2</sup> )	Canopy area of existing trees to remain on the property		
	V <sub>85</sub> (in)	runoff volume from 85th percentile, 24-hour storm	1.1	
<sup>5</sup> Rooftop and Impervious Area Disconnection	A <sub>imp</sub> (ft <sup>2</sup> )	impervious drainage area	1500	135
	V <sub>85</sub> (in)	runoff volume from 85th percentile, 24-hour storm	1.1	
<sup>6</sup> Porous Pavement	A <sub>res</sub> (ft <sup>2</sup> )	area of gravel storage layer		0
	D <sub>res</sub> (ft)	depth of gravel storage layer		
	n <sub>agg</sub>	porosity of aggregate		
	C	efficiency factor		
<sup>7</sup> Vegetated Swales	A <sub>imp</sub> (ft <sup>2</sup> )	impervious drainage area		0
	V <sub>85</sub> (in)	runoff volume from 85th percentile, 24-hour storm	1.1	
<sup>8</sup> Infiltration Trenches	L (ft)	trench length		0
	W (ft)	trench width		
	D (ft)	trench depth		
<sup>9</sup> Dry Wells and Underground Infiltration Facilities	V (ft <sup>3</sup> )	combined volume of all dry wells and underground infiltration facilities (include supporting design documentation)		0
<sup>10</sup> Rain Barrels and Cisterns	N	number of rain barrels and/or cisterns		0
	V <sub>a</sub> (ft <sup>3</sup> )	volume of each rain barrel and/or cistern		
			<sup>11</sup> Total Volume Reduction (ft <sup>3</sup> )	<b>135</b>
			<sup>12</sup> Effective Treated Impervious Area (ft <sup>2</sup> )	<b>1667</b>
<b>85th Percentile, 24 Hour Design Storm Depth</b>				
Elevation <6000 feet = 1.1 inch				
Elevation 6,000-6,500 feet = 1.2 inch				
Elevation 6,500-7,000 feet = 1.3 inch				
Elevation > 7,000 = 1.4 inch				

# **Regulated Project**

# Post-Construction Storm Water Quality Plan

For:

**Commercial Project No. 1**

**Placer County, California**

Planning Permit No. 1, Improvement Plan No. 1, Grading Permit No. 1, Building Permit No. 1

APN: 000-0000-001

Prepared for:

Joe Jones

President

Development Inc.

100 C St.

Sacramento, CA 95899

916-567-5555

Prepared by:

Development Inc.

100 C St.

Sacramento, CA 95899

916-567-5555

Preparation Date: May 1, 2017

Approval Date: \_\_\_\_\_

## Section 1 General Project Information

The undersigned owner of the subject property, is responsible for the implementation of the provisions of this Storm Water Quality Plan (SWQP), including ongoing operations and maintenance (O&M), consistent with the requirements of the East Placer Storm Water Quality Design Manual and the State of California Phase II Small MS4 General Permit (Order No: 2013-0001-DWQ). If the undersigned transfers its interest in the property, its successors-in-interest shall bear the aforementioned responsibility to implement the SWQP.

For all Regulated Projects (As identified in Form 1-2 below), the undersigned owner hereby grants access to all representatives of Placer County for the sole purpose of performing O&M inspections of the installed treatment system(s) and hydromodification control(s) if any.

A copy of the final signed and fully approved SWQP shall be available on the subject site for the duration of construction and then stored with the project approval documentation and improvement plans in perpetuity.

<b>Form 1-1 Project Identification and Owner's Certification</b>		
Project Site Address:	123 Gold St., Placer City, CA 99999	
<b>Owner Name:</b>	Joe Jones	
Title	President	
Company	Development Inc.	
Address	100 C St.	
City, State, Zip Code	Sacramento, CA 95899	
Email	<a href="mailto:jj@myemail.com">jj@myemail.com</a>	
Telephone #	916-567-5555	
Signature	Date	
<b>Engineer:*</b>	Frank N. Storm	<b>PE Stamp*</b> (Required for all Regulated Projects)
Title	Civil Engineer	
Company	Development Inc.	
Address	100 C St.	
City, State, Zip Code	Sacramento, CA 95899	
Email	<a href="mailto:Frank@email.com">Frank@email.com</a>	
Telephone #	916-567-5555	
Signature		
Brief Description of Project:  (Attach additional sheets as necessary)	New office building and parking lot.	

\* Not required for Small Projects as determined in Form 1-2 below. Project owners are responsible for ensuring that all storm water facilities are designed by an appropriately licensed and qualified professional.

## Form 1-2 Project Category

### Development Category

(Indicate project category by checking the appropriate box and enter corresponding impervious area)

<sup>1</sup> <b>Small Project</b> – All projects, except LUPs, that create and/or replace between 2,500-5,000 ft <sup>2</sup> of impervious surface or detached single family homes that create and/or replace 2,500 ft <sup>2</sup> or more of impervious surface and are not part of a larger plan of development.	
<sup>2</sup> Enter total new and/or replaced impervious surface (ft <sup>2</sup> )	
<sup>3</sup> <b>Regulated Project</b> – All projects that create and/or replace 5,000 ft <sup>2</sup> or more of impervious surface.	X
<sup>4</sup> <b>Regulated Redevelopment Project</b> with equal to, or greater than 50 percent increase in impervious area	
<sup>5</sup> <b>Regulated Redevelopment Project</b> with less than 50 percent increase in impervious area	
<sup>6</sup> Enter total pre-project impervious surface (ft <sup>2</sup> )	0
<sup>7</sup> Enter total new and/or replaced impervious surface (ft <sup>2</sup> )	9225
<sup>8</sup> <b>Regulated Road or linear underground/overhead project (LUP)</b> creating 5,000 ft <sup>2</sup> or more of newly constructed contiguous impervious surface.	
<sup>9</sup> Enter total new and/or replaced impervious surface (ft <sup>2</sup> )	
<sup>10</sup> <b>Regulated Hydromodification Management Project</b> – Regulated projects that create and/or replace 1 acre or more of impervious surface. A project that does not increase impervious surface area over the pre-project condition is not a hydromodification management project.	
<sup>11</sup> Enter total new and/or replaced impervious surface (ft <sup>2</sup> )	

## Section 3 Regulated Projects

**Section 3 forms are to be completed for all Regulated Projects.**

### Form 3-1 Site Location and Hydrologic Features

Site coordinates:  <i>Take GPS measurement at approximate center of site</i>	<sup>1</sup> Latitude  xx.xxxx	<sup>2</sup> Longitude  xxx.xxxx	<sup>3</sup> Elevation (ft. above sea level)  6500	<sup>4</sup> 85th Percentile, 24 Hour Design Storm Depth (in):  1.2
--	--------------------------------------	--	--	---

<sup>5</sup> Receiving waters <i>Name of stream, lake or other downstream waterbody to which the site runoff eventually drains</i>	Truckee River
---	---------------


<sup>6</sup> 303(d) listed pollutants of concern <i>Refer to State Water Resources Control Board website <a href="http://www.waterboards.ca.gov/water_issues/programs/water_quality_assessment/#impaired">www.waterboards.ca.gov/water_issues/programs/water_quality_assessment/#impaired</a></i>	Sediment
--	----------

<sup>7</sup> Is Project going to be phased? <i>If yes, ensure that the SWQP evaluates each phase with distinct DMAs, requiring LID BMPs to address runoff at time of completion.</i>	No
---	----

<sup>8</sup> Use this form to show a conceptual schematic depicting DMAs and conveyance features connecting DMAs to the site outlet(s). An example is provided below that can be modified for the proposed project or a drawing clearly showing DMAs and flow routing may be attached.

**Example only**

**Modify for project specific SWQP  
Use separate sheet if necessary**

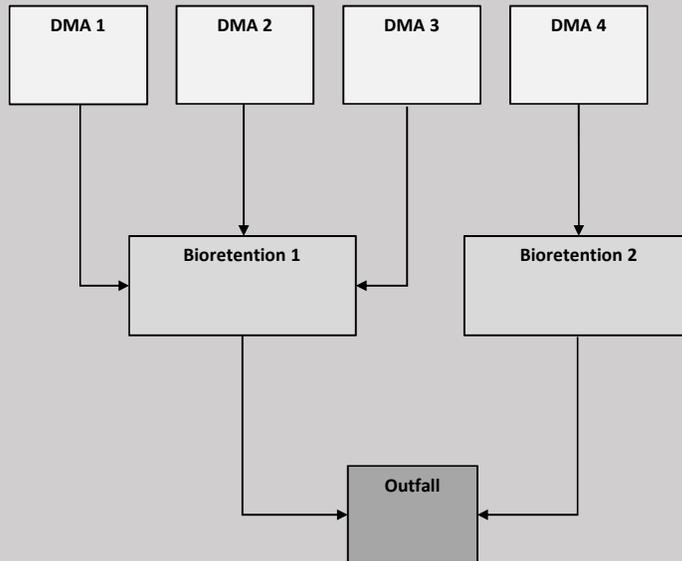


**Form 3-2 Site Assessment and Layout Documentation**


	Has this Item been considered in the Site Layout and depicted in the Site Plan?	
	Yes	Not Applicable (Include brief explanation)
Define the development envelope and protected areas, identifying areas that are most suitable for development and areas to be landscaped , or left undisturbed, and used for infiltration and/or snow storage.	X	
Concentrate development on portions of the site with less permeable soils and preserve areas that can promote infiltration.	X	
Limit overall impervious coverage of the site with paving and roofs.	X	
Set back development from creeks, wetlands, and riparian habitats.	X	
Preserve significant trees.	X	
Conform site layout along natural landforms.	X	
Avoid excessive grading and disturbance of vegetation and soils.	X	
Replicate the site's natural drainage patterns.	X	
Detain and retain runoff throughout the site.	X	

**Attach a Site Plan that incorporates the applicable considerations above. Ensure that the following items are included in the Site Plan:**

- Site Boundary
- Soil types and areal extents, test pit and infiltration test locations
- Topographic data with 1 ft. contours
- Existing natural hydrologic features (depressions, watercourses, wetlands, riparian corridors)
- Environmentally sensitive areas and areas to be preserved.
- Proposed locations and footprints of improvements creating new, or replaced, impervious surfaces
- Potential pollutant sources and locations
- Entire site divided into separate DMAs with unique identifiers
- Existing and proposed site drainage network with flow directions and site run-on and discharge locations
- Proposed design features and surface treatments used to minimize imperviousness and reduce runoff including snow storage areas
- Proposed locations and footprints of treatment and hydromodification management facilities
- Design features for managing authorized non-stormwater discharges
- Areas of soil and/or groundwater contamination
- Existing utilities and easements
- Maintenance areas

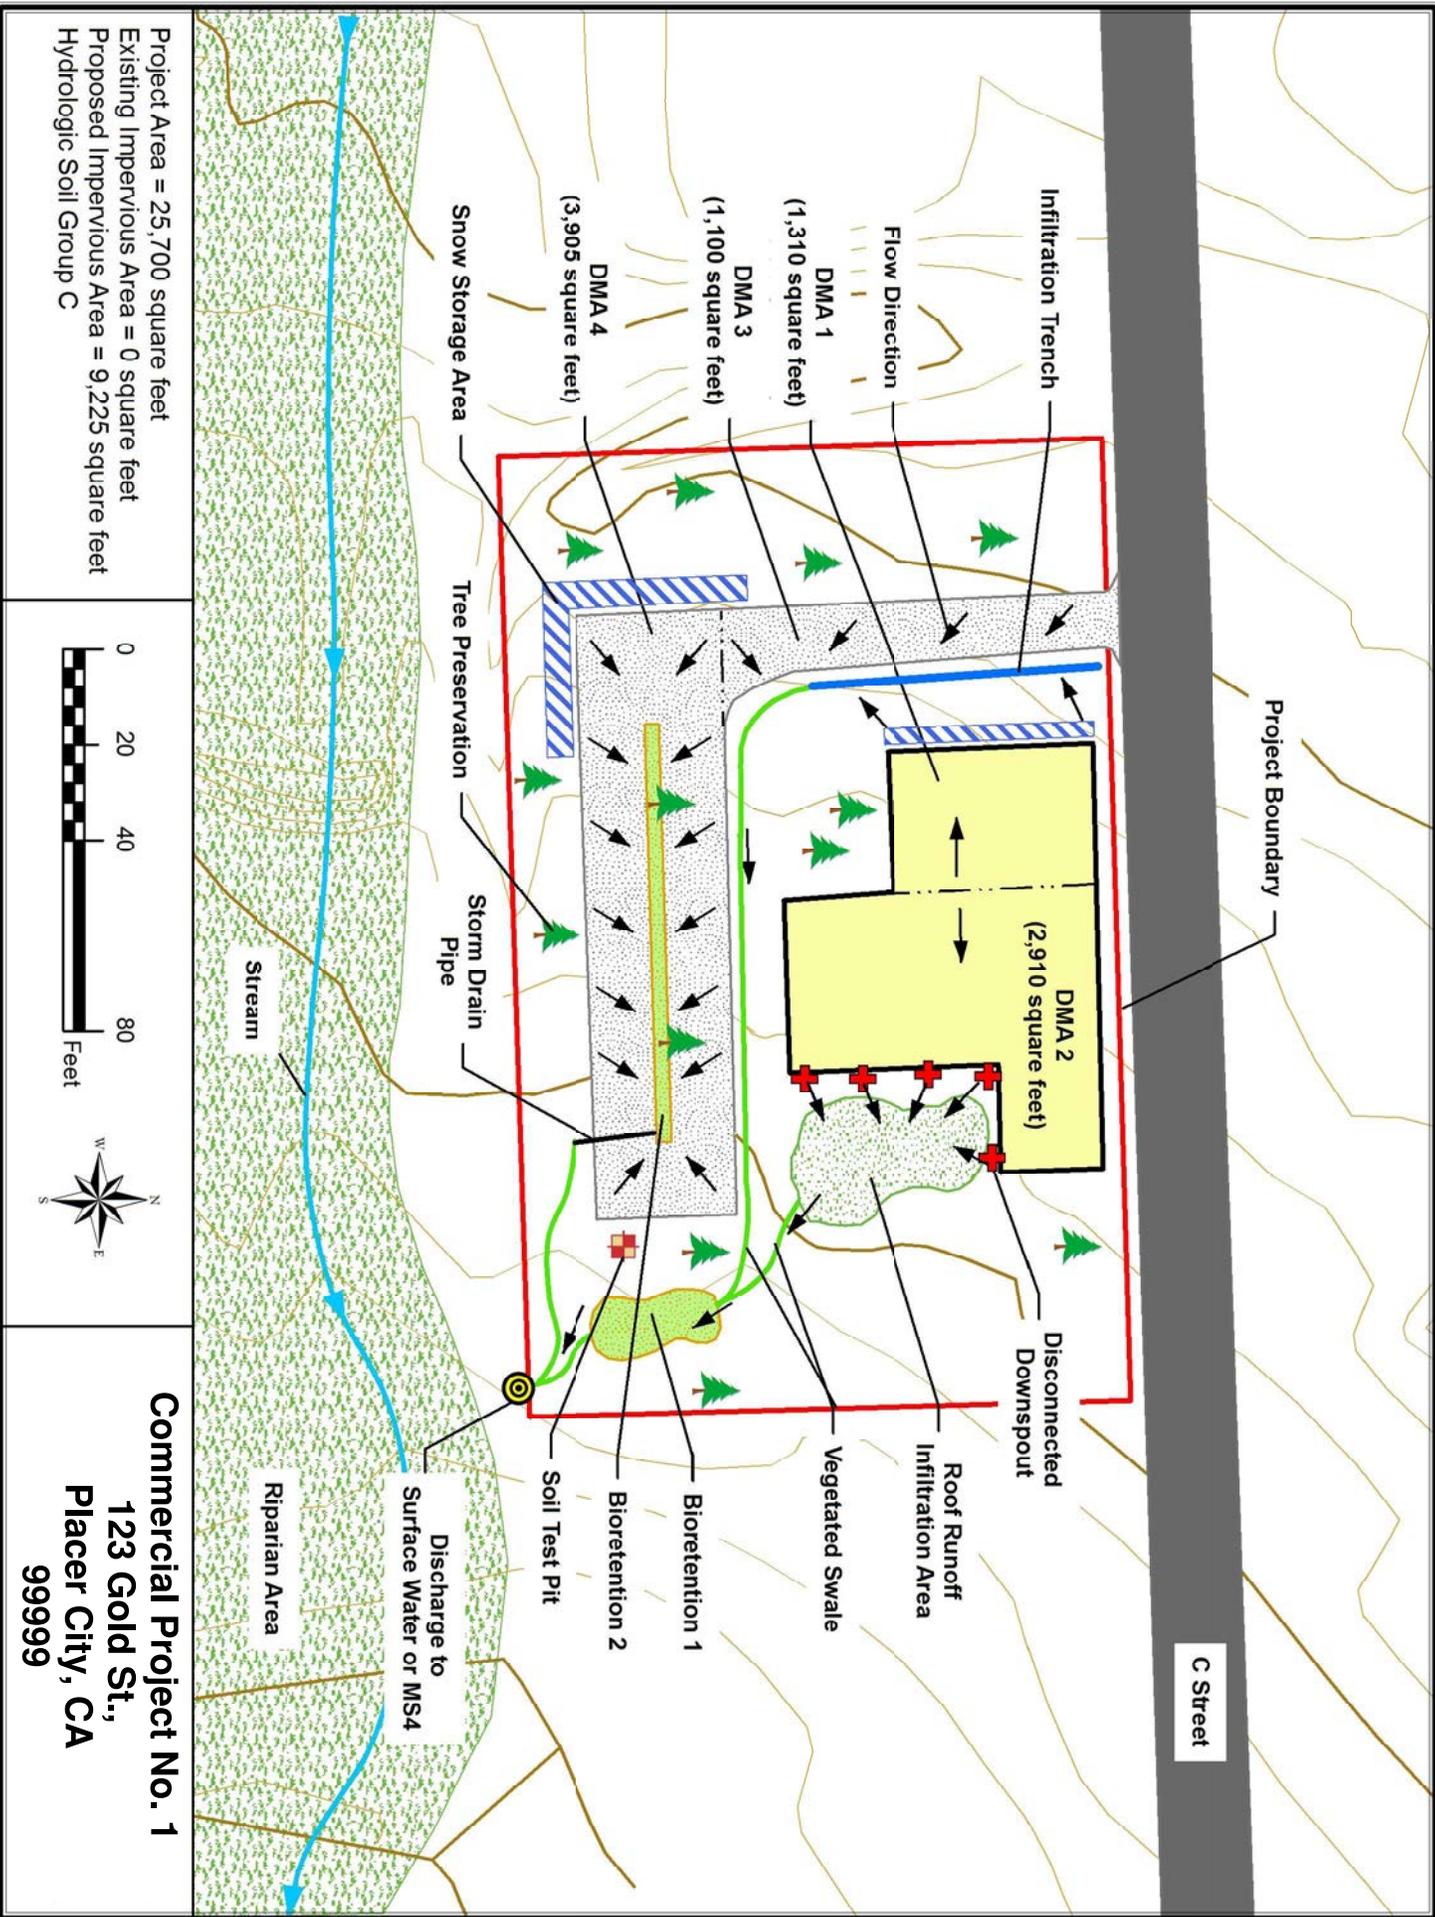

Project Area = 25,700 square feet  
 Existing Impervious Area = 0 square feet  
 Proposed Impervious Area = 9,225 square feet  
 Hydrologic Soil Group C



**Commercial Project No. 1**  
 123 Gold St.,  
 Placer City, CA  
 99999

Form 3-3 Source Control Measures			
Potential Pollutant Generating Activity or Source	Check One		Describe the source control measures to be implemented for each potential pollutant generating activity or source present on the project as listed in Appendix C and in the CASQA Fact Sheets. Include any special features, materials, or methods of construction that will be used.
	Present	Not Applicable	
Accidental spills or leaks	<input checked="" type="checkbox"/>	<input type="checkbox"/>	All materials will be stored inside and properly sealed
Interior floor drains	<input checked="" type="checkbox"/>	<input type="checkbox"/>	Floor drains in basement connect to sanitary sewer.
Parking/storage areas and maintenance	<input checked="" type="checkbox"/>	<input type="checkbox"/>	Parking lot to be swept monthly.
Indoor and structural pest control	<input checked="" type="checkbox"/>	<input type="checkbox"/>	All materials will be stored inside and properly sealed
Pools, spas, ponds, decorative fountains, and other water features	<input type="checkbox"/>	<input checked="" type="checkbox"/>	
Landscape/outdoor pesticide use	<input checked="" type="checkbox"/>	<input type="checkbox"/>	All manufacturer recommendations and regulations will be followed. Minimum amounts will be used.
Restaurants, grocery stores, and other food service operations	<input type="checkbox"/>	<input checked="" type="checkbox"/>	
Refuse areas	<input checked="" type="checkbox"/>	<input type="checkbox"/>	Trach bins to be closed and locked.
Industrial Processes	<input type="checkbox"/>	<input checked="" type="checkbox"/>	
Outdoor storage of equipment or materials	<input type="checkbox"/>	<input checked="" type="checkbox"/>	
Vehicle and equipment cleaning	<input type="checkbox"/>	<input checked="" type="checkbox"/>	
Vehicle and equipment repair and maintenance	<input type="checkbox"/>	<input checked="" type="checkbox"/>	
Fuel dispensing areas	<input type="checkbox"/>	<input checked="" type="checkbox"/>	
Loading docks	<input type="checkbox"/>	<input checked="" type="checkbox"/>	
Fire sprinkler test water	<input checked="" type="checkbox"/>	<input type="checkbox"/>	To be disposed in sanitary sewer.
Drain or wash water from boiler drain lines, condensate drain lines, rooftop equipment, drainage sumps, and other sources	<input checked="" type="checkbox"/>	<input type="checkbox"/>	To be disposed in sanitary sewer.
Unauthorized non-storm water discharges	<input type="checkbox"/>	<input checked="" type="checkbox"/>	
Building and grounds maintenance	<input checked="" type="checkbox"/>	<input type="checkbox"/>	Landscape maintenance to use minimal fertilizers.

The source control measures identified in this table shall be designed consistent with recommendations from the CASQA Stormwater BMP Handbook for New Development and Redevelopment<sup>1</sup>, or from another equivalent manual.

<sup>[1]</sup> California Stormwater BMP Handbook New Development and Redevelopment. California Stormwater Quality Association (CASQA). January 2003.

Form 3-4 Runoff Reduction Calculator for Site Design Measures on Regulated Projects										
		<sup>1</sup> DMA ID No.	1		2		3		4	
Site Design Measure	Runoff Reduction Parameters			Runoff Reduction (ft <sup>3</sup> )						
<sup>2</sup> Adjacent/On-Site Stream Setbacks and Buffers	A <sub>imp</sub> (ft <sup>2</sup> )	impervious drainage area		0						
	V <sub>85</sub> (in)	runoff volume from 85th percentile, 24-hour storm	1.1	0	1.1	0	1.1	0	1.1	
<sup>3</sup> Soil Quality Improvement and Maintenance	A <sub>pond</sub> (ft <sup>2</sup> )	ponding area								
	D <sub>pond</sub> (ft)	ponding depth								
	A <sub>sa</sub> (ft <sup>2</sup> )	soil amendment area		0		0		0		
	D <sub>sa</sub> (ft)	depth of amended soil								
<sup>4</sup> Tree Planting and Preservation	n	porosity of amended soil								
	n <sub>e</sub>	number of new evergreen trees						2		
	n <sub>d</sub>	number of new deciduous trees								
	A <sub>ec</sub> (ft <sup>2</sup> )	canopy area of existing trees to remain on the property		0		0		0		
<sup>5</sup> Rooftop and Impervious Area Disconnection	V <sub>85</sub> (in)	runoff volume from 85th percentile, 24-hour storm	1.1		1.1		1.1		1.1	
	A <sub>imp</sub> (ft <sup>2</sup> )	impervious drainage area		0	2500		0		0	
<sup>6</sup> Porous Pavement	V <sub>85</sub> (in)	runoff volume from 85th percentile, 24-hour storm	1.1		1.1	225	1.1	0	1.1	
	A <sub>res</sub> (ft <sup>2</sup> )	area of gravel storage layer								
	D <sub>res</sub> (ft)	depth of gravel storage layer		0		0		0		
	n <sub>agg</sub>	porosity of aggregate								
<sup>7</sup> Vegetated Swales	C	efficiency factor								
	A <sub>imp</sub> (ft <sup>2</sup> )	impervious drainage area	1310				1000			
<sup>8</sup> Infiltration Trenches	V <sub>85</sub> (in)	runoff volume from 85th percentile, 24-hour storm	1.1	118	1.1	0	1.1	90	1.1	
	L (ft)	trench length								
<sup>9</sup> Dry Wells and Underground Infiltration Facilities	W (ft)	trench width		0		0		0		
	D (ft)	trench depth								
<sup>10</sup> Rain Barrels and Cisterns	V (ft <sup>3</sup> )	combined volume of all dry wells and underground infiltration facilities (include supporting design documentation)		0		0		0		
	N	number of rain barrels and/or cisterns	10			0		0		
	V <sub>s</sub> (ft <sup>3</sup> )	volume of each rain barrel and/or cistern	50	250		0		0		
<sup>11</sup> Do all Site Design Measures meet the design requirements outlined in the Fact Sheets?					Yes	X	No			
<sup>12</sup> Total Volume Reduction (ft <sup>3</sup> )				368		225		90		
<sup>13</sup> Effective Treated Impervious Area (ft <sup>2</sup> )				4088		2500		1000		



### Form 3-6 Volume-Based Infiltrating Bioretention Measures

<sup>1</sup> DMA ID No. <i>If combining multiple DMAs from Form 3-5, enter a new unique DMA ID No.</i>	DMA 1-3	DMA 4		
<sup>2</sup> WQV (ft <sup>3</sup> ) <i>Item 5 in Form 3-5</i> <i>If combining multiple DMAs from Form 3-5, enter the sum of their respective WQVs.</i>	113	238		
<sup>3</sup> Surface Loading Rate <i>Maximum 5.0 in/hr</i>	5	5		
<sup>4</sup> BMP Surface Area (ft <sup>2</sup> ) <i>Top of BMP</i>	180	225		
<sup>5</sup> Infiltration rate of underlying soils (in/hr)	0.12	0.12		
<sup>6</sup> Maximum ponding depth (ft) <i>BMP specific, see BMP design details</i>	0.5	0.5		
<sup>7</sup> Ponding Depth (ft) <i>d<sub>BMP</sub> = Minimum of (1/12 * Item 5 * 48 hrs) or Item 6</i>	0.5	0.5	-	-
<sup>8</sup> Infiltrating surface area, SA <sub>BMP</sub> (ft <sup>2</sup> ) <i>Bottom of BMP</i>	95	225		
<sup>9</sup> Planting media depth, d <sub>media</sub> (ft)	1.5	1.5		
<sup>10</sup> Planting media porosity	0.30	0.30		
<sup>11</sup> Gravel depth, d <sub>media</sub> (ft) <i>Only included in certain BMP types</i>	1.0	1.0		
<sup>12</sup> Gravel porosity	0.30	0.30		
<sup>13</sup> Retention Volume (ft <sup>3</sup> ) <i>V<sub>retention</sub> = Item 8 * [Item 7 + (Item 9 * Item 10) + (Item 11 * Item 12) + (1.5 * (Item 5 / 12))]</i>	116.9	276.8	-	-
<sup>14</sup> Untreated Volume (ft <sup>3</sup> ) <i>V<sub>untreated</sub> = Item 2 – Item 13</i> <i>If greater than zero, adjust BMP sizing variables and re-compute retention volume</i>	0	0	0	0
<sup>15</sup> Treated Flow Rate (ft <sup>3</sup> /s) <i>Q<sub>treated</sub> = 1/43,200*(Item 3 * Item 4)</i>	0.0208	0.0260	0.0000	0.0000
<sup>16</sup> Total Treated Flow Rate for Project (ft <sup>3</sup> /s) <i>Q<sub>total</sub> = Sum of Item 15 for all DMAs</i>	0.0468			
<sup>17</sup> Is WQV for each DMA treated on-site? <i>Check Yes if Item 14 equals 0 for all DMAs</i>	Yes	<b>X</b>	No	

## Form 5-1 BMP Inspection and Maintenance

BMP	Inspection Point and Frequency	Maintenance Activity Required
Rain Barrels	Roof drains/Annual	Remove debris
	Barrels/Annual	Repair leaks
	Irrigation piping/Annual	Repair leaks
Veg Swale	Embankments and channel invert/Annual or as needed	Repair erosion problems, remove debris and sediment.
Bioretention facility in parking lot	Inlets and Outlets/ Twice a year	Remove debris
	Plants/Monthly	Irrigate, weed control, replace dead plants
	Overflow structure/ Twice a year	Remove debris to unclog

## Form 6-1 Post-Construction Stormwater BMPs

*Following is a summary of all BMPs included in the Project design. This checklist must be included on the cover sheet of the Improvement Plans for all Regulated Projects.*

	BMP	Plan Sheet Number(s)
Structural Source Controls (list BMPs)	<b>Refuse bins</b>	<b>C3</b>
	<b>Floor drains</b>	<b>C6</b>
Site Design Measures	Stream Setbacks and Buffers	
	Soil Quality Improvement and Maintenance	
	Tree Planting and Preservation	<b>C4</b>
	Rooftop and Impervious Area Disconnection	<b>C4</b>
	Porous Pavement	
	Vegetated Swales	<b>C5</b>
	Rain Barrels and Cisterns	<b>C2</b>
Stormwater Treatment and Baseline Hydromodification Measures	Bioretention with Infiltration	<b>C8 and Detail 1</b>
	Flow-Through Planters, Tree Box Filters and Media Filters	
Hydromodification Management Measures	Supplemental Detention	

# **Hydromodification Management Project**

# Post-Construction Storm Water Quality Plan

For:

**Sierra Market Place**

**Placer County, California**

Planning Permit No. 2

Prepared for:

**Joe Jones**

**CEO**

**High Country Development**

**54321 Snowy Rd**

**Placer City, CA 99999**

**999-999-9999**

Prepared by:

**Blizzard Engineering Inc**

**25 Alpine St.**

**Placer City, CA 99999**

**999-999-1000**

Preparation Date: **May 2, 2017**

Approval Date: \_\_\_\_\_

## Section 1 General Project Information

The undersigned owner of the subject property, is responsible for the implementation of the provisions of this plan, including ongoing operations and maintenance (O&M), consistent with the requirements of the East Placer Storm Water Quality Design Manual and the State of California Phase II Small MS4 General Permit (Order No: 2013-0001-DWQ). If the undersigned transfers its interest in the property, its successors-in-interest shall bear the aforementioned responsibility to implement the SWQP.

For all Regulated Projects (As identified in Form 1-2 below), the undersigned owner hereby grants access to all representatives of Placer County for the sole purpose of performing O&M inspections of the installed treatment system(s) and hydromodification control(s) if any.

A copy of the final signed and fully approved SWQP shall be available on the subject site for the duration of construction and then stored with the project approval documentation and improvement plans in perpetuity.

<b>Form 1-1 Project Identification and Owner's Certification</b>		
Project Site Address:	54000 Snowy Rd	
<b>Owner Name:</b>	Joe Jones	
Title	CEO	
Company	High Country Development	
Address	54321 Snowy Rd	
City, State, Zip Code	Placer City, CA 99999	
Email	<a href="mailto:Joe@email.com">Joe@email.com</a>	
Telephone #	999-999-9999	
Signature	Date	
<b>Engineer:*</b>	Phil Lakes, P.E.	<b>PE Stamp*</b> (Required for all Regulated Projects)
Title	Engineer	
Company	Blizzard Engineering Inc	
Address	25 Alpine St.	
City, State, Zip Code	Placer City, CA 99999	
Email	<a href="mailto:Phil@email.com">Phil@email.com</a>	
Telephone #	999-999-1000	
Signature		
Brief Description of Project:  (Attach additional sheets as necessary)	New market and parking lot.	

\* Not required for Small Projects as determined in Form 1-2 below. Project owners are responsible for ensuring that all storm water facilities are designed by an appropriately licensed and qualified professional.

## Form 1-2 Project Category

### Development Category

(Indicate project category by checking the appropriate box and enter corresponding impervious area)

<sup>1</sup> <b>Small Project</b> – All projects, except LUPs, that create and/or replace between 2,500-5,000 ft <sup>2</sup> of impervious surface or detached single family homes that create and/or replace 2,500 ft <sup>2</sup> or more of impervious surface and are not part of a larger plan of development.	
<sup>2</sup> Enter total new and/or replaced impervious surface (ft <sup>2</sup> )	
<sup>3</sup> <b>Regulated Project</b> – All projects that create and/or replace 5,000 ft <sup>2</sup> or more of impervious surface.	
<sup>4</sup> <b>Regulated Redevelopment Project</b> with equal to, or greater than 50 percent increase in impervious area	
<sup>5</sup> <b>Regulated Redevelopment Project</b> with less than 50 percent increase in impervious area	
<sup>6</sup> Enter total pre-project impervious surface (ft <sup>2</sup> )	
<sup>7</sup> Enter total new and/or replaced impervious surface (ft <sup>2</sup> )	
<sup>8</sup> <b>Regulated Road or linear underground/overhead project (LUP)</b> creating 5,000 ft <sup>2</sup> or more of newly constructed contiguous impervious surface.	
<sup>9</sup> Enter total new and/or replaced impervious surface (ft <sup>2</sup> )	
<sup>10</sup> <b>Regulated Hydromodification Management Project</b> – Regulated projects that create and/or replace 1 acre or more of impervious surface. A project that does not increase impervious surface area over the pre-project condition is not a hydromodification management project.	X
<sup>11</sup> Enter total new and/or replaced impervious surface (ft <sup>2</sup> )	392,040

## Section 3 Regulated Projects


**Section 3 forms are to be completed for all Regulated Projects.**

### Form 3-1 Site Location and Hydrologic Features

Site coordinates:  <i>Take GPS measurement at approximate center of site</i>	<sup>1</sup> Latitude  xx.xxxx	<sup>2</sup> Longitude  xxx.xxxx	<sup>3</sup> Elevation (ft. above sea level)  6500	<sup>4</sup> 85th Percentile, 24 Hour Design Storm Depth (in):  1.2
<sup>5</sup> Receiving waters <i>Name of stream, lake or other downstream waterbody to which the site runoff eventually drains</i>		Truckee River		
<sup>6</sup> 303(d) listed pollutants of concern <i>Refer to State Water Resources Control Board website <a href="http://www.waterboards.ca.gov/water_issues/programs/water_quality_assessment/#impaired">www.waterboards.ca.gov/water_issues/programs/water_quality_assessment/#impaired</a></i>		Sediment		
<sup>7</sup> Is Project going to be phased? <i>If yes, ensure that the SWQP evaluates each phase with distinct DMAs, requiring LID BMPs to address runoff at time of completion.</i>				No

<sup>8</sup> Use this form to show a conceptual schematic depicting DMAs and conveyance features connecting DMAs to the site outlet(s). An example is provided below that can be modified for the proposed project or a drawing clearly showing DMAs and flow routing may be attached.

**Example only**  
**Modify for project specific SWQP**  
**Use separate sheet if necessary**

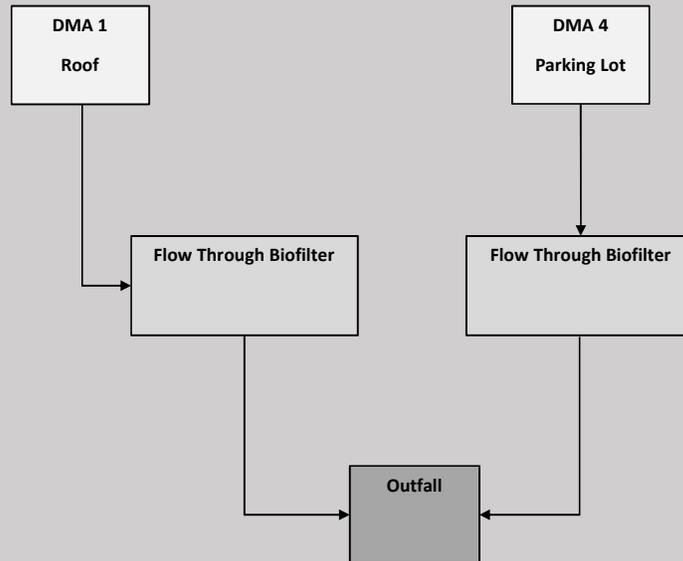

### Form 3-2 Site Assessment and Layout Documentation

	Has this Item been considered in the Site Layout and depicted in the Site Plan?	
	Yes	Not Applicable (Include brief explanation)
Define the development envelope and protected areas, identifying areas that are most suitable for development and areas to be landscaped, or left undisturbed, and used for infiltration and/or snow storage.	Yes	NA, Previously developed site, all areas previously disturbed. Majority of site to be developed with stormwater treatment along one side of parcel.
Concentrate development on portions of the site with less permeable soils and preserve areas that can promote infiltration.	Yes	NA, uniform clay soils throughout site, no infiltration is feasible.
Limit overall impervious coverage of the site with paving and roofs.	Yes	NA, conforming to local impervious coverage ordinance
Set back development from creeks, wetlands, and riparian habitats.	Yes	NA, no creeks or wetlands nearby
Preserve significant trees.	Yes	NA, no trees or native vegetation present
Conform site layout along natural landforms.	Yes	NA, site previously graded flat
Avoid excessive grading and disturbance of vegetation and soils.	Yes	NA, entire site previously disturbed.
Replicate the site's natural drainage patterns.	Yes	Very slow infiltration rates, extended ponding in lower areas during wet periods. Regrading for building pad and parking lot, routing runoff to biotreatment facility.
Detain and retain runoff throughout the site.	X	High groundwater area, infiltration not feasible. Runoff is detained and treated in a flow-through system then discharged to City MS4.

**Attach a Site Plan that incorporates the applicable considerations above. Ensure that the following items are included in the Site Plan:**

- Site Boundary
- Soil types and areal extents, test pit and infiltration test locations
- Topographic data with 1 ft. contours
- Existing natural hydrologic features (depressions, watercourses, wetlands, riparian corridors)
- Environmentally sensitive areas and areas to be preserved.
- Proposed locations and footprints of improvements creating new, or replaced, impervious surfaces
- Potential pollutant sources and locations
- Entire site divided into separate DMAs with unique identifiers
- Existing and proposed site drainage network with flow directions and site run-on and discharge locations
- Proposed design features and surface treatments used to minimize imperviousness and reduce runoff including snow storage areas
- Proposed locations and footprints of treatment and hydromodification management facilities
- Design features for managing authorized non-stormwater discharges
- Areas of soil and/or groundwater contamination
- Existing utilities and easements
- Maintenance areas



Form 3-3 Source Control Measures			
Potential Pollutant Generating Activity or Source	Check One		Describe the source control measures to be implemented for each potential pollutant generating activity or source present on the project as listed in Appendix C and in the CASQA Fact Sheets. Include any special features, materials, or methods of construction that will be used.
	Present	Not Applicable	
Accidental spills or leaks	<input checked="" type="checkbox"/>	<input type="checkbox"/>	All materials will be stored inside and properly sealed.
Interior floor drains	<input checked="" type="checkbox"/>	<input type="checkbox"/>	Floor drains connect to sanitary sewer.
Parking/storage areas and maintenance	<input checked="" type="checkbox"/>	<input type="checkbox"/>	Parking lot to be swept monthly.
Indoor and structural pest control	<input checked="" type="checkbox"/>	<input type="checkbox"/>	Periodic inspections and treatment. No pesticides stored on site.
Pools, spas, ponds, decorative fountains, and other water features	<input type="checkbox"/>	<input checked="" type="checkbox"/>	
Landscape/outdoor pesticide use	<input checked="" type="checkbox"/>	<input type="checkbox"/>	All manufacturer recommendations and regulations will be followed. Minimum amounts will be used.
Restaurants, grocery stores, and other food service operations	<input type="checkbox"/>	<input checked="" type="checkbox"/>	
Refuse areas	<input checked="" type="checkbox"/>	<input type="checkbox"/>	Trash bins to be closed and locked.
Industrial Processes	<input checked="" type="checkbox"/>	<input type="checkbox"/>	Lumber processing and storage yard. No direct drains to storm drainage system. Outdoor areas swept daily.
Outdoor storage of equipment or materials	<input checked="" type="checkbox"/>	<input type="checkbox"/>	All material storage areas are covered and include secondary containment.
Vehicle and equipment cleaning	<input type="checkbox"/>	<input checked="" type="checkbox"/>	
Vehicle and equipment repair and maintenance	<input type="checkbox"/>	<input checked="" type="checkbox"/>	
Fuel dispensing areas	<input type="checkbox"/>	<input checked="" type="checkbox"/>	
Loading docks	<input checked="" type="checkbox"/>	<input type="checkbox"/>	Drains to sump. Sump is cleaned as needed and materials disposed of at landfill, or in sanitary sewer.
Fire sprinkler test water	<input checked="" type="checkbox"/>	<input type="checkbox"/>	To be disposed in sanitary sewer.
Drain or wash water from boiler drain lines, condensate drain lines, rooftop equipment, drainage sumps, and other sources	<input checked="" type="checkbox"/>	<input type="checkbox"/>	To be disposed in sanitary sewer.
Unauthorized non-storm water discharges	<input type="checkbox"/>	<input checked="" type="checkbox"/>	
Building and grounds maintenance	<input checked="" type="checkbox"/>	<input type="checkbox"/>	Landscape maintenance to use minimal fertilizers.

The source control measures identified in this table shall be designed consistent with recommendations from the CASQA Stormwater BMP Handbook for New Development and Redevelopment<sup>1</sup>, or from another equivalent manual.

<sup>[1]</sup> California Stormwater BMP Handbook New Development and Redevelopment. California Stormwater Quality Association (CASQA). January 2003.

Form 3-4 Runoff Reduction Calculator for Site Design Measures on Regulated Projects										
		<sup>1</sup> DMA ID No.	1		2		3		4	
Site Design Measure	Runoff Reduction Parameters			Runoff Reduction (ft <sup>3</sup> )						
<sup>2</sup> Adjacent/On-Site Stream Setbacks and Buffers	A <sub>imp</sub> (ft <sup>2</sup> )	impervious drainage area		0		0		0		0
	V <sub>85</sub> (in)	runoff volume from 85th percentile, 24-hour storm	1.1		1.1		1.1		1.1	
<sup>3</sup> Soil Quality Improvement and Maintenance	A <sub>pond</sub> (ft <sup>2</sup> )	ponding area								
	D <sub>pond</sub> (ft)	ponding depth								
	A <sub>sa</sub> (ft <sup>2</sup> )	soil amendment area		0		0		0		0
	D <sub>sa</sub> (ft)	depth of amended soil								
<sup>4</sup> Tree Planting and Preservation	n	porosity of amended soil								
	n <sub>e</sub>	number of new evergreen trees								
	n <sub>d</sub>	number of new deciduous trees								
	A <sub>ec</sub> (ft <sup>2</sup> )	canopy area of existing trees to remain on the property		0		0		0		0
<sup>5</sup> Rooftop and Impervious Area Disconnection	V <sub>85</sub> (in)	runoff volume from 85th percentile, 24-hour storm	1.1		1.1		1.1		1.1	
	A <sub>imp</sub> (ft <sup>2</sup> )	impervious drainage area		0		0		0		0
<sup>6</sup> Porous Pavement	V <sub>85</sub> (in)	runoff volume from 85th percentile, 24-hour storm	1.1		1.1		1.1		1.1	
	A <sub>res</sub> (ft <sup>2</sup> )	area of gravel storage layer		0		0		0		0
	D <sub>res</sub> (ft)	depth of gravel storage layer								
	n <sub>agg</sub>	porosity of aggregate								
<sup>7</sup> Vegetated Swales	C	efficiency factor								
	A <sub>imp</sub> (ft <sup>2</sup> )	impervious drainage area		0		0		0		0
<sup>8</sup> Infiltration Trenches	V <sub>85</sub> (in)	runoff volume from 85th percentile, 24-hour storm	1.1		1.1		1.1		1.1	
	L (ft)	trench length								
<sup>9</sup> Dry Wells and Underground Infiltration Facilities	W (ft)	trench width		0		0		0		0
	D (ft)	trench depth								
<sup>10</sup> Rain Barrels and Cisterns	V (ft <sup>3</sup> )	combined volume of all dry wells and underground infiltration facilities (include supporting design documentation)		0		0		0		0
	N	number of rain barrels and/or cisterns		0		0		0		0
	V <sub>s</sub> (ft <sup>3</sup> )	volume of each rain barrel and/or cistern								
<sup>11</sup> Do all Site Design Measures meet the design requirements outlined in the Fact Sheets?					Yes		No	X		
<sup>12</sup> Total Volume Reduction (ft <sup>3</sup> )				0		0		0		0
<sup>13</sup> Effective Treated Impervious Area (ft <sup>2</sup> )				0		0		0		0



### Form 3-6 Volume-Based Infiltrating Bioretention Measures

<sup>1</sup> <b>DMA ID No.</b> <i>If combining multiple DMAs from Form 3-5, enter a new unique DMA ID No.</i>				
<sup>2</sup> <b>WQV (ft<sup>3</sup>)</b> <i>Item 5 in Form 3-5</i> <i>If combining multiple DMAs from Form 3-5, enter the sum of their respective WQVs.</i>				
<sup>3</sup> <b>Surface Loading Rate</b> <i>Maximum 5.0 in/hr</i>				
<sup>4</sup> <b>BMP Surface Area (ft<sup>2</sup>)</b> <i>Top of BMP</i>				
<sup>5</sup> <b>Infiltration rate of underlying soils (in/hr)</b>				
<sup>6</sup> <b>Maximum ponding depth (ft)</b> <i>BMP specific, see BMP design details</i>				
<sup>7</sup> <b>Ponding Depth (ft)</b> <i>d<sub>BMP</sub> = Minimum of (1/12 * Item 5 * 48 hrs) or Item 6</i>	-	-	-	-
<sup>8</sup> <b>Infiltrating surface area, SA<sub>BMP</sub> (ft<sup>2</sup>)</b> <i>Bottom of BMP</i>				
<sup>9</sup> <b>Planting media depth, d<sub>media</sub> (ft)</b>				
<sup>10</sup> <b>Planting media porosity</b>				
<sup>11</sup> <b>Gravel depth, d<sub>media</sub> (ft)</b> <i>Only included in certain BMP types</i>				
<sup>12</sup> <b>Gravel porosity</b>				
<sup>13</sup> <b>Retention Volume (ft<sup>3</sup>)</b> <i>V<sub>retention</sub> = Item 8 * [Item 7 + (Item 9 * Item 10) + (Item 11 * Item 12) + (1.5 * (Item 5 / 12))]</i>	-	-	-	-
<sup>14</sup> <b>Untreated Volume (ft<sup>3</sup>)</b> <i>V<sub>untreated</sub> = Item 2 – Item 13</i> <i>If greater than zero, adjust BMP sizing variables and re-compute retention volume</i>	0	0	0	0
<sup>15</sup> <b>Treated Flow Rate (ft<sup>3</sup>/s)</b> <i>Q<sub>treated</sub> = 1/43,200*(Item 3 * Item 4)</i>	0.0000	0.0000	0.0000	0.0000
<sup>16</sup> <b>Total Treated Flow Rate for Project (ft<sup>3</sup>/s)</b> <i>Q<sub>total</sub> = Sum of Item 15 for all DMAs</i>	0.0000			
<sup>17</sup> <b>Is WQV for each DMA treated on-site?</b> <i>Check Yes if Item 14 equals 0 for all DMAs</i>	Yes		No	X

### Form 3-7 Flow-Through Planters, Tree Box and Media Filters

<sup>1</sup> DMA ID No. <i>If combining multiple DMAs from Form 3-5, enter a new unique DMA ID No.</i>	DMA 1	DMA 2		
<sup>2</sup> WQF (ft <sup>3</sup> /s) Item 6 in Form 3-5 <i>If combining multiple DMAs from Form 3-5, enter the sum of their respective WQFs.</i>	1.0890	0.5450		
<sup>3</sup> Surface Loading Rate Maximum 5.0 in/hr	5.0	5.0		
<sup>4</sup> Maximum Ponding Depth (ft) <i>BMP Specific, see BMP design details</i>	0.5	0.5		
<sup>5</sup> Soil/Media Surface Area (ft <sup>2</sup> ) <i>Top of BMP</i>	9500	5100		
<sup>6</sup> Soil/Media Depth (ft)	1.50	1.50		
<sup>7</sup> Soil/Media porosity	0.30	0.30		
<sup>8</sup> Gravel Depth (ft)	1.00	1.00		
<sup>9</sup> Gravel porosity	0.30	0.30		
<sup>10</sup> Detention Volume (ft <sup>3</sup> ) $V_d = \text{Item } 5 * [\text{Item } 4 + (\text{Item } 6 * \text{Item } 7) + (\text{Item } 8 * \text{Item } 9) + (3 * (\text{Item } 3 / 12))]$	23,750	12,750	0	0
<sup>11</sup> Manufacturers' specified flow rate for proprietary devices (ft <sup>3</sup> /s) <i>(attach a copy of the product specifications)</i>				
<sup>12</sup> Treated Flow Rate (ft <sup>3</sup> /s) $Q_{\text{treated}} = 1/43,200 * (\text{Item } 3 * \text{Item } 5) \text{ or Item } 11$	1.0995	0.5903	0.0000	0.0000
<sup>13</sup> Untreated Flow Rate (ft <sup>3</sup> /s) $Q_{\text{untreated}} = \text{Item } 2 - \text{Item } 12$ <i>If greater than zero, adjust BMP sizing variables and re-compute treated flow</i>	0.0000	0.0000	0.0000	0.0000
<sup>14</sup> Total Treated Flow Rate for Project (ft <sup>3</sup> /s) $Q_{\text{total}} = \text{Sum of Item } 12 \text{ for all DMAs}$	1.6898			
<sup>15</sup> Is WQF for each DMA treated on-site? <i>Check Yes if Item 13 equals 0 for all DMAs.</i>	Yes	<b>X</b>	No	

## Section 4 Regulated Hydromodification Management Projects

### Form 4-1 Peak Runoff Response Time (Complete Section 4 forms for Regulated Hydromodification Projects only)

Determine total runoff response time for pre- and post-construction conditions at each project outlet.

Variables	Pre-construction DMAs to Project Outlet				Post-construction DMAs to Project Outlet			
	1	2	3	4	1	2	3	4
<sup>1</sup> Length of longest overland flow path <i>Not to exceed 100 ft</i>	100				0			
<sup>2</sup> Slope of overland flow path (ft/ft)	0.0050				NA			
<sup>3</sup> Manning's roughness coefficient for overland flow surface <i>See Table 5-5 of the Placer County SWMM</i>	0.4000				NA			
<sup>4</sup> Overland flow response time (min) $(0.355 * (\text{Item 1} * \text{Item 3})^{0.6}) / (\text{Item 2}^{0.3})$	15.91	0.00	0.00	0.00	0.00	0.00	0.00	0.00
<sup>5</sup> Hydrologic Soil Group <i>Refer to Section 3.1.1. or NRCS Web Soil Survey</i>	D				D			
<sup>6</sup> Current Land Cover Type(s) <i>Select from categories shown in Table 5-3 of the SWMM</i>	Bare				Commercial			
<sup>7</sup> Pervious Area Condition: <i>Based on the extent of vegetated cover Good &gt;75%; Fair 50-75%; Poor &lt;50% Attach photos of site to support rating</i>	Poor				NA			
<sup>8</sup> Infiltration Rate (in/hr) <i>Refer to Table 5-3 of the SWMM using Items 3, 4, and 5 above or obtain site specific field measurements (See Section 3.1.1)</i>	0.01				0.00			
<sup>9</sup> Length of collector flow (ft)	700				800			
<sup>10</sup> Cross-sectional area of collector flow facility (ft <sup>2</sup> )	1.00				7.00			
<sup>11</sup> Wetted perimeter of collector flow facility (ft)	3.50				9.40			
<sup>12</sup> Manning's roughness of collector flow facility	0.040				0.010			
<sup>13</sup> Slope of collector flow facility (ft/ft)	0.0050				0.0050			
<sup>14</sup> Channel flow velocity (ft/sec) $V = (1.49 / \text{Item 12}) * (\text{Item 10} / \text{Item 11})^{0.67} * (\text{Item 13})^{0.5}$	1.14	0.00	0.00	0.00	8.66	0.00	0.00	0.00
<sup>15</sup> Collector flow facility response time (min) $T_c = \text{Item 9} / (\text{Item 14} * 60)$	10.21	0.00	0.00	0.00	1.54	0.00	0.00	0.00
<sup>16</sup> Total runoff response time or T <sub>t</sub> (min) $T_t = \text{Item 4} + \text{Item 15}$	26.12	0.00	0.00	0.00	1.54	0.00	0.00	0.00

**Form 4-2 Hydromodification Target for Peak Runoff**

Variables	Pre-construction DMAs to Project Outlet				Post-construction DMAs to Project Outlet			
	1	2	3	4	1	2	3	4
<sup>1</sup> Drainage Area (ft <sup>2</sup> ) <i>Sum of all outlet level DMAs should equal total project area.</i>	392,040				392,040			
<sup>2</sup> Impervious Area (ft <sup>2</sup> ) <i>Sum of all outlet level DMAs should equal total project impervious area.</i>	0				392,040			
<sup>3</sup> Rainfall depth for 2yr storm with duration equal to response time (in) <i>See Placer County SWMM Table 5-A-2 for elevation of site and duration equal to response time</i>	0.25				0.08			
<sup>4</sup> Unit peak runoff (cfs/acre) <i>q = 60/Form 4-1 Item 16 * Item 3</i>	0.57	-	-	-	3.12	-	-	-
<sup>5</sup> Infiltration factor (cfs/acre) <i>F<sub>i</sub> = Form 4-1 Item 8 * (1 + 1/(1.3 + 0.0005 * Form 3-1 Item 3))</i>	0.01	-	-	-	-	-	-	-
<sup>6</sup> Peak runoff from DMAs (cfs) <i>Q<sub>p</sub> = Item 1 * Item 4 – Item 5 * (Item 1 - Item 2)</i>	5.10	-	-	-	28.28	-	-	-
<sup>7</sup> Total Pre-Project Peak Runoff (ft <sup>3</sup> /s) <i>Q<sub>total</sub> = Sum of Item 6 for all Pre-construction DMAs</i>								
	5.10							
<sup>8</sup> Is the total post-project treated flow rate equal to or less than the total pre-project peak runoff? <i>Yes, if Item 7 is greater than or equal to the sum of the Total Treated Flow Rates from Form 3-6 Item 16 and 3-7 Item 14.</i>	YES							

## Form 4-3 Detention Volumes for Hydromodification Management

	Post-construction DMAs to Project Outlet			
	1	2	3	4
<sup>1</sup> Land cover and hydrologic condition <i>See NRCD TR-55 Manual Table 2-2 for types</i>	Commercial and business			
<sup>2</sup> Hydrologic Soil Group <i>Refer to Section 3.1.1. or NRCS Web Soil Survey</i>	D	-	-	-
<sup>3</sup> Drainage Area (A) (ft <sup>2</sup> )	392,040	-	-	-
<sup>4</sup> Curve Number (CN) <i>Use Items 1 and 2 to select curve number from NRCS TR-55 Manual Table 2-2</i>	95			
<sup>5</sup> Post-development soil storage capacity, S (in): $S = (1000 / \text{Item 4}) - 10$	0.5	#DIV/0!	#DIV/0!	#DIV/0!
<sup>6</sup> Precipitation for 2-yr, 24-hr storm (in) <i>See Placer County SWMM Table 5-A-1 for elevation of site and 24-hr duration depths</i>	2.80			
<sup>7</sup> Post-developed runoff volume for 2-yr – 24-hour storm, $V_{\text{runoff}}$ (ft <sup>3</sup> ): $V_{\text{runoff}} = \text{Item 3} * (1 / 12) * [(\text{Item 6} - 0.2 * \text{Item 5})^2 / (\text{Item 6} + 0.8 * \text{Item 5})]$	73,652	#DIV/0!	#DIV/0!	#DIV/0!
<sup>8</sup> Attenuation Factor, $q_{\text{out/in}}$ (ratio of target outflow rate to peak inflow rate): $q_{\text{out/in}} = \text{Form 4-2 Item 6 Pre-Construction} / \text{Form 4-2 Item 6 Post-Construction}$	0.18	#DIV/0!	#DIV/0!	#DIV/0!
<sup>9</sup> Equalization Factor, $V_s/V_r$ (ratio of storage capacity to runoff volume) <i><math>V_s/V_r</math> obtained using Item 8 and nomograph in Figure 6-1 of NRCS TR-55 Manual for Rainfall Type IA</i>	0.40			
<sup>10</sup> Runoff detention capacity to achieve hydromodification management criteria (ft <sup>3</sup> ) $D_{\text{hydromod}} = \text{Item 7} * \text{Item 9}$	29461	#DIV/0!	#DIV/0!	#DIV/0!
<sup>11</sup> Site Design Measure (SDM) Volume (ft <sup>3</sup> ): <i>Sum of Item 12 in Form 3-4 for all SDMs in this DMA.</i>	0			
<sup>12</sup> Bioretention Volume (ft <sup>3</sup> ): <i>Sum of Item 13 in Form 3-6 for all bioretention measures in this DMA.</i>	0			
<sup>13</sup> Flow-Through Detention Volume (ft <sup>3</sup> ): <i>Sum of Item 10 in Form 3-7 for all flow-through facilities in this DMA.</i>	36500			
<sup>14</sup> Supplemental Detention Volume (ft <sup>3</sup> ):	0			
<sup>15</sup> Combined Detention Volume in this DMA (ft <sup>3</sup> ): <i>Sum of Items 11 through 14</i>	36,500	-	-	-
<sup>16</sup> Is detention capacity to achieve hydromodification management criteria achieved at all project outlets? <i>Yes, if Item 10 is less than or equal to Item 15 for each DMA. If not provide additional storage capacity with appropriate flow controls at the discharge.</i>	Yes	X	No	

## Form 5-1 BMP Inspection and Maintenance

BMP	Inspection Point and Frequency	Maintenance Activity Required
Biofilters	Inlets and outlets/annually	Remove debris as needed to maintain flow
	Surface of filter bed/annually and after large storms	Remove accumulations to as needed maintain filtration rates
	Vegetation/annually	Remove weeds, replace dead plants

## Form 6-1 Post-Construction Stormwater BMPs

*Following is a summary of all BMPs included in the Project design. This checklist must be included on the cover sheet of the Improvement Plans for all Regulated Projects.*

	BMP	Plan Sheet Number(s)
Structural Source Controls (list BMPs)	<b>Loading dock containment</b>	<b>C1</b>
	<b>Refuse area cover</b>	<b>C2</b>
	<b>Floor drain sump</b>	<b>C3</b>
Site Design Measures	Stream Setbacks and Buffers	
	Soil Quality Improvement and Maintenance	
	Tree Planting and Preservation	
	Rooftop and Impervious Area Disconnection	
	Porous Pavement	
	Vegetated Swales	
	Rain Barrels and Cisterns	
Stormwater Treatment and Baseline Hydromodification Measures	Bioretention with Infiltration	
	Flow-Through Planters, Tree Box Filters and Media Filters	<b>C5 and D5</b>
Hydromodification Management Measures	Supplemental Detention	